



Genesee County Land Bank Authority

452 S. Saginaw St. 2nd Floor, Flint, MI 48502

Neighborhood Stabilization Program 2 (NSP2)

Invitation for Bids – General Contractor

841 E. Ninth St., Flint, MI 48503

BID NUMBER: LB 11-030

Due Date: Monday, September 19, 2011 at 3:00 pm EST

As part of the Michigan NSP 2 Consortium, a partnership between:

Michigan State Housing Development Authority (MSHDA)

The City of Flint

Genesee County Land Bank Authority (GCLBA)



INVITATION FOR BIDS: 841 E. NINTH ST. – GENERAL CONTRACTOR

Overview

The Genesee County Land Bank Authority (GCLBA) is seeking sealed bids for the rehabilitation of 841 E. Ninth St., Flint, MI 48503. This property is being rehabilitated as single-family residential homes to be sold to income eligible buyers under the Neighborhood Stabilization Program 2 (NSP2). The GCLBA has received NSP 2 grant funding from the MSHDA for this purpose. The NSP 2 funds are provided to MSHDA from the U.S. Department of Housing and Urban Development (HUD).

Sealed Bid Due Date

General contractors with qualifications and experience in renovation of single-family residential properties invited to submit sealed bids to the Genesee County Land Bank Authority, 452 S. Saginaw St., 2nd Floor, Flint, Michigan 48502 on or before **Monday, September 19, 2011 at 3:00 pm EST.** The outside of the envelope must be marked **“LB 11-030, Sealed Bid for 841 E. Ninth St.”**

Bid Opening

The bid opening will be Monday, September 19, 2011 at 3:15 pm EST at the Genesee County Land Bank Authority, Conference Room, 452. S. Saginaw St., 2nd Floor, Flint, MI 48502 and is open to the public.

Mandatory Pre-bid Meeting and Walkthrough

A mandatory pre-bid meeting will take place at 1602 N. Grand Traverse St., Flint, MI 48503 at 9:00 am on Friday, September 9th, 2011.

A mandatory walkthrough of property to be rehabilitated will follow at 841 E. Ninth St., Flint, MI 48503 from 10:15 am to 11:15 am.

Bidders must be present at both the pre-bid meeting and the walkthrough in order to bid on this proposal.



Proposal Requirements/ Bidding Instructions

Bids must be sealed, the outside of the envelope must be marked “LB 11-030, Sealed Bid for 841 E. Ninth St.” and contain the following:

1. Copy of a Valid State of Michigan Builders License
2. Copies of E.P.A. Renovator and Firm Certificates
3. Copy of Lead Abatement Contractor Certification
4. 2011 Certificate to do Business with Genesee County
5. City of Flint Section 3 Certification
6. Insurance Certificate including:
 - a. Worker’s Compensation
 - b. General Liability of \$2,000,000 for Bodily Injury and Property Damage
 - c. Genesee County Land Bank named as a Certificate Holder
7. Bid Guarantee Required at 5% of the bid amount if the contractor’s bid amount is over \$50,000
8. Subcontractor information form (attached)
9. Certification Form Note (attached)
10. Demonstration of Capacity Form (attached)
11. Typed or Inked Contractor Bid Form and Specifications (attached)

City of Flint Section 3 Certification

City of Flint Section 3 Certification is a requirement of this rehabilitation project. The lowest qualified bidder of this proposal will be given 10 business days from the bid opening to provide the Genesee County Land Bank with a Section 3 Certification from the City of Flint. Requirements for this are included in the bid package. Certified payroll will be required to accompany the monthly Section 3 forms to assure GCLBA that the Section 3 compliance is met. The Certified payroll will not be linked to Davis-Bacon wage rates. This is not a Davis- Bacon project.

Bid Acceptance

Bid proposals of more than 10% lower or 15% higher than the GCLBA cost estimate will be disqualified. The GCLBA anticipates immediately entering into a contract with the general contractor after all certification requirements have been provided and accepted. The contractor must be ready to begin work immediately upon receipt of the notice to proceed by the GCLBA.

Value Engineering

Value engineering may be used by the GCLBA after the contractor has been selected particularly in instances where a line item significantly varies from the specification writer’s estimate.

Method of Payment

Payment will be made for work items completed based on the accepted price per the contractors bid including any value engineering. GCLBA will provide payment for work items completed after invoice from the contractor, inspection and acceptance by GCLBA, submittal of Section 3 documentation, sworn statements and any lien waivers from the work items completed. The GCLBA will provide payment within 30 days of invoice with complete documentation as required by GCLBA.

Bonding Requirements

For any construction contracts or subcontracts exceeding **\$50,000.00**, the following is required:

1. A bid guarantee from each bidder equivalent to the bid price. The "bid guarantee" shall consist of a firm commitment such as a bid bond, certified check for 5 percent (5%) of total bid, or other negotiable instrument accompanying a bid as assurance that the bidder will, upon acceptance of his bid, execute such contractual documents as may be required within the time specified.
2. A payment and performance bond on the part of the contractor for 100 percent (100%) of the contract price.

A "payment bond" is one executed in connection with a contract to assure payment as required by law of all persons supplying labor and material in the execution of the work provided for in the contract.

A "performance bond" is one executed in connection with a contract to secure fulfillment of all the contractor's obligations under such contract.

Where bonds are required, the bonds shall be obtained from companies holding certificates of authority as acceptable sureties pursuant to 31 CFR part 223, "Surety Companies Doing Business with the United States."

OR

In lieu of acquiring the payment and performance bonds, Grantee will accept an irrevocable line of credit listing Grantee as the sole beneficiary and equal to (a) the greater of the contract award amount or (b) 25% of the total construction contract. The line of credit must be issued for the entire construction period plus one (1) year following construction completion



Demonstration of Capacity

All bidders are required to submit a statement(s) of experience, proposed plans for performing the work, and equipment available by completing the Demonstration of Capacity Form attached to this bid proposal.

Minority Owned Firms and Women's Business Enterprises

GCLBA is seeking to encourage participation by respondents who are small and minority-owned firms, women's business enterprises and labor surplus area firms.

HUD Debarred List and Excluded Parties List System

Names of owner(s) and the contractor firm awarded the winning bid on this proposal will be reviewed on the HUD Funding Disqualifications Limited Denial of Participation, HUD Funding Disqualifications and Voluntary Abstentions list https://www5.hud.gov/ecpcis/main/ECPCIS_List.jsp and the Excluded Parties List System <https://www.epls.gov/eplsearch.do> . Mechanical, electrical and plumbing contractors will also be reviewed on Debarred List and Excluded Parties List System. The subcontractor information form is attached which must be submitted with the bid.

Lead Safe Work Practices

Lead safe work practices must be used for all rehabilitation activities and performed in accordance with applicable federal, state and local laws, ordinances, codes or regulations governing evaluation and hazard reduction.

Timeline for Completion

This project must be completed within 120 days from the date the GCLBA issues a notice to proceed. This includes all work items included in the bid and GCLBA final approval at time of completion and a certificate of occupancy issued by the City of Flint Department of Building and Safety.

2011 Certificate to do Business with Genesee County

Each contractor must submit one copy of their 2011 CERTIFICATE TO DO BUSINESS WITH GENESEE COUNTY. The Land Bank follows Genesee County Office of Equity and Diversity policies and procedures for this process. For further information on this requirement, contact the Genesee County Office of Equity and Diversity, 1101 Beach Street, Room 343, Flint, Michigan 48502, phone (810) 257-3028; fax (810) 768-7943.



Federal Compliance Requirements

The contractor must comply with all of the following federal guidelines for this rehabilitation project:

1. OSHA 29 CRF 1926- Construction Industry Standards
2. 29 CFR 1926.62- Construction Industry Lead Standards
3. 29 CFR 1910.1200 – Hazard Communication
4. 40 CFR Part 261- EPA Regulations
5. HUD Title X parts 1012-1013
6. Federal Labor Standards and Provisions
7. Equal Opportunity Clause
8. Section 3 Clause
9. HUD Contract and Subcontract Activity

Questions and Addendums

Questions regarding this bid should be directed to Kyle Stottmeister at (810) 257-3088 ext. 533 or email to kstottmeister@thelandbank.org. Addendums to this bid proposal may be found at the GCLBA website at www.thelandbank.org under the tab current bids. Please check the website for updates to this bid package.



CERTIFICATION FORM NOTE

THIS PAGE MUST BE COMPLETED AND INCLUDED WITH THE SUBMITTAL CERTIFICATION

The undersigned hereby certifies, on behalf of the Respondent named in this Certification (the "Respondent"), that the information provided in this bid submittal to GCLBA is accurate and complete, and I am duly authorized to submit same. I hereby certify that the Respondent has reviewed this bid proposal in its entirety and accepts its terms and conditions.

(Name of Respondent)

(Signature of Authorized Representative)

(Typed Name of Authorized Representative)

(Title)

(Date)



DEMONSTRATION OF CAPACITY

Company Name: _____

Statement of Experience

Years of Experience: _____

Proposed Plans for Performing the Work

Date contractor can begin work: _____

Date Contractor can complete work by: _____

Equipment Available

I certify that I have the necessary equipment available in order to complete the work outlined in this bid and accompanying specifications.

Signed this _____ day of _____, _____

Contractor Name (please print)

Contractor Signature



SUBCONTRACTOR INFORMATION FORM

Please provide the following information requested below on your mechanical, electrical and plumbing subcontractors for GCLBA to check the: 1) HUD Funding Disqualifications Limited Denial of Participation, HUD Funding Disqualifications and Voluntary Abstentions list and the 2) Excluded Parties List System. Is general contractor is self-performing these items please indicate it on this list.

Mechanical Subcontractor

Firm Name: _____

Owner(s) Name(s): _____

Address, City, State, Zip: _____

Phone number: _____

Electrical Subcontractor

Firm Name: _____

Owner(s) Name(s): _____

Address, City, State, Zip: _____

Phone number: _____

Plumbing Subcontractor

Firm Name: _____

Owner(s) Name(s): _____

Address, City, State, Zip: _____

Phone number: _____



CONTRACTOR BID FORM

Owner Name: Genesee County Land Bank Authority

Contact Person/ Spec Writer: Kyle Stottmeister

Contact Phone Number: (810) 257-3088 ext. 533

Contact Email: kstottmeister@thelandbank.org

Bid Submission Deadline Date: Monday, September 19, 2011 before 3:00 pm

Property Address: 841 E. Ninth St., Flint, MI 48503

**Bid Offer as per
Attached Specifications \$** _____

Contractor Name: _____

Contractor Signature: _____ **Date:** _____

Contractor Address: _____

Contractor Phone: _____

Contractor Email: _____

**Workers Comp
Insurance Expires Date:** _____

**Liability
Insurance Expires Date:** _____

Note: Bid package includes one (1) set of specifications. One copy of the specifications must be completed and returned with this bid form that must be line priced in clearly legible numbers (ink or typewritten)

Section 3 Certification Process in the City of Flint

GCLBA follows the City of Flint's Section 3 Certification Process for the NSP 2 Program. If the contractor does not have Section 3 Certification at time of bid submission, the contractor must submit a letter stating compliance with Section 3 Certification will be achieved within 10 days of receiving contract award.

The City of Flint has strengthened the HUD requirements for Section 3. Section 3 Residents must live in the City of Flint to qualify for the GCLBA and City of Flint NSP 2 - Section 3 Program. The City of Flint has built a partnership with Mott Workforce Development to assist with certification of Section 3 Residents and Mott Workforce Development has a list of eligible Section 3 workers that the General Contractor can connect with for assistance in meeting Section 3 requirements. There is currently over 300 Section 3 Residents Certified through Mott Workforce Development with various skill sets in construction related fields.

Section 3 Business Certification

Please contact Tracy Atkinson from the City of Flint Department of Community and Economic Development (810) 766-7426 ext. 3059 or tatkinson@cityofflint.com for information regarding company Section 3 Certification.

Section 3 Residents Certification

Mott Community College Workforce Development can provide assistance with employee and laborer Section 3 Certifications. Please contact Dorian Jackson, Job Development Specialist (810) 232-2548 or dorian.jackson@mcc.edu or Kathleen Levallier, Job Development Specialist (810) 232-4674 or kathleen.levallier@mcc.edu for more information.

Attachments

The following documents are attached in order to help meet the Section 3 requirements:

- a. Section 3 Clause
- b. City of Flint – Section 3 Plan Addendum
- c. Certification for Business Concerns Seeking Section 3 Preference in Contracting and Demonstration of Capability
- d. Resident Employment Opportunity Data



SPECS BY LOCATION/TRADE

9/2/2011

Work Write-up/Re-Bid: _____
 Walk-Through Date: _____
 Bid Date: _____
 Initial: _____

Case Number: _____
 Construction Specialist: _____
 Phone: _____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 1 - General Requirements

Approx. Wall SF: 2,200

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 1 General Requirements					
36	BUILDING PERMIT REQUIRED The contractor is responsible for submitting this owner-prepared work write up to the building department, applying for, paying for and receiving a building permit prior to starting any work.	1.00	EA	_____	_____
37	ELECTRICAL PERMIT REQUIRED Prior to the start of work, the contractor shall create any documentation necessary to apply for, pay for and receive an electrical permit on behalf of the owner.	1.00	EA	_____	_____
38	PLUMBING PERMIT REQUIRED Prior to the start of work, the contractor shall: create a riser diagram, septic layout and all other documentation needed to apply for, pay for and receive a plumbing permit on behalf of the owner.	1.00	EA	_____	_____
39	HVAC PERMIT REQUIRED Prior to the start of the heating/cooling work, the contractor shall create a heating distribution layout and perform heat/cooling loss calculations and all other documentation needed to apply for, pay for and receive an HVAC permit on behalf of the owner.	1.00	EA	_____	_____
93	BID AND PERFORMANCE BOND IN COMPLIANCE WITH REQUIREMENTS Prior to commencing work, contractor shall provide owner with a bond written on the AIA form for 100% of the contract, callable in the event of either non- performance or non-payment.	1.00	M	_____	_____
Trade: 9 Environmental Rehab					
2070	ASBESTOS ABATEMENT Secure & isolate room, provide protective floor coverings when not removing floor tile. Pre-treat surface with wetting agent. Provide worker protection including whole body coveralls, respirators, & decontamination area. Dispose of asbestos in clearly identified disposal drums & HEPA vacuum entire area. All work must be done by a licensed Asbestos abatement company. Abate the following items from the hazard report by Global Environmental. 1. Stucco siding - 3,100 sq. ft. 2. Duct wrap - 102 sq. ft. 3. Duct wrap 2" tape - 10 lin. ft. 4. All hazardous materials listed in report - see list on report	1.00	AL	_____	_____
9007	CLEAN TO LEAD CLEARANCE Prior to final acceptance of the lead hazard reduction work and	1,500.00	SF	_____	_____

Location: 1 - General Requirements

Approx. Wall SF: 2,200

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 9	Environmental Rehab				

any remaining paint chips, dust and debris and lead dust wipe samples shall be obtained from floors, windows sills and window troughs. The contractor shall re-clean (Using the HEPA/wash/HEPA method) all applicable components and surfaces and pay for all additional clearance dust sampling if any dust sample results exceedd the thresholds of 40 ug/SF for floors, 250 ug/Sf for window sills and 400 ug/SF for window troughs.

Bidder: _____

Location Total: _____

Location: 2 - Interior

Approx. Wall SF: 1,404

Ceiling/Floor SF: 1,440

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				

2350 FLOOR--REFINISH WOOD

1,150.00

SF

Drum sand and edge floor. Counter sink all nails and fill holes. Vacuum and tack rag room. Apply a sanding sealer and two coats of oil based polyurethane varnish. Vacuum room. Repair water damage in both South bedrooms. Refinish stairs as well. Repair water damage in dining room and upstairs bedroom. Everywhere except Kitchen and bathrooms.

2408 BASEBOARD--1x6 WITH BASE CAP

800.00

SF

Install a 2 piece baseboard system using #2 1X6 pine (planed to 11/16" thickness where it abbutts door cassings) as base molding with finger jointed WM-65fj 11/16" x 1 3/8" base cap molding. Use finish nails of sufficient length to penetrate framing 1". Mitre all lap joints, and break all lap joints over framing. Replace all base on the second floor, include kitchen and back entrance and foyer.

2980 WINDOW--VINYL SINGLE HNG DBL GLZ

2.00

EA

Field measure, order and install a vinyl, single hung, double glazed, one-over-one window and jamb including screen, caulk, interior casing (1x4) and exterior trim. Windows should have integrated J-channel if used in conjunction with new vinyl siding. Windows must be Energy Star rated. Install half screen. Replace 2 windows in garage - cover rest with siding.

2981 Window -WOOD SINGLE HUNG, DOUBLE GLAZE

31.00

EA

Field measure, order and install a wood, single hung, double glazed, new construction window and jamb including screen, caulk, extension jambs if necessary, interior casing (1 x 4 clear pine) and exterior trim. Windows must be Energy Star rated. Window should have aluminum clad exterior. Install half screen. Window should be Jeldwen or approved equivalent. Do not include attic windows or garage windows.

Location: 2 - Interior

Approx. Wall SF: 1,404

Ceiling/Floor SF: 1,440

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10 Carpentry					
3185	DOOR--PREHUNG METAL ENTRANCE Dispose of door and frame. Install a prehung fiberglass, wood grain, insulated, 6-panel entrance door and jamb including interior (1 x 4) and exterior casing, threshold, one entrance and one mortised deadbolt keyed alike (Schlage, brass finish or approved equivalent). Paint back door with two coats of exterior acrylic latex paint (Owner's choice of color). Front door should be 1/2 light and stained to match existing trim. Replace front and back door. See lead report.	2.00	EA	_____	_____
3210	STORM DOOR--ALUMINUM Install an aluminum combination storm and screen door with white baked enamel aluminum finish and top chain. If storm is in front of entrance door with decorative oval glass it should be full view glass not split screen.	2.00	EA	_____	_____
3360	DOOR--PREHUNG SOLID CORE 2 PANEL Install a 1-3/8" prehung, solid core, 2 panel door and jamb including casing both sides (1 x 4), 3 butt hinges and a privacy lockset. Replace all interior doors on the second floor and main floor half bath and basement..	12.00	EA	_____	_____
4025	REFINISH TRIM--INTERIOR Clean trim and prepare for refinishing. Lightly sand the existing trim and apply two coats of polyurethane, sanding in between coats. Include all interior doors that are not being replaced. Refinish stained wood trim on main floor.	600.00	SF	_____	_____
Trade: 17 Drywall & Plaster					
5235	LAMINATE 1/2" DRYWALL Hang 1/2" gypsum over wall or ceiling surface with screws 8" on center and a bead of construction adhesive 20" on center. Butt drywall to door and window casing and apply J channel molding. Remove top molding from 3-piece base and reinstall after surface is paint-ready. Tape, 3-coat finish and sand ready for paint. Laminate over all ceilings in house. Laminate interior of back porch, and back foyer. Laminate walls in kitchen. Laminate drywall on whole second floor. See lead report.	3,800.00	SF	_____	_____
Trade: 19 Paint & Wallpaper					
5566	PREP & PAINT HOUSE (INTERIOR) Remove/cover all hardware, fixtures not to be painted. Wet scrape loose, cracked, peeling, blistered surfaces. Feather edges & dull gloss surfaces with sandpaper. Clean all surfaces. Spot prime and top coat trim, ceiling, walls, doors & windows with owner's choice of premixed latex. Ceilings will be flat white and walls will be owner's choice of color. Include any closets.	1,400.00	SF	_____	_____

Location: 2 - Interior

Approx. Wall SF: 1,404

Ceiling/Floor SF: 1,440

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 20 Floor Coverings					
5930	UNDERLAY & VINYL SHEET GOODS Install 1/4" underlayment (micro ply, birch plywood) , using 7d screw shank or cement coated nails, or narrow crown staples, 6" on center allowing a 1/4" gap at wall. Install 070" thick, backed vinyl sheet goods w/ minimum seams, per manufact. recommendations. Caulk edges of vinyl w/clear silicone caulk to create positive seal. Install metal edge strips in openings & shoe molding (Shoe molding along cabinets or vanities will match stain color on cabinets). \$15 material allowance for vinyl. Owner to pick style and color. Install in Kitchen, both bathrooms, and back entrance (between kitchen and 1/2 bath)	225.00	SF	_____	_____
5960	REMOVE FLOOR COVERING TO SUBFLOOR Remove floor covering to subfloor, remove all staples/nails, inspect subfloor for water/mold damage. Remove all transitions. Remove flooring in both bathrooms and kitchen.	200.00	SF	_____	_____
Trade: 21 HVAC					
6145	DUCT CLEANING Subcontract a certified duct cleaning company to remove grates and use a truck mounted cleaning system to remove all dust and particles from HVAC system. Provide written certificate at time of check request.	1,400.00	SF	_____	_____
Trade: 23 Electric					
7560	RECEPTACLE REPLACE Replace receptacle with duplex receptacle and plastic cover plate. Match existing color. Replace all receptacles in house. Include GFCI per code in kitchen and bathrooms.	1.00	AL	_____	_____
7675	SWITCH REPLACE Replace light switch with single pole, toggle switch and cover plate. Match existing color. Replace all switches throughout house.	1.00	AL	_____	_____
7805	SMOKE DETECTOR--BATTERY POWERED Install a UL approved, ceiling mounted, battery powered smoke and fire detector and battery. Must have 5 year Lithium-ion battery. Install one in each bedroom, one in the hall outside the bedrooms, one in basement, one in attic, and one on main floor.	7.00	EA	_____	_____
8045	DOORBELL SYSTEM Install a wireless doorbell system containing a buzzer and two door buttons.	1.00	EA	_____	_____
Trade: 1200 Furnishings (CSI)					
C12500	INSTALL WINDOW TREATMENTS	21.00	EA	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 2 - Interior

Approx. Wall SF: 1,404

Ceiling/Floor SF: 1,440

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 1200	Furnishings (CSI)				
	Install window treatments in all windows. Owner will pick treatments (\$35 material allowance for standard windows, \$75 for windows over 5' wide).				

Bidder: _____

Location Total: _____

Location: 3 - Kitchen

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 5	Demolition & Disposal				
707	FRAME IN REFRIGERATOR OPENING & PATCH WALL	1.00	EA	_____	_____
	Remove refrigerator from wall. Frame in opening with 2 x 4 (16 o.c.) Insulate with R-11 batt insulation. Sheet exterior and drywall interior, finish and sand. Patch plaster on walls in kitchen at same time.				
711	REMOVE BEARING WALL	11.00	LF	_____	_____
	Temporarily shore up ceiling on both sides of wall. Remove bearing wall. Install a support beam (LVL or equivalent support - size subject to engineering requirements). Beam may be installed below joist. Install support studs for beam in wall on either side. Remove wall between Kitchen and dining room. Eliminate any electrical, plumbing, or HVAC as necessary.				

Trade: 10 **Carpentry**

3715	CABINET--WOOD BASE	17.00	LF	_____	_____
	Replace base cabinets. Install base cabinet with doors of solid oak or maple. Cabinet will have solid oak or maple stiles, 1/2" veneered plywood sides and metal or plastic corner bracing. Drawers shall be made of wood or composition material. Cabinets will have pulls or knobs and will match the finish on the faucet. Cabinets will be Kountry Wood Products Harmony Line - Bristol Maple (Or approved Equivalent) Available at Starline Kitchen and Bath Leave spot for dishwasher - run electric and plumbing.				
3725	CABINET--WOOD WALL	15.00	LF	_____	_____
	Replace wall cabinets. Field measure and screw to studs, level and plumb, kitchen wall cabinet. Door to be solid wood. Frame to have solid wood stiles, 1/2" plywood sides, metal or plastic corner bracing. Cabinets will have pulls or knobs and will match the finish on the faucet. Cabinets will be Kountry Wood Products Harmony Line - Bristol Maple (Or approved Equivalent) Available at Starline Kitchen and Bath Install outlet in upper cabinet above range for microwave.				
3750	COUNTER TOP--PLASTIC LAMINATE	26.00	LF	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 3 - Kitchen

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				

Dispose of counter top. Field measure and manufacture a plastic laminate counter top, glued to particle board designed for this purpose. Provide cutout for sink. Owner's choice of in-stock color and texture.

Trade: 22 Plumbing

6835 SINK--DOUBLE BOWL COMPLETE--GCI

1.00

EA

Install a 22 gauge 33" x 22" x 8" double bowl, stainless steel, self rimming kitchen sink including a Delta "Cicera" single handle faucet - model #468-SSSD-DST - brushed stainless finish (or approved equivalent), trap, supply lines, shut-off valves & escutcheon plates on all supply & drain lines. NOTE: All copper is to be soldered & all PVC fittings glued.

Trade: 23 Electric

7730 LIGHT FIXTURE--REPLACE

1.00

EA

Replace a ceiling mounted, 4 bulb, UL approved, incandescent light fixture with shade and lamps. \$150 allowance for fixture. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb.

7740 LIGHT FIXTURE AND SWITCH

1.00

EA

Install a ceiling mounted, UL approved, 1 bulb light fixture (\$50 material allowance) controlled by an switch with a cover located at the strike side of the door. Fish wire and repair all tear out. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb. Light will be "pendant" type light directly over the sink.

7845 GARBAGE DISPOSAL AND CIRCUIT

1.00

EA

Mount a 1/2 horsepower garbage disposal with a stainless steel chamber under sink and connect to waste line. Install an ivory toggle switch on wall adjacent sink and power wiring on independent 15 amp circuit. Fish wire and patch all tear out.

Bidder: _____

Location Total: _____

Location: 4 - Dining Room

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 23	Electric				

7730 LIGHT FIXTURE--REPLACE

1.00

EA

Replace a ceiling mounted, UL approved, incandescent light fixture with shade and lamps. \$150 allowance for fixture. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb.

Bidder: _____

Location Total: _____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 5 - Living Room

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 23	Electric				
7730	LIGHT FIXTURE--REPAIR SCONCE Repair wall mounted, sconces above fireplace. Rewire if necessary, clean, and mount to new junction boxes. Bulbs should be CFL or approved high efficiency bulb. Sconce lights on either side of fireplace.	2.00	EA	_____	_____
7740	LIGHT FIXTURE Install a ceiling mounted, UL approved, light fixture (\$150 material allowance) controlled by an switch with a cover located at the strike side of the door. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb. Replace light fixture in front entrance.	1.00	EA	_____	_____

Bidder: _____

Location Total: _____

Location: 6 - Office

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 23	Electric				
7730	LIGHT FIXTURE--REPLACE SCONCE Replace awall mounted, UL approved, incandescent light fixture with shade and lamps. \$50 allowance for fixture. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb.	1.00	EA	_____	_____

Bidder: _____

Location Total: _____

Location: 7 - 1/2 Bath

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 5	Demolition & Disposal				
735	DEMOLISH BATHROOM & MOVE WALL Remove all bath fixtures. Remove drywall on walls to studs. Remove all nails and prepare for new drywall. Reframe wall to office to make bathroom large enough for standard vanity and toilet. See lead report.	1.00	EA	_____	_____

Trade: 10	Carpentry				
3820	TOWEL SET-- 3-PIECE CHROME Install a chrome plated steel bath set comprised of a soap dish, 24" towel bar and toilet paper holder.	1.00	EA	_____	_____
3832	BATH MIRROR Install beveled edge mirror sized at the width of vanity by 36" high. Install on back wall over toilet	1.00	SF	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 7 - 1/2 Bath

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				

Trade: 17 Drywall & Plaster

5280 DRYWALL--WATER RESISTANT

100.00

SF

Hang, tape and 3 coat finish 1/2" water resistant drywall. Apply a 3/8" bead of adhesive to framing member and screw or nail 8" on center. Wet sand ready for paint.

Trade: 22 Plumbing

6901 VANITY--30" COMPLETE

1.00

EA

Install a 30" vanity complete with plywood cabinet, cultured marble top, Delta, single handle brushed stainless steel finish (like model #B510LF-SS or approved equivalent), supply risers, shut-off valves and all required waste connectors to complete the installation.

7010 COMMODE--REPLACE--1.6 GPF--GCI

1.00

EA

Install a 2 piece, close coupled, white, vitreous china, commode with a maximum water usage per flush of 1.6 Gallons. Include plastic or pressed wood white seat, supply pipe, shut-off valve, flap valve and wax seal.
Toilet should be Mansfield Model 135 elongated bowl (or approved equivalent)

Trade: 23 Electric

7753 REPLACE WALL LIGHT FIXTURE

1.00

EA

Replace fixture with a wall mounted 4 bulb fixture. Ensure proper operation with existing switch. \$50 fixture allowance, Owner will pick fixture.
Bulbs should be CFL or approved high efficiency bulb.
Move light to back wall over the toilet

Bidder: _____

Location Total: _____

Location: 9 - Back Entrance

Approx. Wall SF: 256

Ceiling/Floor SF: 60

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 5	Demolition & Disposal				

735 DEMOLISH INTERIOR OF BACK ENTRANCE

1.00

EA

Remove all shelves, doors, trim, etc.. Remove material on walls to studs. Remove all nails and prepare for new drywall.
Remove interior wall between entrance and storage closet.
See lead report.

Bidder: _____

Location Total: _____

Location: 10 - Stairway

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Address: 841 E Ninth Street

Unit: Unit 01

Location: 10 - Stairway

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				
2520	HANDRAIL--REPLACE INTERIOR Install 2" round hardwood handrail with braces screwed to studs and handrail. Paint with 2 coats of white semi-gloss interior latex paint, sanded between coats.	14.00	LF	_____	_____
2535	STAIRCASE--REMOVE ENCLOSURE AND DOORS AT TOP Remove the enclosure and doors that have been added at the top of the stairs. Include any repairs to ceiling, walls, rail, and ballusters.	1.00	FL	_____	_____
Bidder:	_____			Location Total:	_____

Location: 11 - Main Bath

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 5	Demolition & Disposal				
735	DEMOLISH BATHROOM Remove all bath fixtures. Remove drywall on walls to studs. Remove all nails and prepare for new drywall	1.00	EA	_____	_____
Trade: 10	Carpentry				
3820	TOWEL SET-- 3-PIECE CHROME Install a chrome plated steel bath set comprised of a soap dish, 24" towel bar and toilet paper holder.	1.00	EA	_____	_____
3832	BATH MIRROR Install beveled edge mirror sized at the width of vanity by 36" high.	1.00	SF	_____	_____
4150	TUB END WALL Frame a 2"x 4", 30" wide partition at tub end for full ceiling height. Provide blocking for a showerhead fitting and a 2'x 2' access panel. Hang water resistant drywall, tape and finish with 3 coats of compound. Use metal corner bead around access panel opening. Make stops for access panel and use 4 round-headed screws to install panel of 1/2" BCX plywood with smooth, sanded edges.	1.00	EA	_____	_____
4160	CLOSET--FRAME NEW CLOSET IN BATHROOM Reframe shower into closet. Hang, tape and 3 coat finish 1/2" gypsum to both sides of the 2"x 3" framing. Hang a 30' pre-hung 2 panel solid core door, including casing. Install a 1"x 12" plywood shelf, 1-3/8" hanger rod and 1"x 4" interior base. Match exterior base to room. Prep and prime ready to paint.	1.00	EA	_____	_____
Trade: 22	Plumbing				
6865	VANITY -- 36" COMPLETE Install a 36" vanity complete with plywood cabinet, cultured marble top, dual control, brass bodied, single lever faucet, supply risers, shut-off valves and all required waste connectors to complete the installation.	1.00	EA	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 11 - Main Bath

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 22	Plumbing				
6958	BATHTUB/SOWER--5' FIBERGLASS--Sterling Install a 5', 4 piece, Kohler Sterling™, 60" x 30" x 72" - Complete Unit - fiberglass tub and shower unit complete with pop up drain and overflow, PVC waste & trap, single lever shower diverter, shower rod and Delta Faucet "Monitor" Model 1343 tub/shower faucet - Model #BT14496 - SS (or approved equivalent).	1.00	EA	_____	_____
7010	COMMODE--REPLACE--1.6 GPF--GCI Install a 2 piece, close coupled, white, vitreous china, commode with a maximum water usage per flush of 1.6 Gallons. Include plastic or pressed wood white seat, supply pipe, shut-off valve, flap valve and wax seal. Toilet should be Mansfield Model 135 elongated bowl (or approved equivalent)	1.00	EA	_____	_____

Trade: 23 Electric

7730	LIGHT FIXTURE--REPLACE Replace a ceiling mounted, UL approved, incandescent light fixture with shade and lamps. \$50 allowance for fixture. Owner will pick fixture. Bulbs should be CFL or approved high efficiency bulb. Turn scone light into standard bath light. Replace shower light, include waterproof trim ring.	2.00	EA	_____	_____
7818	INSTALL BATH LIGHT, VENT Install a an Energy Star approved ceiling mounted Fan/Light fixture rated for a min 100 watts w/ an exterior ducted vent fan capable of min. 80 CFM operating at 2.5 Sone or less, vented w/ damper to exterior such as NuTone QTREN080FLT. Switch fan & light using a single switch. Install 4" metal duct and vent to the exterior ideally through a wall or gable end using a 4" hooded vent with damper. All duct seams shall be sealed with duct mastic. Insulate the ductwork with vinyl or foil faced R 6 minimum duct insulation. Repair any damage to the ceiling installation and air seal fan/light assembly to the ceiling with low VOC caulk.	1.00	EA	_____	_____

Bidder: _____

Location Total: _____

Location: 12 - N. Bedroom

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 23	Electric				
8017	ENERGY STAR CEILING FAN LIGHT FIXTURE--GCI Install an ENERGY STAR® approved 42- 52 inch white ceiling fan switched at the room entrance. Include fan mounting box if necessary. Bulbs should be CFL or approved high efficiency bulb.	1.00	EA	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Bidder: _____

Location Total: _____

Location: 13 - S.W. Bedroom

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
--------	------	----------	-------	------------	-------------

Trade: 23 Electric

8017 ENERGY STAR CEILING FAN LIGHT FIXTURE--GCI

Install an ENERGY STAR® approved 42- 52 inch white ceiling fan switched at the room entrance. Include fan mounting box if necessary.

Bulbs should be CFL or approved high efficiency bulb.

1.00 EA _____

Bidder: _____

Location Total: _____

Location: 14 - S.E. Bedroom

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
--------	------	----------	-------	------------	-------------

Trade: 23 Electric

8017 ENERGY STAR CEILING FAN LIGHT FIXTURE--GCI

Install an ENERGY STAR® approved 42- 52 inch white ceiling fan switched at the room entrance. Include fan mounting box if necessary.

Bulbs should be CFL or approved high efficiency bulb.

1.00 EA _____

Bidder: _____

Location Total: _____

Location: 16 - Attic

Approx. Wall SF: 630

Ceiling/Floor SF: 980

Spec #	Spec	Quantity	Units	Unit Price	Total Price
--------	------	----------	-------	------------	-------------

Trade: 10 Carpentry

3590 STAIR TREADS AND RISERS

Dispose of existing stair treads and risers. Replace with like material.

See lead report.

1.00 EA _____

Trade: 16 Conservation

4935 ATTIC R-49 CELLULOSE--GCI

Install blown- in cellulose insulation per manufacturer's specifications to R49. Maintain ventilation routes from soffit and other vents with baffles. Build curb around attic access if necessary. Insulate attic access with batt insulation.

800.00 SF _____

Bidder: _____

Location Total: _____

Location: 17 - Basement

Approx. Wall SF: 770

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
--------	------	----------	-------	------------	-------------

Trade: 5 Demolition & Disposal

746 DEMO CHIMNEY

1.00 EA _____

Location: 17 - Basement

Approx. Wall SF: 770

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 5	Demolition & Disposal				
	Remove surplus masonry chimney by hand. After securing site and removing all potentially damaged vehicles, chisel bricks at mortar line to disassemble the chimney. Remove to basement. Repair roof and floors by framing hole and installing the appropriate thickness of OSB. Replace shingles with matching style and color. Repair drywall as necessary				
Trade: 7	Masonry				
1185	GLASS BLOCK WINDOW Replace old basement window with premade glass block unit with 6"x 6"x 4" thick glass block. At least two windows on opposite sides of room should have operable vent.	8.00	EA	_____	_____
Trade: 10	Carpentry				
2520	HANDRAIL--REPLACE INTERIOR Install 2" round hardwood handrail with braces screwed to studs and handrail. Paint with 2 coats of white semi-gloss interior latex paint, sanded between coats.	12.00	LF	_____	_____
2540	STAIRCASE--REPLACE BASEMENT Dispose of entire basement staircase and handrail. Construct an open staircase using 2"x12" pine stringers and 5/4" pine stepping stock treads. Install wood handrail, one side, 32" above tread nosing. Stringers to rest on a 2"x12" preservative treated pine sill. See lead report. Remove shelves as well.	1.00	EA	_____	_____
Trade: 16	Conservation				
4996	INSULATE RIM JOIST--FOAM--GCI After cleaning the area thoroughly, apply expanding foam to the rim joist at the entire perimeter of the basement and/or crawl space exterior walls. Install to R 19 at a minimum. Use a foam product that meets International Residential Code (IRC), Section R314.5.11, and Underwriters Laboratories, Inc. (UL) classification Certificate R7813 such as Dow FROTH-PAK FS Foam or Handi-Foam Two Component E-84 Class 1 Foam. Insulate from the subfloor for the first floor to the top of the foundation wall and seal all penetrations and the top of the foundation. Seal all openings within the area of the rim joist created by plumbing, gas lines, electrical boxes or any other penetrations.	115.00	LF	_____	_____
Trade: 19	Paint & Wallpaper				
5755	PREP & PAINT CONCRETE FLOOR Sweep clean entire floor. Clean with TSP and rinse thoroughly. Roll out one coat of owner's choice of premixed latex floor paint per manufacturer's recommendations.	750.00	SF	_____	_____
5760	PREP & PAINT CONCRETE WALL	770.00	SF	_____	_____

Location: 17 - Basement

Approx. Wall SF: 770

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 19 Paint & Wallpaper					
	Scrape loose, peeling, cracked, blistered paint from concrete surface. Wash dirt fungus, dust from surface. Spot prime and top coat with owner's choice of premixed acrylic latex based flat.				
5795	SPRAY WITH BLEACH SOLUTION Using a mixture of Bleach and water (12:1 mixture ratio). Spray walls or floor to remove stains. Use appropriate ventilation and respirators.	1,500.00	SF	_____	_____
Trade: 21 HVAC					
6055	HIGH EFFICIENCY FURNACE & DUCT--GAS Install an appropriately sized, high efficiency (95%), intermittent pilot, forced air furnace complete with plenum, supply duct and galvanized return duct connected to wall registers, to service all rooms. Remove existing boiler and dispose of all other materials in a code legal dump. New furnace to be vented with PVC piping per manufacturer's specifications. New furnace will have minimum limited warranties of: 20 years on heat exchangers; 5 years on parts. Include auto set back thermostat controls, vent pipe & new shut- off valve. An exterior return air filter box shall be installed on one side, both sides, or bottom of new furnace. Seal all exposed duct joints as a part of this item with Duct Mastic.	1.00	EA	_____	_____
6180	A/C CENTRAL UNIT Submit manuf's cut sheet & cooling load calcs to owner min 15 working days prior to installation. Install central A/C system w/ min EER of 13 including condensing unit, A type coil, control & power wiring, insulated freon lines, plenums, ext pad & connections to create a product capable of 68 F interior when ext is 100 F at 95% humidity. Provide owner w/factory warranty, manual & 1-yr contractors warranty. Do not install condenser until house is sold and closing date is set.	1.00	EA	_____	_____
Trade: 22 Plumbing					
6630	SUPPLY--PEX Install flexible pex piping with a minimum number of couplings to fixtures. Install mechanical connectors and shut off valves at all fixtures. Size pipe to 1990 CABO minimums per table 2406.5. Replace all water lines in house.	150.00	LF	_____	_____
6705	WASTE LINES--INSPECT, REPORT Test waste lines for leaks and proper venting. Identify defects and submit to the agency a priced list of recommended repairs to bring structure into compliance with the current plumbing code.	1.00	AL	_____	_____
7071	HWH - HIGH EFFICIENCY 40 GAL GAS POWER VENTED--GCI Install a 40 gallon, glass lined, high efficient, power vented, insulated to R-7, gas water heater with a 7 year warranty.	1.00	EA	_____	_____

Address: 841 E Ninth Street

Unit: Unit 01

Location: 17 - Basement

Approx. Wall SF: 770

Ceiling/Floor SF: 744

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 22	Plumbing				

work to power vent to exterior. Provide separate electrical circuit & new gas piping from shut-off valve to fixture. Dispose of old water heater in code legal dump. If the HWH is located in a basement with a floor drain the discharge tube shall be directed to the drain. If it is located on an upper floor or if there is no floor drain, install a catch pan drained to the exterior.

7115 LAUNDRY TUB AND FAUCET - REPLACE

1.00

EA

Remove existing sink to code legal dump. Install single bowl, 24" fiberglass laundry tray to fit under faucet. Include standard 2 handle chrome laundry faucet. Hook up waste line.

7135 HOSE BIBB

2.00

EA

Install a bronze, freeze free hose bibb on outside of structure with inside shut-off valve and backflow preventer. Seal exterior penetration with silicone caulk.
One on the driveway side and one in the back of the house.

Trade: 23 Electric

7475 ELECTRIC SERVICE--200 AMP

1.00

EA

Dispose of old electric service to code legal dump. Install a 200 amp, main disconnect, 110/220 volt, 24 circuit panel board, meter socket, weather head, service cable, and ground rod and cable. Caulk exterior service penetration. Install to Michigan Electrical Code Requirements. Include Arc Fault breakers as required by code.

7680 INSTALL 5 BASEMENT LIGHTS AND SWITCH

1.00

EA

Remove old light fixtures. Install 5 keyless single bulb fixtures (\$5 allowance) spaced evenly in basement. Run wire to new switch located on the latch side of basement door
Bulbs should be CFL or approved high efficiency bulb.

Bidder: _____

Location Total: _____

Location: 18 - Garage

Approx. Wall SF: 720

Ceiling/Floor SF: 400

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				

3185 DOOR--PREHUNG METAL ENTRANCE

1.00

EA

Dispose of door and frame. Install a prehung metal, insulated, 6-panel entrance door and jamb including interior and exterior casing, threshold, one entrance and one mortised deadbolt keyed alike (Schlage, brass finish or approved equivalent). Paint with two coats of exterior acrylic latex paint (Owner's choice of color). Front door should be decorative oval at least 1/2 light.

3200 DOOR OVERHEAD GARAGE

1.00

EA

Dispose of door, track and hardware. Install an insulated steel, 16'x 7' garage door including hardware, exterior trim and drip

Address: 841 E Ninth Street

Unit: Unit 01

Location: 18 - Garage

Approx. Wall SF: 720

Ceiling/Floor SF: 400

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				
	cap.				

Trade: 23 Electric

7795 REPLACE GARAGE DOOR OPENER

1.00

EA

Replace existing garage door opener with screw type opener. (2 remotes)

Bidder: _____

Location Total: _____

Location: 19 - Exterior

Approx. Wall SF: 0

Ceiling/Floor SF: 0

Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 10	Carpentry				
2590	SIDING--PRE-PRIMED WOOD	3,500.00	SF	_____	_____
	Prepare surface by removing existing siding and nails, installing backers, applying Tyvek housewrap or approved equivalent, and flashing at all openings. Nail 6" Pawlonia, 4 1/2" exposure (fully primed), siding (or approved equivalent) to the surface using galvanized siding nails (Maze Stormguard double dipped in molten zinc, or approved equivalent) driven at least 1" into studs. Stagger joints in adjacent pieces and center all butt joints over studs. Corner posts, window, and door trim will be fully primed cedar.				
	Include garage.				
3560	PORCH--REBUILD	36.00	SF	_____	_____
	Remove deteriorated porch. Rebuild exact replica of original - reuse existing foundation if possible (panels between posts are not original and should not be replaced). Pour new concrete cap. Construct roof structure with rafters, and 1/2" decking. Soffit and fascia should match existing. Structural lumber and deck shall be preservative treated. Ceiling should be individual t&g boards stained with Mahogany stain. Match posts as closely as possible. Steps should be 6' wide with railing on both sides.				
3875	HOUSE NUMBER SET	1.00	EA	_____	_____
	Install 3" high metal or PVC house numbers on a 1"x 4" pine backer board painted with 2 coats of exterior white latex paint.				
3885	MAILBOX	1.00	EA	_____	_____
	Dispose of mailbox and install a steel, black enamel finish, letter-size mail box with magazine rack and lock-eye for padlock.				

Trade: 15 Roofing

4580 TEAR OFF AND REROOF SHINGLES

19.00

SQ

Remove and dispose of all roofing & defective sheathing. Cut a 1" wide vent at ridge board. Replace up to 5 sf of sheathing per 100 sf of roof using pine board or CDX plywood of matching

Address: 841 E Ninth Street

Unit: Unit 01

Location: 19 - Exterior

Approx. Wall SF: 0

Ceiling/Floor SF: 0


Spec #	Spec	Quantity	Units	Unit Price	Total Price
Trade: 15	Roofing				
	Install shingle-over ridge vent. Include "Ice and water shield" where specified by code. Call for "open roof" inspection prior to drying in.				
	Replace house and garage.				
4585	RESHEET--7/16" OSB Remove roof to deck. Install 7/16" OSB over entire roof. Include garage.	1,900.00	SF	_____	_____
4635	GUTTER--5" SEAMLESS ALUMINUM Dispose of gutter. Install 5", K- type, seamless, .027 gauge aluminum gutter to service roof. White or brown color choice by owner. Downspouts will have 4' removeable extensions.	200.00	LF	_____	_____
Trade: 16	Conservation				
4908	WALL INSULATION--DENSE PACK CELULOSE--GCI After sealing cavities drill 2 1/8" to 2 9/16" access holes for each stud cavity in the areas specified in interior or exterior locations. Install blow in borax treated (no ammonium sulfate permitted), cellulose insulation per manufacturer's specifications and dense-packed into all specified wall cavities to a minimum density of 3.5 Lbs. per Cubic Foot for the entire cavity. Use a 1" to 1 1/4" ID vinyl "wall tube" attached to the standard cellulose blower tubing to place the cellulose deep into the wall cavity. Check each stud cavity for blocking and other obstructions prior to blowing. Carefully seal all drilled holes with wood or foam plugs and patch all holes to match surrounding materials if the surface is exposed. In balloon framed houses insure that blown cellulose is blocked from entering floor cavities such as 2nd floor floors.	2,000.00	SF	_____	_____
Trade: 19	Paint & Wallpaper				
5675	PREP & PAINT EXTERIOR TRIM--SF Cover ground with drop cloth. Scrape loose, cracked, peeling, blistered paint from exterior trim. Dispose of chips properly. Feather edges & dull gloss by sanding. Rinse trim with hose and let dry. Caulk allcracks. Spot prime and top coat with owner'schoice of acrylic latex semi-gloss. Encapsulate and paint window trim, door trim, soffit and fascia, and foundation. Include garage. See lead report	750.00	SF	_____	_____
Trade: 23	Electric				
8165	ENTRANCE LIGHT FIXTURE--REPLACE Remove damaged light fixture and replace with an exterior, waterproof, single bulb fixture. \$20 fixture allowance.	5.00	EA	_____	_____

Bidder: _____

Location Total: _____

Unit Total for 841 E Ninth Street, Unit Unit 01: _____

Address Grand Total for 841 E Ninth Street: _____



GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

**Rehabilitation
Environmental Inspection Report
For:
41-18-280-028
841 E. 9th Street
Flint, Michigan 48503**

NSP-2 June 2011
Global Project No. F1438D

Prepared by:

GLOBAL ENVIRONMENTAL ENGINEERING INC.
6140 Rashelle Drive, Suite 1
Flint, Michigan 48507
(810) 238-9190
Fax: (810) 238-9195

Prepared for:

Genesee County Land Bank
452 S. Saginaw Street – 2nd Floor
Flint, Michigan 48502

Site Summary

HM	A
T	

Genesee County Rehabilitation Environmental Inspection Summary

41-18-280-028
841 E. 9th Street
Flint, Michigan 48503



Year Built:	1921	Square Footage:	1,536
Latitude:	N 43° 00'46.85"	Longitude:	W 83° 40'33.07"
Gas:	Connected	Electric:	Connected


Comments: A two-story wood framed residential structure with aluminum siding, a basement and garage.

Inspected By:

Mark Keyes
Julie Herrick
Robert Dunlap

Inspected On:

June 6, 2011



GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

Table of Contents

1.0	INTRODUCTION.....	1
2.0	HAZARDOUS MATERIALS INSPECTION	1
3.0	ASBESTOS CONTAINING BUILDING MATERIAL INSPECTION	1
3.1	Asbestos Inspection	1
3.2	Sample Collection	1
3.3	Laboratory Analysis/Results.....	2
3.4	Category I Non-Friable ACM	2
4.0	SIGNATURE	3

Tables and Attachments

Table 1	Hazardous Material List
Table 2	Suspect Asbestos Containing Materials
Table 3	Category I Non-Friable
Attachment 1	Site Inspection Photos
Attachment 2	Floor Plan with Sample Locations
Attachment 3	Asbestos Laboratory Analytical Results
Attachment 4	MDEQ "Notice of Intent to Demolish" Form

Site Summary Legend for Report Cover

A = Friable Asbestos Containing Materials
HM = Hazardous Materials
O = Occupied
ED = Emergency Demolition
T = Tire

1.0 INTRODUCTION

The Genesee County Land Bank retained Global Environmental Engineering Inc. (Global) to complete a pre-renovation environmental inspection for the following property:

Property:

- 841 E. 9th Street, Flint, Michigan 48503
- Parcel No: 41-18-280-028

Description:

The building is a two-story, wood framed, aluminum sided residential structure with a basement and garage.

2.0 HAZARDOUS MATERIALS INSPECTION

The property was inspected for the presence of household hazardous materials, including but not limited to; paint, solvents, pesticides/fertilizers, fuel, oil, fluorescent light fixture ballasts, fluorescent light bulbs, underground storage tanks (USTs), above ground storage tanks (ASTs), and mercury thermostats. The Global inspectors documented the location of each of the hazardous materials identified and marked the materials with spray paint. At the discretion of the inspectors photographs were also obtained during the inspection of potential and known hazardous materials. Hazardous materials identified are listed on **Table 1**. If obtained, photographs of hazardous materials for the above referenced property are included in **Attachment 1**.

3.0 ASBESTOS CONTAINING BUILDING MATERIAL INSPECTION

The property was inspected for the presence of asbestos-containing materials (ACMs) in order to meet the requirements of 40 CFR, Part 61, Subpart M, National Emissions Standards for Hazardous Air Pollutants (NESHAP).

3.1 Asbestos Inspection

The property was inspected for the presence of suspected ACMs. Typical building materials that may contain asbestos include drywall, floor tiles, roofing felt and shingles, ceiling tiles, insulation, pipe insulation, and duct insulation. Friable materials are defined as materials that when dry may be crumbled or reduced to powder using hand pressure and thus release asbestos fibers.

For the purpose of this inspection non-friable materials that may become friable during the renovation/demolition (Category II non-friable) were identified and sampled.

3.2 Sample Collection

At least one sample of each friable suspected ACM identified during the inspection was collected. A Michigan Accredited Asbestos Inspector collected representative samples of each friable suspected ACM. Each sample was placed into a sealed plastic bag and labeled. A description of the material and location of the sample collected was recorded in the field notes. The total quantity of each suspected ACM was estimated and recorded in the field notes.

A listing of suspect ACMs at this property that were sampled and sent to the laboratory for analysis is included in **Table 2**. A copy of a floor plan showing sample locations is included in **Attachment 2**.

3.3 Laboratory Analysis/Results

Each sample of suspect ACM collected at this property was analyzed for asbestos content using polarized light microscopy (PLM) by a NVLAP and NIST accredited laboratory in accordance with 40 CFR Ch. I (1-1-87 Edition) Part 763, Subpart F, Appendix A, pp. 293-299. Asbestos containing materials are defined as materials that contain greater than one percent (>1%) asbestos.

Each sample collected for analysis was delivered via UPS to International Asbestos Testing Laboratories (IATL) 9000 Commerce Parkway, Suite B, Mt. Laurel, New Jersey. Laboratory results are included in **Attachment 3**.

The results of the laboratory analysis indicated, two of the suspect materials sampled, the duct wrap and 2" tape (841-4) and the stucco siding (841-6) contains asbestos. A copy of the laboratory results is included as **Attachment 3**.

The duct wrap and tape located on the register boots, runs and basement throughout and the stucco siding on the garage and under the aluminum siding on the house should be properly removed and disposed by a licensed asbestos abatement contractor as part of the renovation project.


A Notice of Intent to Renovate/Demolish form must be filed with the State of Michigan Department of Consumer Industry at least 10 days before beginning a renovation project or the removal of the material. A form has been included for your future use.

3.4 Category I Non-Friable ACM

Bendable, flexible, and tar based non-friable materials (Category I non-friable) were identified and sampled. For the purpose of this inspection Category I Non-Friable materials that may become friable during the renovation were identified and sampled. A copy of the MDEQ "Notice of Intent to Demolish" form is included as **Attachment 4**.

4.0 SIGNATURE

This report was prepared based on the site conditions that existed at the time of the inspection, sample collection, and the laboratory analytical results.

Prepared by: 
Julie Herrick, Michigan Certified Asbestos Inspector
Michigan Accreditation Number A35947

Reviewed by: 
Mark Keyes, Michigan Certified Asbestos Inspector
Michigan Accreditation Number A6041

Tables

**Genesee County Pre-Demolition
Environmental Inspection Summary**

41-18-280-028
841 E. 9th Street
Flint, Michigan 48503

TABLE 1

HAZARDOUS MATERIALS

Material	Quantity & Units	Location
Refrigerator	1 Unit(s)	Kitchen
Computer Monitor	1 Unit(s)	Dining Room
Computer Monitor	1 Unit(s)	Den
Mercury Thermostat	1 Unit(s)	Living Room
Smoke Detector	1 Unit(s)	Living Room
Television	1 Unit(s)	2nd Floor Bedroom
Computer Monitor	1 Unit(s)	2nd Floor Bedroom
Paint	1 - 1 Gallon(s)	2nd Floor Hall
Smoke Detector	2 Unit(s)	2nd Floor Hall
Lacquer	1 - 12 Ounce(s)	Dining Room
Enamel	1 - 11 Ounce(s)	Dining Room
Trim Adhesive	1 - 5.7 Ounce(s)	Dining Room
WD-40	1 - 10 Ounce(s)	Dining Room
Brass Cleaner	1 - 8 Ounce(s)	Dining Room
Raid	1 Can	Dining Room
Smoke Detector	2 Unit(s)	Kitchen
Freezer	1 Unit(s)	Basement
Paint	6 - 1 Gallon(s)	Basement
Computer Monitor	1 Unit(s)	Basement
Paint	1 - 1 Quart(s)	Basement
Stain	1 - 4 Ounce(s)	Basement
Paint	6 - 1 Gallon(s)	Basement
Stain	2 - 1 Quart(s)	Basement
WD-40	1 - 12 Ounce(s)	Basement
Paint	2 - 5 Gallon(s)	Garage
WD-40	1 - 8 Ounce(s)	Garage
Antifreeze	2 - 1 Gallon(s)	Garage
Motor Oil	2 - 1 Quart(s)	Garage
Brake Fluid	1 - 32 Ounce(s)	Garage
Power Steering Fluid	1 - 32 Ounce(s)	Garage
Gasoline	1 - 1 Gallon(s)	Garage
Fluorescent Light Bulbs 8'	2 - 8' Bulb(s)	Garage
Fluorescent Light Ballast	2 Ballast(s)	Garage
Paint	1 - 1 Gallon(s)	Garage
Spray Paint	4 - 11 Ounce(s)	Garage
Round Up	1 - 1 Gallon(s)	Garage
Paint Thinner	1 - 1 Gallon(s)	Garage
Enamel	1 - 15 Ounce(s)	Garage
Caulk	2 - 10 Ounce(s)	Garage
Fluorescent Light Bulbs 2'	2 - 2' Bulb(s)	Garage

**Genesee County Pre-Demolition
Environmental Inspection Summary**

Great Stuff	2 - 16 Ounce(s)	Garage
Window Washer Fluid	1 - 1 Gallon(s)	Garage
Brake Parts	1 - 14 Ounce(s)	Garage
Paint	5 - 1 Gallon(s)	Attic

TIRE(s) REPORT

Material	Quantity & Units	Location
Tire(s)	5 Tire(s)	Garage

**Genesee County Pre-Demolition
Environmental Inspection Summary**

41-18-280-028
841 E. 9th Street
Flint, Michigan 48503

**TABLE 2
SUSPECT FRIABLE ASBESTOS CONTAINING MATERIALS**

Sample ID	Material	Sample Location	Location	Estimated Quantity	% ACM	ACM Present
841-1	Roofing Material	Back Porch	House Roof	1,235 Square feet	Non Detect	No
841-2a	Window Caulk	Dining Room	Windows Throughout	10 Square feet	Non Detect	No
841-2b	Window Caulk	Living Room	Windows Throughout	Same as above	Non Detect	No
841-2c	Window Caulk	2nd Floor Bedroom	Windows Throughout	Same as above	Non Detect	No
841-3a	Plaster	Kitchen	Throughout	6,144 Square feet	Non Detect	No
841-3b	Plaster	Dining Room	Throughout	Same as above	Non Detect	No
841-3c	Plaster	2nd Floor Bedroom	Throughout	Same as above	Non Detect	No
841-3d	Plaster	2nd Floor Bedroom	Throughout	Same as above	Non Detect	No
841-3e	Plaster	2nd Floor Bedroom	Throughout	Same as above	Non Detect	No
841-4	Duct Wrap	2nd Floor Bathroom	Boots/Runs Throughout	102 Square feet	65	Yes
841-4	Duct Wrap 2" Tape	2nd Floor Bathroom	Basement Duct Work	10 Linear feet	65	Yes
841-5	Drywall	2nd Floor Bathroom	Throughout	3,075 Square feet	Non Detect	No
841-6a	Stucco Siding	Exterior Side of Garage	Exterior Side of Garage	3,100 Square feet	1.1	Yes
841-6b	Stucco Siding	Exterior Side of House	Exterior Side of House	Same as above	NA	Yes
841-6c	Stucco Siding	Exterior Side of Garage	Exterior Side of Garage	Same as above	NA	Yes

Date Inspected: 06/06/2011

Asbestos samples analyzed by Polarized light Microscopy (PLM). ACM - Asbestos Containing Material

Asbestos containing materials are defined as materials that contain greater than one percent (>1%) asbestos.

Bolded and Shaded materials contain asbestos and Global recommends the materials be removed prior to renovation/demolition activities.

Attachment 1



Refrigerator
Kitchen



Television
2nd Floor Bedroom




Computer Monitor
Den




Mercury Thermostat
Living Room



Television
2nd Floor Bedroom

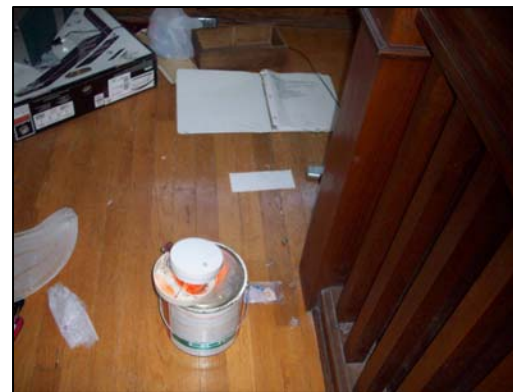

Smoke Detectors and Paint
2nd Floor Hall



GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

Genesee County Renovation Environmental Inspection Summary

Parcel ID: 41-18-280-028

Address: 841 E. 9th Street, Flint, Michigan

Pictures of Hazardous Materials

Prepared By: J.M.H.

Taken: 06/06/2011


Page: 1



Paint
Attic



Paints, Stain
Kitchen

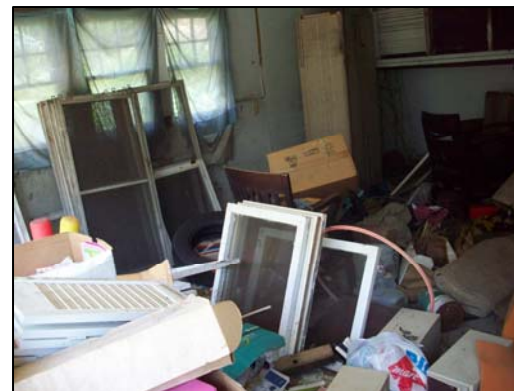

Tire
Garage




Tire, Brake Parts, Caulk, Great Stuff, Window
Washer Fluid,
Garage



Paints, WD-40, Antifreeze, Motor Oil, Brake Fluid,
Gasoline, Spray Paint
Garage



Freezer
Basement



GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

Genesee County Renovation Environmental Inspection Summary

Parcel ID: 41-18-280-028

Address: 841 E. 9th Street, Flint, Michigan

Pictures of Hazardous Materials

Prepared By:	J.M.H.
Taken:	06/06/2011
Page:	2




Example of Duct Wrap
Basement




Example of Duct Wrap
Basement



Example of Duct Wrap
Basement

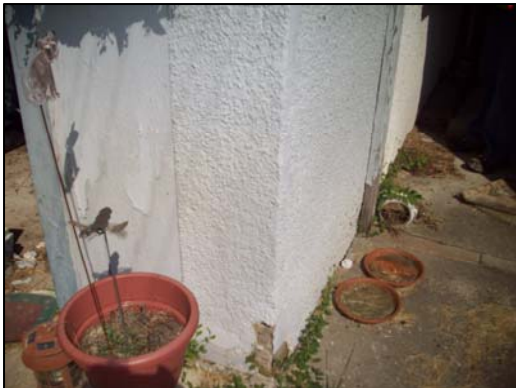

Stucco Siding
Garage and Under Siding of House



GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

Genesee County Renovation Environmental Inspection Summary


Parcel ID: 41-18-280-028

Address: 841 E. 9th Street, Flint, Michigan

**Pictures of Asbestos
Containing Material**

Prepared By:	J.M.H
Taken:	06/06/2011
Page:	3

Attachment 2

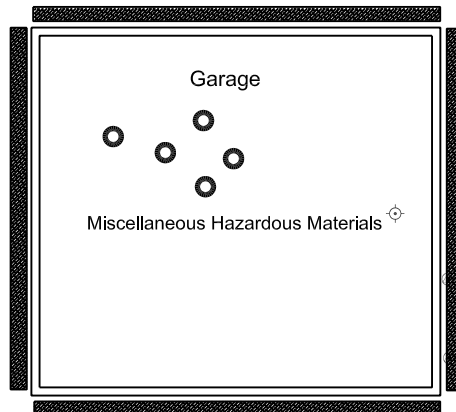





841-6A

841-6B

841-6C

841-2B First Floor

Second Floor

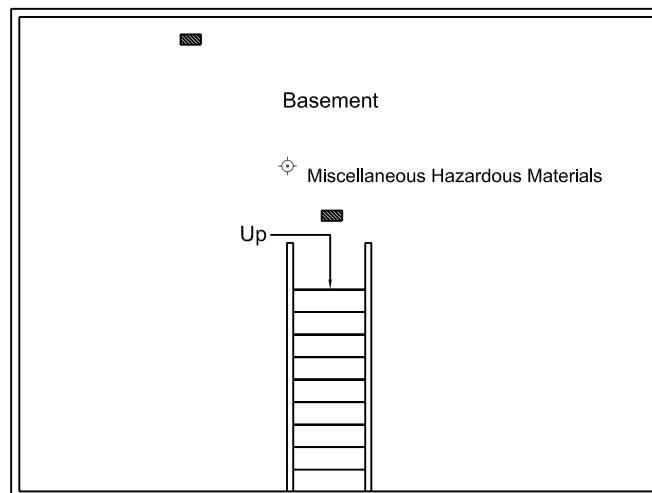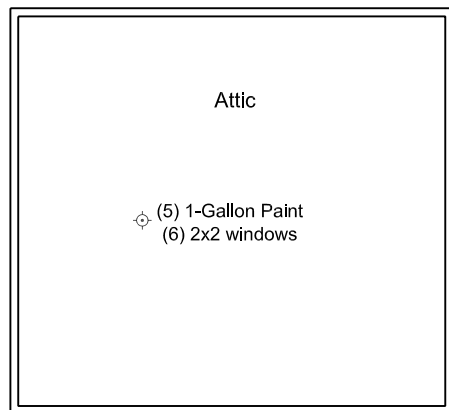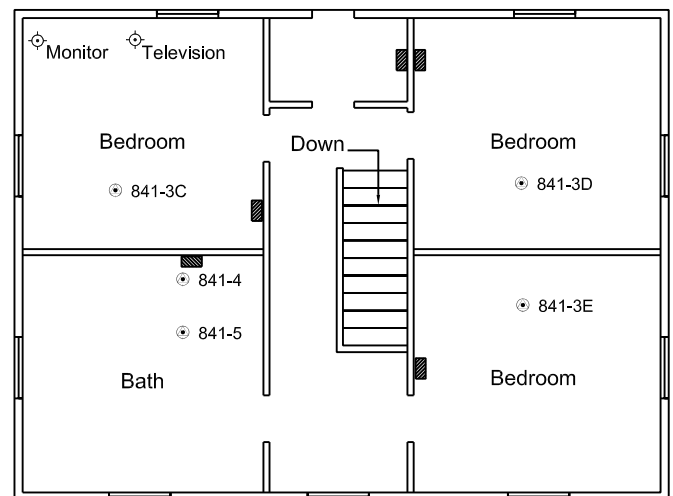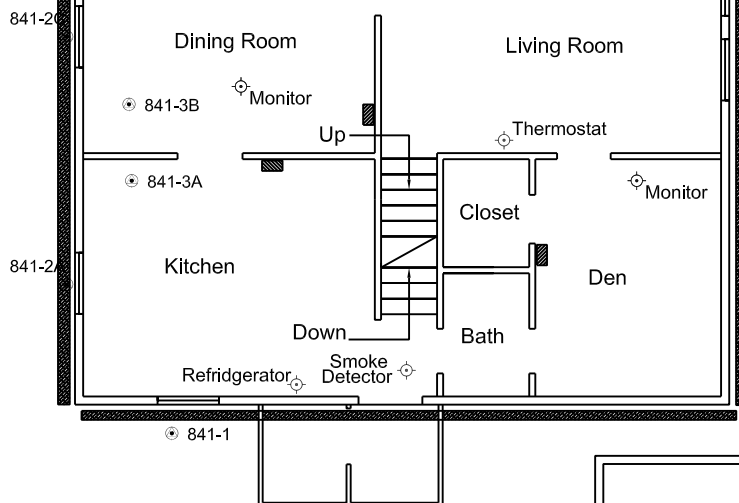

GLOBAL
ENVIRONMENTAL
ENGINEERING INC.

- ▨ Asbestos Containing Materials
- Tire
- ⊕ Hazardous Material
- ⊙ Asbestos Spl Location

841 E. 9th St Flint, Michigan	
House Floor Plan	
Last Modified:	June 2011
Project No.:	F1438
Attachment:	
2	

Attachment 3

CERTIFICATE OF ANALYSIS

Client: Global Environmental Engineering Inc
6140 Rashelle Dr; Ste 1
Flint MI 48507

Report Date: 6/15/2011
Report No: 242526
Project: GCLBA-Rehab 841 E 9th St
Project No.: F1438D

BULK SAMPLE ANALYSIS SUMMARY

Lab No.: 4327531	Description / Location: Green/Black Shingle	
Client No.: 841-1		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	15
		Cellulose
		85

Lab No.: 4327532	Description / Location: White Glazing	
Client No.: 841-2a	Window	
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	None Detected
		None Detected
		100

Lab No.: 4327533	Description / Location: White Glazing	
Client No.: 841-2b	Window	
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	None Detected
		None Detected
		100

Lab No.: 4327534	Description / Location: White Glazing	
Client No.: 841-2c	Window	
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	None Detected
		None Detected
		100

Accreditation

NIST-NVLAP No. 101165-0

NY-DOH No. 11021

AIHA-LAP, LLC No. 100188

*This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA or any agency of the U.S. government
This report shall not be reproduced except in full, without written approval of the laboratory.*

Analytical Method:


EPA 600/R-93/116

Comments:

(PC) Indicates Stratified Point Count Method performed. Method not performed unless stated. Quantification at <0.25% by volume is possible with this method. (PC-Trace) represents this limit of quantitation. (PC-Trace) means that asbestos was detected but is not quantifiable under the Point Counting regimen. Analysis includes all distinct separable layers in accordance with EPA 600 Method. If not reported or otherwise noted, layer is either not present or the client has specifically requested that it not be analyzed. Small asbestos fibers may be missed by PLM due to resolution limitations of the optical microscope. Therefore, negative PLM results cannot be guaranteed. Electron Microscopy can be used as a confirming technique. Regulatory Limit is based upon the sample matrix.

Analysis Performed By: S. Robb

Approved By:



Date: 6/15/2011

Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Global Environmental Engineering Inc
6140 Rashelle Dr; Ste 1
Flint MI 48507

Report Date: 6/15/2011
Report No: 242526
Project: GCLBA-Rehab 841 E 9th St
Project No.: F1438D

BULK SAMPLE ANALYSIS SUMMARY

Lab No.: 4327535	Description / Location: White Sheetrock	
Client No.: 841-3a		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	2
		Cellulose
		98

Lab No.: 4327536	Description / Location: White Plaster	
Client No.: 841-3b		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	None Detected
		None Detected
		100

Lab No.: 4327536	Description / Location: Grey Plaster		Layer No.: 2
Client No.: 841-3b			
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>	<u>% Non-Fibrous Material</u>
None Detected	None Detected	None Detected	None Detected
		None Detected	100

Lab No.: 4327537	Description / Location: White Sheetrock	
Client No.: 841-3c		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	2
		Cellulose
		98

Accreditation **NIST-NVLAP No. 101165-0** **NY-DOH No. 11021** **AIHA-LAP, LLC No. 100188**

*This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA or any agency of the U.S. government
This report shall not be reproduced except in full, without written approval of the laboratory.*

Analytical Method: EPA 600/R-93/116

Comments: (PC) Indicates Stratified Point Count Method performed. Method not performed unless stated. Quantification at <0.25% by volume is possible with this method. (PC-Trace) represents this limit of quantitation. (PC-Trace) means that asbestos was detected but is not quantifiable under the Point Counting regimen. Analysis includes all distinct separable layers in accordance with EPA 600 Method. If not reported or otherwise noted, layer is either not present or the client has specifically requested that it not be analyzed. Small asbestos fibers may be missed by PLM due to resolution limitations of the optical microscope. Therefore, negative PLM results cannot be guaranteed. Electron Microscopy can be used as a confirming technique. Regulatory Limit is based upon the sample matrix.

Analysis Performed By: S. Robb

Date: 6/15/2011

CERTIFICATE OF ANALYSIS

Client: Global Environmental Engineering Inc
6140 Rashelle Dr; Ste 1
Flint MI 48507

Report Date: 6/15/2011
Report No: 242526
Project: GCLBA-Rehab 841 E 9th St
Project No.: F1438D

BULK SAMPLE ANALYSIS SUMMARY

Lab No.: 4327538	Description / Location: White Sheetrock	
Client No.: 841-3d		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	2
		Cellulose
		98

Lab No.: 4327539	Description / Location: White Sheetrock	
Client No.: 841-3e		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	2
		Cellulose
		98

Lab No.: 4327540	Description / Location: Grey Duct Insulation	
Client No.: 841-4		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
65	Chrysotile	15
		Cellulose
		20

Lab No.: 4327541	Description / Location: White Sheetrock	
Client No.: 841-5		
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>
None Detected	None Detected	5
		Cellulose
		95

Accreditation **NIST-NVLAP No. 101165-0** **NY-DOH No. 11021** **AIHA-LAP, LLC No. 100188**

*This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA or any agency of the U.S. government
This report shall not be reproduced except in full, without written approval of the laboratory.*

Analytical Method: EPA 600/R-93/116

Comments: (PC) Indicates Stratified Point Count Method performed. Method not performed unless stated. Quantification at <0.25% by volume is possible with this method. (PC-Trace) represents this limit of quantitation. (PC-Trace) means that asbestos was detected but is not quantifiable under the Point Counting regimen. Analysis includes all distinct separable layers in accordance with EPA 600 Method. If not reported or otherwise noted, layer is either not present or the client has specifically requested that it not be analyzed. Small asbestos fibers may be missed by PLM due to resolution limitations of the optical microscope. Therefore, negative PLM results cannot be guaranteed. Electron Microscopy can be used as a confirming technique. Regulatory Limit is based upon the sample matrix.

Analysis Performed By: S. Robb

Date: 6/15/2011



9000 Commerce Parkway, Ste B
Mount Laurel, NJ 08054
Toll Free 877-428-4285
Local: 856-231-9449
Fax: 856-231-9818

CERTIFICATE OF ANALYSIS

Client: Global Environmental Engineering Inc
6140 Rashelle Dr; Ste 1
Flint MI 48507

Report Date: 6/15/2011
Report No: 242526
Project: GCLBA-Rehab 841 E 9th St
Project No.: F1438D

BULK SAMPLE ANALYSIS SUMMARY

Lab No.:	4327542	Description / Location:	Tan Plaster	
Client No.:	841-6a			
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>	<u>Type</u>	<u>% Non-Fibrous Material</u>
PC 1.1	Chrysotile	None Detected	None Detected	PC 98.9

Lab No.:	4327543	Description / Location:	Sample Not Analyzed	
Client No.:	841-6b			
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>	<u>Type</u>	<u>% Non-Fibrous Material</u>
Sample Not Analyzed		Sample Not Analyzed		

Lab No.:	4327544	Description / Location:	Sample Not Analyzed	
Client No.:	841-6c			
<u>% Asbestos</u>	<u>Type</u>	<u>% Non-Asbestos Fibrous Material</u>	<u>Type</u>	<u>% Non-Fibrous Material</u>
Sample Not Analyzed		Sample Not Analyzed		

Accreditation

NIST-NVLAP No. 101165-0

NY-DOH No. 11021

AIHA-LAP, LLC No. 100188

*This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA or any agency of the U.S. government
This report shall not be reproduced except in full, without written approval of the laboratory.*

Analytical Method:

EPA 600/R-93/116

Comments:

(PC) Indicates Stratified Point Count Method performed. Method not performed unless stated. Quantification at <0.25% by volume is possible with this method. (PC-Trace) represents this limit of quantitation. (PC-Trace) means that asbestos was detected but is not quantifiable under the Point Counting regimen. Analysis includes all distinct separable layers in accordance with EPA 600 Method. If not reported or otherwise noted, layer is either not present or the client has specifically requested that it not be analyzed. Small asbestos fibers may be missed by PLM due to resolution limitations of the optical microscope. Therefore, negative PLM results cannot be guaranteed. Electron Microscopy can be used as a confirming technique. Regulatory Limit is based upon the sample matrix.

Analysis Performed By: S. Robb

Date: 6/15/2011



Chain of Custody

9000 Commerce Parkway
Suite B
Mt. Laurel, NJ 08054
Toll Free: 877 428-4285
info@iatl.com
www.iatl.com

Client: Global Environmental Engineering Inc.
6140 Rashelle Dr. Suite 1
Flint, MI 48507

Project Name: GCLBA - Rehab 841E 9th St
Project No.: F1438D

Office Phone: 810-238-9190
Cell Phone:
FAX / Email 1: 810-238-9195 jherrick@globaleeei.com

Contact 1: Julie Herrick
Contact 2: Desiree Babble
FAX / Email 2: dbabble@globaleeei.com

Special Instructions:

Matrix:

☐ Air ☐ Soil ☒ Bulk ☐ Other
☐ Water ☐ Paint ☐ Surface Dust / Wipe

Analysis Method:

☐ PCM : NIOSH 7400
☐ PCM : OSHA
☐ PCM : TWA

☐ AAS : Lead in Air
☐ AAS : Lead in Water
☐ AAS : Lead in Paint
☐ AAS : Lead Dust/Wipe¹
☐ AAS : Lead in Soil
☐ AAS : TCLP
☐ AAS : Metals (Cd, Zn, Cr)

See Page 2 for Bulk Asbestos Specific Log

☒ PLM : Bulk Asbestos EPA 600
☐ PLM : Point Counting 198.1
☐ PLM : NOB via 198.1 (PLM only)
☐ If <1% by PLM, to TEM via 198.4²
☐ PLM : See page 2 for instructions

See Page 4 for Mold Specific Log

☐ IAQ : I Bioaersol Fungal Spore Trap³
☐ IAQ : II Bioaersol Fungal Spore Trap⁴
☐ IAQ : Tape, Bulk, Misc. Qualitative³
☐ IAQ : Tape, Bulk, Misc. Quantitative³
☐ IAQ : Other Culturable ID²

☐ TEM : AHERA
☐ TEM : NIOSH 7402
☐ TEM : Dust / Wipe
☐ TEM : Dust / Microvac
☐ TEM : NOB 198.4
☐ TEM : Bulk Analysis
☐ TEM : Potable Water
☐ TEM : Non-Potable Water
☐ TEM : Other
☐ Total Dust : NIOSH 0500
☐ Total Dust : NIOSH 0600

1- Requires ASTM acceptable material

2- Call to confirm TAT

3- Non-culturable

4- With Non-fungal Microscopic Exam

Turnaround Time:

Preliminary Results Requested By...

date / time

☐ Verbals ☒ FAX ☒ Email

jherrick@globaleeei.com

☐ 10 Day ☒ 5 Day ☐ 3 Day ☐ 2 Day ☐ 1 Day* ☐ 12 Hour** ☐ 6 Hour** ☐ RUSH**

* End of next business day unless otherwise specified.

** Matrix Dependent. Please notify the lab before shipping.

Sample Numbers:

Client #(s): 841-1 - 841-6
(start) (end)

IATL#(s): - Total: 14
(start) (end)

Please use your sample log to supply sampling information (ex. Volumes, areas, descriptions, locations, etc.) or download form at iatl.com

Chain of Custody:

Relinquished (Name / Organization): Julie Herrick
Received (Name / IATL):
Sample Login (Name / IATL): F1438D
Sample Prep (Name / IATL):
Analysis (Name(s) / IATL):
QA/QC Review (Name / IATL):
Archived / Released: QA/QC InterLAB Use:

RECEIVED
Date: 6/15/11 Time:
Date: Time:
Date: Time:
Date: Time:
Date: Time:
Date: Time:
Date: Time:

Chain of Custody

- Bulk Asbestos Sample Log -

Client: Global Environmental Engineering Inc.
6140 Rashelle Dr. Ste. 1, Flint, MI 48507

Project Name: 841 E. 9th St.
Project No.: FI438D

PLM Special Instructions:

☒ PLM : Bulk Asbestos Building Materials EPA 600 / R 93-116

☐ PLM : Point Counting

☐ PC : via ELAP 198.1

☐ PC : 400 Points

☐ PC : 800 Points *

☐ PC : 1600 Points *

☐ PLM : Analyze Until Positive (Positive Stop)

☐ AUP : by Homogenous Area as Noted

☐ AUP : by Material Type as Noted

☐ PLM : Non-Building Material *, **(Dust, Wipe, Tape, Soil)

☐ Soil or Vermiculite Analysis *, **

☐ PLM : Gravimetric Reduction

☐ PLM : NOB via 198.1

☐ PLM : Friable via EPA 600 2.3

☐ If <1% by PLM, to TEM via 198.4 *

☐ If <1% by PLM, Hold for Instructions

☐ PLM: Instructions for Multi-Layered Samples

☐ Analyze and Report All Separable Layers per EPA 600

☐ Report Composite for Drywall Systems per NESHAP

☐ Report All Layers and Composite Where Applicable

☐ Only Analyze and Report Specifically Noted Layer

* Additional charge and turnaround may be required. ** Alternative Method (ex: EPA 600/R-04/004) may be recommended by Laboratory.

Sampling Date: 6-6-2011

Client Sample ID:	IATL Sample ID:	Sample Description / Location	Notes
841-1'	4327531	Roofing Material	Composite
841-2a	4327532	Window caulk	where possible
841-2b	4327533	↓	↓
841-2c	4327534	↓	↓
841-3a	4327535	Plaster	↓
841-3b	4327536	↓	↓
841-3c	4327537	↓	↓
841-3d	4327538	↓	↓
841-3e	4327539	↓	↓
841-4	4327540	Duct Wrap Insulation	↓
841-5	4327541	Drywall	↓
841-6a	4327542	Stucco Siding	↓
841-6b	4327543	↓	↓
841-6c	4327544	↓	↓

Attachment 4

NOTIFICATION OF INTENT TO RENOVATE/DEMOLISH



MICHIGAN DEPARTMENT OF NATURAL RESOURCES AND ENVIRONMENT (DNRE) AIR QUALITY DIVISION
NESHAP, 40 CFR Part 61, Subpart M



MICHIGAN DEPARTMENT OF ENERGY, LABOR AND ECONOMIC GROWTH (DELEG), ASBESTOS PROGRAM,
P.A. 135 OF 1986, AS AMENDED, Section 220 (1-4) or (8)

DNRE/DELEG USE ONLY

Postmark Date ____/____/____ Rec'd Date ____/____/____

Emergency Date ____/____/____ Valid No. _____

☐ OK ☐ Send Def Ltr. Date of Def Ltr. ____/____/____

FOLLOW UP ____/____/____ Spoke w/ _____

Comments: _____

Notification No. _____ Trans No. _____

Calculate DELEG Asbestos Project Fee: (1% Project Fee)

Total Project Cost: _____ x 0.01 = _____

Type of Contractor: _____ License No.: _____

Licensing Authority: _____

1. NOTIFICATION:

Date of Notification: _____

Date of Revision(s): _____

Notification Type: ☐ Original ☐ Revised ☐ Canceled ☐ Annual

Mark appropriate boxes: (both DNRE and DELEG may apply):

DNRE (NESHAP) [260 In. ft./160 sq. ft. or more is threshold]

☐ Planned Renovation – 10 **working** days notice

☐ Emergency Renovation

☐ Scheduled Demolition – 10 **working** days notice

☐ Intentional Burn – 10 **working** days notice

☐ Ordered Demolition

DELEG (MIOSHA) [Will not accept annual notifications]

☐ Demo, Reno, Encap. (>10 In. ft./15 sq. ft.) 10 **calendar** days notice

☐ Emergency Renovation/Encapsulation

2. PROJECT SCHEDULE:

START DATE

END DATE

* Renovation _____

+Asb. Removal _____

+Demolition: _____

Encapsulation: _____

Work Schedule: Please indicate the anticipated days of the week and work hours for the purpose of scheduling a compliance inspection.

Days of the Week

Work Hours

Asb. Removal: _____

Demolition: _____

Encapsulation: _____

* Includes setup, build enclosure, asbestos removal, demobilizing, etc.

+Include **only** those dates you are conducting asbestos removal/demo.

☐ Check here if this is a multi-phased project, attach a schedule showing the start/end date of each phase.

3. ABATEMENT CONTRACTOR:

Internal Project #: _____

Name: _____

Mailing Address: _____

City/State/Zip: _____

E-mail: _____

Contact: _____ Phone: _____

4. DEMOLITION CONTRACTOR:

Internal Project #: _____

Name: _____

Mailing Address: _____

City/State/Zip: _____

E-mail: _____

Contact: _____ Phone: _____

5. FACILITY OWNER: ("Facility" includes Bridges)

Name: _____

Mailing Address: _____

City/State/Zip: _____

E-mail: _____

Contact: _____ Phone: _____

6. FACILITY DESCRIPTION:

Facility Name: _____

Location Address/Description: _____

_____ If Apt. # of units: _____

City/Twp. _____ State: _____ Zip Code: _____

County: _____ Nearest Crossroad: _____

Size: (sq. ft.) _____ No. of Floors: _____ Floor No.: _____

Age: _____ Present Use: _____ Prior Use: _____

Specific Location(s) in Facility: _____

7. DISPOSAL SITE:

Name: _____

Location Address: _____

City/State/Zip: _____

8. WASTE TRANSPORTER 1:

Name: _____

Address: _____

City/State/Zip: _____

Phone: _____

WASTE TRANSPORTER 2:

9. ORDERED DEMOLITIONS: (See NESHAP regulations for definition of "Ordered Demolition.") A copy of the official Order must accompany this notification.

Gov't Agency Ordering Demo: _____

Name/Title of Person Signing Order: _____

Date of Order: _____ Date Ordered to Begin: _____

10. IS ASBESTOS PRESENT?

☐ Yes ☐ No

☐ To be removed prior to demolition

Estimate the amount of asbestos: Include RACM (Regulated Asbestos Containing Material) to be removed, encapsulated, etc. Also include the amount and type (floor tile, roofing, etc.) of non-friable Category I and/or Category II ACM that **will not** be removed prior to demolition. (**NOTE:** In a demolition, cementitious ACM **cannot** remain in a structure, as it is likely to become regulated in the demolition/handling process. It **must** be removed prior to demolition.)

RACM to be
Removed

RACM to be
Encapsulated

Non-friable ACM **not**
removed prior to demo.
Category I Category II

Units of Measure

				<input type="checkbox"/> Ln. Ft.	<input type="checkbox"/> Ln. M.
				<input type="checkbox"/> Sq. Ft.	<input type="checkbox"/> Sq. M.
				<input type="checkbox"/> Cu. Ft.*	<input type="checkbox"/> Cu.M.*

*Volume (cubic ft./meters) should be used only if unable to measure by linear/square measure (example: asbestos has fallen off of surface).

(continued on reverse side)

NOTIFICATION OF INTENT TO RENOVATE/DEMOLISH (continued)

11. PROJECT DESCRIPTION: Complete **A) for Renovation** (asbestos removal/encapsulation) and/or **B) for Demolition**:

A) RENOVATION: Mark all surfaces/types of RACM to be removed:

☐ Piping ☐ Fittings ☐ Boiler(s) ☐ Tanks(s)
☐ Beam(s) ☐ Duct(s) ☐ Tunnel(s) ☐ Ceiling Tile(s)
☐ Mag Block ☐ Other (describe) _____

Encapsulation (for DELEG): Mark surfaces/types to be encapsulated:

☐ Piping ☐ Fittings ☐ Boiler(s) ☐ Tank(s)
☐ Beam(s) ☐ Duct(s) ☐ Tunnel(s) ☐ Ceiling Tile(s)
☐ Other (describe) _____

Method of removal: Describe how the asbestos will be removed from the surface (example: glove bag, scrape with hand tools, cut in sections and carefully lower, etc.): _____

B) DEMOLITION: Describe the method of demolition of facility, bridge, etc., and indicate if complete or partial. If partial, describe which part of facility bridge, etc., will be demolished: _____

12. ENGINEERING CONTROLS: Describe work practices and engineering controls used to prevent visible emissions before, during, and after removal, and until proper disposal: _____

13. UNEXPECTED ASBESTOS: Describe the steps you intend to follow in the event that unexpected RACM is found or previously non-friable asbestos becomes friable (crumbled, pulverized, reduced to powder, etc.) and therefore regulated: _____

14. PROCEDURE(S) USED TO DETECT THE PRESENCE OF ASBESTOS: **A)** Indicate how you determined whether or not asbestos is in the facility. If analytical sampling was used, describe method of analysis. (The determination of the presence or absence of asbestos must be made prior to submitting a renovation/demolition notification.): _____

B) Name, address, and phone number of company performing asbestos survey: _____

C) Name, accreditation number of inspector, and date of inspection: _____

15. EMERGENCY RENOVATIONS: Date/time of emergency: _____ Describe the sudden, unexpected event: _____

Explain how the event caused unsafe conditions, and/or would cause equipment damage and/or an unreasonable financial burden: _____

16. I certify that an individual trained in the provisions of 40 CFR Part 61, Subpart M, will be on-site during the renovation and during demolition involving RACM above the threshold and/or during an ordered demolition. Evidence that this person has completed the required training will be available for inspection at the renovation or demolition site.

Signature of Owner or Abatement Contractor Date

Signature of Owner or Demolition Contractor Date

17. Signature Requirements for Projects with Negative Pressure Enclosures: (required by DELEG)
Per Section 221(1)(2) of P.A. 135 of 1986, as amended, clearance air monitoring is required for any asbestos abatement project involving 10 linear feet/15 square feet or more of friable material which is performed within a negative pressure enclosure. I (the building owner or lessee) have been advised by the contractor of my responsibility under Act 135 to have clearance air monitoring performed on this project.

Signature of Building Owner or Lessee Date

Signature of Asbestos Abatement Contractor Representative Date

NOTE: It is not mandatory that a signed copy be sent to DELEG unless requested. For affected projects, this section of the notification form must be completed, signed, and made part of your records before the project begins.

18. I certify that the above information is correct:

Printed Name of Owner/Operator Date

Signature of Owner/Operator Date

MAILING ADDRESSES/PHONE NUMBERS: (See Item 1 to determine which agency requirements/regulations are applicable to your project.)

For **Public Act 135 of 1986, as amended, Section 220 (1-4) or (8)**, mail to address below. For more info visit:
<http://www.michigan.gov/asbestos>

MIOSHA Asbestos Program
 DELEG, CSHD
 P.O. Box 30671
 Lansing, MI 48909-8171

517.322.1320 (office), 517.322.1713 (fax)

For **NESHAP Demolitions/Renovations, 40 CFR, Part 61, Subpart M**, mail notifications to the appropriate address below (by county of subject facility): For more info visit <http://www.michigan.gov/deg> click on Air, then Asbestos NESHAP Program.

All Counties (except Wayne County)

NESHAP Asbestos Program
 DNRE, AQD
 P.O. Box 30260
 Lansing, MI 48909-7760

517.373.7064 (Revision Line)

Wayne County Only

NESHAP Asbestos Program
 Detroit Field Office, DNRE, AQD
 Cadillac Place, Suite 2-300
 3058 West Grand Boulevard
 Detroit, MI 48202

313.456.4686



***COMBINATION LEAD BASED PAINT
INSPECTION AND
RISK ASSESSMENT SURVEY***

FOR THE PROPERTY KNOWN AS:

841 E. 9th Street

Flint, MI 48503

Owner's name: Genesee County Land Bank

Owner's Phone #: (810) 257-3088

Current Occupant's name: Vacant Residence

Date of Construction: 1920's



PREPARED FOR:

Genesee County Land Bank
452 S. Saginaw Street, 2nd Floor
Flint, MI 48502
(810) 257-3088

LABWORK PROVIDED BY

Accurate Analytical Testing (AAT)
(734) 699-5227
NLLAP # 100986

DATE(S) OF ASSESSMENT:

June 14, 2011

REPORT PREPARED AND SUBMITTED BY:

Michael Gravlin
EPA Certified Lead Risk Assessor
Certification #: P-00313

ETC Job#: 137259

38900 West Huron River Drive, Romulus, MI 48174

PHONE: (734) 955-6600 FAX: (734) 955-6604

WEBSITE: www.2etc.com

TABLE OF CONTENTS

I. EXECUTIVE SUMMARY

Chart detailing lead hazards found at the home, severity of the hazard, priority and potential solutions (hazard control options) for each hazard.

II. PURPOSE AND SCOPE OF WORK

- A. Lead Inspections
- B. Lead Risk Assessments
- C. Project Limitations and Problems

III. REGULATORY INFORMATION

- A. Title X
- B. Department of Housing and Urban Development (HUD) Requirements
- C. Environmental Protection Agency (EPA):
- D. Occupational Safety and Health Administration (OSHA):
- E. City of Detroit (Ordinances and Codes)

IV. SAMPLE RESULTS AND INFORMATION

- A. Lead Paint Sampling
- B. Lead Dust Sampling
- C. Lead Soil Sampling

V. HAZARD CONTROL OPTION RECOMMENDATIONS

VI. RE-EVALUATION RECOMMENDATIONS

VII. COST ESTIMATES

VIII. RECOMMENDATIONS FOR FUTURE OPERATIONS AND MAINTENANCE

APPENDICES

- Appendix A - All Paint Sample Results (XRF Method)
- Appendix B - **Lead Paint Only** Sample Results (XRF Method)
- Appendix C - Potential Hazards
- Appendix D - Maps of Residence
- Appendix E - Resident Questionnaire and Building Condition Form
- Appendix F - Re-Evaluation Schedule Chart
- Appendix G—Site Photos

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Hazards throughout Home				
Dust levels in some window troughs / wells within the home were found to have elevated lead levels. Therefore, all window troughs should be considered to be lead contaminated.	High	High	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.
Dust levels in some window sills / stools within the home were found to have elevated lead levels. Therefore, all window sills should be considered to be lead contaminated.	High	High	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.
Dust levels on some floors within the home were found to have elevated lead levels. Therefore, all floors should be considered to be lead contaminated.	High	High	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.	The risk assessor believes that these high lead levels were caused by other lead hazards dealt with below. Therefore, after having completed all other abatement / interim control options, clean the entire house for lead dust thoroughly using the accepted HEPA-Wash-HEPA cleaning methods.
A majority of window components (sash interiors and exteriors, troughs and jambs) throughout the home, including basement and attic levels were found to present lead hazards, rather than listing each on a room by room basis, all deteriorated window components should be considered lead hazards.	High	High	1) Remove and replace with new replacement windows or 2) replace individual lead painted components 3) enclose all lead painted surfaces or 4) strip all surfaces bare to the substrate, make necessary repairs, stabilize surfaces, and repaint.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
A majority of window trim components (aprons, stools and casings) throughout the home were found to present lead hazards, rather than listing each on a room by room basis, all deteriorated door components should be considered lead hazards.	High	High	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
A majority of door components throughout the home were found to present lead hazards, rather than listing each on a room by room basis, all deteriorated door components should be considered lead hazards.	High	High	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs, including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Hazards on Property (Not Home)				
Visible paint chips and debris is present on the ground	High	High	Remove all visible paint chips and construction debris.	Remove all visible paint chips and construction debris.
Exterior House 22				
Porch walls, columns, beam and all porch trim including the rafter tails and crown moldings represents deteriorated lead paint surface hazards	Low	Low	1) Wrap walls with Tyvek or equivalent, apply foam insulation board, seal all seams and install a new vinyl or aluminum siding system, including wrapping and enclosure of all trim components with vinyl or aluminum, or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved, exterior grade encapsulant or 3) strip all surfaces bare to the substrate, make necessary repairs, stabilize surfaces, and repaint or 4) replace individual lead painted components	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and wrap with aluminum or vinyl

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
All exterior window sills, casings and door casings represent deteriorated lead paint surface hazards	Low	Low	1) Enclose by wrapping with vinyl or aluminum and seal or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved, exterior grade encapsulate or 3) Remove and replace with new components or 4) strip surfaces bare to the substrate, make necessary repairs, stabilize surfaces, and repaint	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and wrap with aluminum or vinyl
Coal door assembly represents a deteriorated lead paint friction/impact surface hazards	Low	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Ext. Garage 23				
Wood walls represent deteriorated lead paint surface hazards	Low	Low	1) Wrap walls with Tyvek or equivalent, apply foam insulation board, seal all seams and install a new vinyl or aluminum siding system or 2) wet scrape/sand all surfaces bare to the substrate, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved, exterior grade encapsulate or 3) strip all surfaces bare to the substrate, make necessary repairs, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and wrap with aluminum or vinyl
Window sills and casings represents deteriorated lead paint surface hazard(s)	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and wrap with aluminum or vinyl

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Fascia and crown molding represents deteriorated lead paint surface hazard(s)	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and wrap with aluminum or vinyl
Int. Garage 24				
Window sash interiors, exteriors, troughs and jambs representsdeteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new replacement windows or 2) replace individual lead painted components 3) enclose all lead painted surfaces or 4) strip all surfaces bare to the substrate, make necessary repairs, stabilize surfaces, and repaint.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Dining Room 1				
Door jamb (side C-to Kitchen) represents a deteriorated lead paint friction/impact surface hazard	Medium	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Enclosed Porch 2				
Storm door represents a deteriorated lead paint friction/impact surface hazard	Low	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Knee walls, ceilings, joists and columns represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cobver with a suitable wallboard material
Door casings and trimwork represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Foyer 3				
Entry door jamb and threshold represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Bath 6				
Walls represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Sink represents a deteriorated lead paint surface hazard	Low	Low	1) Remove and replace with new sink or 2) Strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape/sand all surfaces, make necessary repairs, stabilize all surfaces and repaint. DO NOT use abrasive cleaners in sink. ALWAYS drain water after each use-DO NOT REUSE WATER Other recommendations1) Abate as soon as possible
Hallway 7				
Door stops represent deteriorated lead paint friction/impact surface hazards	Low	Medium	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Walls and ceiling represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material
Baseboards represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Door casings represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Rear Entry 8				
Storm door, jamb and stops represents a deteriorated lead paint friction/impact surface hazard	Low	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs, including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Closet door, jamb and stops represents a deteriorated lead paint friction/impact surface hazard	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs, including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Door and closet casings represents deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Closet shelves and brackets represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all
Door threshold (side A) and closet threshold represents a deteriorated lead paint friction/impact surface hazard	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Cabinet componets (exteriors, interiors shelves) represent deteriorated lead paint friction/impact surface hazards	Low	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Kitchen 9				
Walls and ceiling represent deteriorated lead paint surface hazards	High	High	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material
Door jambs and stops represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs, including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Cabinet componets (exetriors, interiors, doors, drawers and shelves) represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Baseboards represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.
Door casings represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Laundry chute door and casing represent deteriorated lead paint friction/impact surface hazards	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Stair Up 10				
Ceiling represents a deteriorated lead paint surface hazard	Low	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Hall 11				
Walls and ceiling represent deteriorated lead paint surface hazards	Low	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material
Bathroom 12				
Walls and ceiling represent deteriorated lead paint surface hazards	High	High	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material
Laundry chute door and casing represent deteriorated lead paint friction/impact surface hazards	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Cabinet interior and shelves represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Baseboards represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Door casings represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Bathtub represents a deteriorated lead paint surface hazard	Medium	Medium	1) Remove and replace with new bathtub or 2) Strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape/sand all surfaces, make necessary repairs, stabilize all surfaces and repaint. Install rubber non-slip bath mats to reduce wear. DO NOT use abrasive cleaners in tub. ALWAYS drain water after each use-DO NOT REUSE BATHWATER Other recommendations1) Abate as soon a possible 2) Take showers only 3) Take baths as quickly as possible
Bedroom 13				
Closet jambs and stops represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Baseboards represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Door and closet casings represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Upper Entry 14				
Entry door jamb and threshold represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Bedroom 15				
Baseboards represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Door and closet casings represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Bedroom 16				
Closet jambs and stops represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs, including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Baseboards represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant, install stops at all contact points with other building components (I.E. doors, etc...) or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.
Closet walls represent deteriorated lead paint surface hazards	Low	Low	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint or 2) stabilize all surfaces and cover with a suitable wallboard material

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Door and closet casings represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.
Attic Stairs17				
Door stops represent deteriorated lead paint friction/impact surface hazards	Low	Medium	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Stair treads and risers represent deteriorated lead paint friction/impact surface hazards	Low	Low	1) Enclose with Luann or other suitable flooring material or 2) Remove and replace flooring material or 3) strip all surfaces bare to the substrate, make necessary repairs and recoat. Note: Floors should be abated last.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces, paint and cover with new floor covering (tread covers, carpet, vinyl tile, etc...) material.
Basement Stair 13				
Door jambs and stops represent deteriorated lead paint friction/impact surface hazards	Medium	Medium	1) Remove and replace with new door systems or 2) replace individual lead painted components or 3) strip all surfaces bare to the substrate, stabilize surfaces, and repaint.	1) Refit door to eliminate friction points, wet scrape/sand all surfaces, make necessary repairs,including installation of weatherstripping or other "soft" stop material, stabilize all surfaces and repaint 2) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 3) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.

ETC - Environmental Services WILCO Environmental

Summary of Existing Lead Based Paint Hazards including Abatement and Interim Control Options				
Client	Genesee County Land Bank			
Survey Location:	841 E. 9th Street, Flint, MI 48503			
Survey Date:	06/14/11	Job#:	137259	
Inspectors:	Michael Gravlin			
<p>The items listed here represent the lead based paint hazards found at this building/site. For each identified hazard, there are corresponding options for performing abatement (long term) fixes and interim control (shorter term) fixes. The client and/or their representative need to select the appropriate and affordable solution to address each of the identified hazards.</p> <p>*Always refer to the Potential Hazard Chart (Appendix C) to determine where other lead painted items may be located as not to create additional hazards during the course of the work. If these items are disturbed, lead safe work practices must be followed.</p> <p>*Selected abatement and interim control activities should be completed by a certified abatement contractor or when appropriate a certified renovation firm. After completing these activities, complete and thorough cleaning must be performed following EPA/HUD "Lead Safe Work Practices Procedures". Additionally, after all work has been completed, a final lead clearance should be conducted and may be required. It is the responsibility of the person(s) performing the lead hazard control work to ensure that all appropriate procedures and regulations are followed.</p>				
Identified Hazard	Severity	Priority	Abatement Options	Interim Control Options
Shelves represent deteriorated lead paint surface hazards	Medium	Low	1) Remove and replace with new components or 2) strip all surfaces bare to the substrate, make necessary repairs and recoat.	1) Use friction reduction treatments (jamb liners, weatherstripping, rubber padding, tread covers, etc.) to reduce wear or 2) Wet plane all friction / impact surfaces, wet scrape all remaining surfaces, make necessary repairs, stabilize all surfaces and repaint.
Stair stringers represents deteriorated lead paint surface hazard(s)	Low	Low	1) Remove and replace with new components or 2) wet scrape/sand all surfaces, make necessary repairs, stabilize surfaces and encapsulate with a Michigan approved encapsulant or 3) strip all surfaces bare to the substrate (either chemically or using mechanical wet methods), make necessary repairs and recoat.	Wet scrape / sand all surfaces, make necessary repairs, stabilize all surfaces and repaint.



During the course of this lead combination investigation:

Lead Based Paint was identified on some components

Lead Based Paint Hazards were identified in some areas

II.) PURPOSE AND SCOPE OF WORK

Attached here within are the results of a lead based paint (LPB) combination inspection and risk assessment (combination survey) performed by Michael Gravlin of ETC - Environmental Services (ETC). This combination survey was performed for Genesee County Land Bank at 841 E. 9th Street in Flint, MI 48503. The site work was performed on June 14, 2011 by Michael Gravlin. Michael Gravlin is an EPA certified lead risk assessor and has completed the manufacturer's training course regarding radiation safety and x-ray measurement technology.

The purpose of a lead combination survey is to identify any existing lead paint and/or lead hazards that might exist within the residence. The process of identifying all lead based paint in a residence is referred to as a lead inspection while identifying all lead hazards in a residence is a risk assessment. It has become common in the industry to perform both of these services at one time and this is referred to as a lead combination survey. Although this report represents both services, for the purposes of discussion, we will discuss the methods and goals of inspections and risk assessments separately.

A. Lead Inspections

ETC's inspection started by breaking down the dwelling into separate functional areas. For the testing of paint, each functional area was then broken down into different building components, according to the various colors and substrates. Samples were collected using a X-Ray Fluorescence (XRF) analyzer. The XRF uses radioactive cadmium to determine the amount of lead located within each surface tested. At the time of this report, HUD has defined Lead-Based Paint (LBP) as paint with an average concentration of 1.0 mg/cm², or greater using the XRF technology. Test results for this residence that can be compared against the HUD and EPA standards can be found in Appendix A.

In cases where the XRF detected LBP and the paint was in poor condition (cracked, peeling, chalking, etc.) the inspector may recommended further testing be done. Additional samples such as dust wipes, vacuum samples, air samples or soil samples may be warranted in the areas where the paint is poor condition.

B. Lead Risk Assessments

A lead risk assessment attempts to identify lead hazards that may exist within a home. Lead hazards are defined in an important lead regulation called Title X, the Title X definition includes the following six items:

1. Lead paint that is deteriorated (flaking, chipped, peeling, etc.) in poor condition as defined by Title X.
2. Lead paint on a friction surface (i.e. rubbing doors, sliding windows, etc.) where associated dust levels exceed safe limits.
3. Lead paint on an impact surface (i.e. door jambs, stair treads, etc.) where the impact is caused by another building component.
4. Lead paint on a chewable surface (i.e. window sills, shelves, etc.) where there is visible evidence of teeth marks.
5. Lead contaminated dust where levels exceed safe limits.
6. Lead contaminated soils where levels exceed safe limits.

A lead risk assessment attempts to identify hazards by taking a series of dust, soil and deteriorated paint samples and comparing them to associated limits developed by HUD and EPA.

C. Project Limitations and Problems

Throughout the course of any LBP combination there can be a number of problems including: areas or surfaces that could not be tested, inaccessible areas, locked doors, problems due to inclement weather, etc. During this combination there may have been materials or items that could not be tested or sampled. These materials must be assumed to be lead based paint and treated as such. The items / materials that could not be tested and must therefore be assumed to be lead painted include:

- Kitchen window exteriors—See XRF results

There may have also been unusual circumstances for this project that may have affected the project. The unusual circumstances existing at 841 E. 9th Street included:

- Overall condition of the house is poor, house exterior is aluminum sided, windows are wood, basement windows are wood, shed is an attached portion of the garage.
- Garage interior was tested, exterior is wood and stucco, windows are wood (operational)

- X-Ray Fluorescence (XRF) is a non-destructive type of paint testing. Inspectors do not remove items that are fastened shut, down, together or otherwise made to impede access. Drop ceiling tiles, furniture, equipment, and other items are not removed by the inspectors, those areas should be made to be accessible to the inspector by the building owner. Excessive storage conditions, deferred cleaning practices, and unsafe building conditions could be cause for a building component to not be tested. If a building component is present but does not show up on the inspection report it should be considered to be lead painted unless it was installed after 1978 or has a factory finish on it.
- It is also possible that wall hangings, flags, banners, pictures wall shelving units and large furniture may hide damage to wall surfaces. If those items are covering up damage, it could change the classification of that component from intact or fair to poor. If this is the case, treat those damaged surfaces as though they are a hazard.
- Bare soil areas will change with usage, weather and other factors beyond the control of the risk assessor who wrote this report.

III.) REGULATORY INFORMATION

A. Title X

In October of 1992 the Residential Lead-Based Paint Hazard Reduction Act was passed. This was a sweeping act aimed at reducing the exposure to Americans to lead hazards. The regulation affected all areas of the population. As part of Title X, many other agencies were charged with responsibilities in assuring the LBP's were addressed. OSHA was required to pass a construction standard, HUD was required to promulgate specific and definitive rules for addressing Public and Indian housing and the EPA was required to pass regulations for real estate disclosure, pre-renovation disclosure, training and certification programs for people working on or with LBP and rules for conducting renovation activities safely following "lead safe work practices". This act is the base from which all other regulations affecting LBP have grown.

B. Department of Housing and Urban Development (HUD) Regulations

By recognizing lead based paint (LBP) as a potential health hazard, HUD became the lead federal agency in the identification of lead hazards and has the primary responsibility to regulate LBP in Public or Indian housing. HUD has generated guidelines and performed extensive research to develop comprehensive requirements for LBP inspections, risk assessments and lead abatement or removal activities. These guidelines are enforceable in Public or Indian housing projects or any other project where HUD funds are dispersed. This includes most community development block grant (CDBG) funds as well as other housing assistance as provided by HUD, VA, etc. These methods represent the "State of the Art" technology for lead activities. At this point, EPA has developed similar rules that are in force in all housing and child occupied facilities and are enforced on a State by State basis.

If the work to be completed on this project is federally, state or locally funded, it is likely the full HUD regulations will apply. HUD program requirements for most projects are determined by the amount of money spent on the project. In general the requirements are:

For all projects where the rehabilitation costs will be between \$0 - \$25,000

Genesee County Land Bank or their contractors (as you determine) may choose any combination of the following three (3) options to address the hazards found in the executive summary.

- all interim control options
- some interim controls and some abatement options
- or all abatement options

Also, please note that anytime even one abatement option is chosen, the contractor and their employees must be fully certified licensed through the State of Michigan – Lead Program to perform any abatement work.

For all projects where the rehabilitation costs will exceed \$25,000

In this case, Genesee County Land Bank or their contractors (as you determine) must choose ONLY abatement options to address the hazards identified.

This has serious repercussions for Genesee County Land Bank as abatement options are almost always more expensive than interim controls and this price difference between \$24,999 and \$25,001 may require large extra lead expenses to the program costs for this property. *You may wish to share this information with all of your selected contractors so they better understand the potential cost increases when their bid price exceeds \$25,000.*

Please note, this is only a general outline and the HUD regulations are very complex. For instance some costs on a project (i.e. the initial risk assessment and final clearance) may not count toward the rehabilitation costs. For further information, refer to the HUD guidelines or contact a ETC representative.

C. Environmental Protection Agency (EPA):

Recently, EPA adopted HUD guidelines for conducting LBP inspections, risk assessments and abatement work practices for lead issues. Both HUD and EPA define Lead-based Paint (LBP) as an average concentration of 1.0 mg/cm² when using XRF technology and 1/2 % by weight when reviewing paint chips.

- **EPA Real Estate Disclosure Act:** EPA issued a regulation to insure that families receive information necessary to protect themselves from LBP hazards when purchasing, renting or leasing an older home. In order to accomplish this, the EPA required information to be disseminated during real estate transfers. This act requires sellers and landlords to:
 - Disclose all known information on LBP and hazards in the housing.
 - Complete a Federal disclosure form, including a lead warning statement, provide a copy to the purchaser/prospect, and retain it for three years.
 - Provide purchasers/prospective tenants with an EPA pamphlet on lead hazards.
 - Sellers are also required to give purchasers a 10-day opportunity to conduct a LBP inspection or risk assessment before becoming obligated to purchase the housing.

Agents are required to ensure that the seller or leaser comply with these requirements or perform these requirements themselves. Failure of the seller, leaser, or agent to comply could result in being sued for damages, and being subjected to civil and criminal penalties, such as potential fines and imprisonment.

- EPA Pre-Renovation Rule (PRE): Additionally, EPA issued a regulation to insure contractors warn occupants considering construction within their residence of the possibility that lead dust could be created and work with the selected contractor to reduce this possibility. This act requires renovation contractors of older homes to:
 - Discuss information on LBP and hazards that could be created during a renovation project.
 - Provide purchasers/prospective tenants with an EPA pamphlet on lead hazards and get a signature or other evidence of delivery.
 - This regulation also recommended that all renovations in older housing be completed by trained persons following lead safe work practices.
- EPA Renovation, Repair and Painting Rule (RRP): The most recent EPA regulation (April 2010) regarding LBP was the RRP. This regulation substantially changed requirements for all contractors performing renovations in older housing. This act requires renovation contractors of older homes to:
 - Requires all contractors to have a “certified renovator” working on each project to insure that the regulation is followed. Must be on-site during set-up, cleaning and self conducted clearance.
 - Certified renovators must take an 8 hour training class to receive their certification directly from the EPA.
 - Not only do individuals have to become certified, the companies taking contracts for work need to become “Certified Firms”. This involves applying to the EPA and paying a fee.
 - All work on any affected project must be done following lead safe work practices as taught in the class.
 - Requires posting of work area and possibly containment of work space.
 - Requires a final visual wipe test clearance be performed by the “Certified Renovator”. No neutral third party clearance is required but can be done if desired.

D. Occupational Safety and Health Administration (OSHA):

Additionally, OSHA has established regulations to prevent high lead exposure to employees working in lead related occupations. Along with establishing a permissible exposure limit (PEL), OSHA, working with the National Institute for Occupational Safety and Health (NIOSH), has mandated engineering, work practice and administrative controls to protect the worker. The current PEL at the time of this report is a concentration no greater than 50 micrograms per cubic meter of air.

E. City of Detroit (Ordinances and Codes)

The purpose and intent of the proposed amendments is to protect the health and welfare of children who occupy rented residential dwellings that contain lead-based paint hazards. Part II of this division requires owners of rental property to have a lead inspection and risk assessment performed at the rental property to determine the presence of lead paint and lead-based paint hazards. If lead based paint hazards exist, then the hazards must be reduced and controlled through interim controls or abatement prior to a tenant occupying the rental property. After interim controls or abatement are performed, the owner must obtain a clearance examination. Owners of rental property must obtain a lead clearance pursuant to Part II in order to receive a certificate of compliance from the City. A certificate of compliance is required for occupancy.

IV.) SAMPLE RESULTS AND INFORMATION

A. Lead Paint Sampling

Lead paint sample results are contained in Appendix B. All types of painted surfaces were tested using X-Ray fluorescence (XRF) technologies. XRF uses gamma photons from a sealed irradiation source to strike the atoms within the painted surface. Most commonly, an isotope of cobalt or cadmium is used to produce gamma photons. Because the source is radioactive, training and certification is required to operate an XRF lead analyzer. All inspectors have received the EPA three day lead inspection training and the manufacturer's XRF training. The radiation safety officer for ETC is Jeremy Westcott.

The serial number of the XRF instrument utilized in this project was 19124. These instruments are registered as radioactive materials with the State of Michigan Department of Environmental Quality. The registration number for these instruments is 031070-01-l01. ETC's representatives handle and operate the XRF instrument in accordance with the manufacturers' directives and methods described in the HUD Guidelines.

ETC's lead testing results are applicable for the time that testing was conducted and for the condition of surfaces at the time they were tested. If questions arise regarding lead content on surfaces that were not tested (or were inaccessible) by ETC, then additional testing services should be solicited to test those surfaces for lead.

B. Lead Dust Sampling

For combination surveys, lead dust sampling is required in areas where children are most likely to come into contact with dust. Areas for consideration include: children's bedroom (s), family rooms, play rooms, kitchens, bathrooms, etc. Lead dust samples are to be taken from at least six different rooms with samples from both the floor and either a window sill or window well within each room.

Current limits for lead dust samples taken during combination surveys are as follows in micrograms per square foot ($\mu\text{g}/\text{ft}^2$):

	Floors	Window Sills	Window Wells/ Troughs	Ext. Concrete
HUD	40	250	400	800
EPA	40	250	400	800
OSHA	~9000	~9000	~9000	~9000

Actual dust level results noted at the 841 E. 9th Street residence are below. Any sample above the allowable regulatory limit is in bold.

<i>Sample #</i>	<i>Room Location</i>	<i>Component</i>	<i>Area Wiped (in sq. ft.)</i>	<i>Lead Concentration (in $\mu\text{g}/\text{ft}^2$)</i>
WS 1	Dining room 1	Floor	1.00	4871.00
WS 2	Dining room 1	Window sill	0.52	772.00
WS 3	Living room 4	Floor	1.00	278.00
WS 4	Living room 4 side a	Trough	0.56	112400.00
WS 5	Office 5	Floor	1.00	235.00
WS 6	Office 5	Window sill	0.42	6381.00
WS 7	Bedroom 13	Floor	1.00	100.00
WS 8	Bedroom 13 side a	Trough	0.64	5413.00
WS 9	Bedroom 15	Floor	1.00	102.00
WS 10	Bedroom 15 side b	Window sill	0.30	585.00
WS 11	Bedroom 16	Floor	1.00	173.00
WS 12	Bedroom 16 side c	Trough	0.64	3342.00

Any high dust levels noted here represent lead hazards and are included in the hazard charts in the Executive Summary. This chart details the lead dust problems identified (or lack thereof) within this residence. *Please keep in mind that if lead dust samples were not taken in each room of the residence the samples that were taken will be used to represent overall conditions in the residence.* This means that areas that were not individually sampled may be listed as having problems based upon the sampling that was conducted in other areas.

C. Lead Soil Sampling

Lead soil sampling is required in areas where bare exposed soil is present around the house and the yard. Areas for consideration include: house perimeter, gardens, play areas, driveways, etc. Lead soil samples will only be taken if bare exposed soils exist. Sampling usually involves three areas: play areas where children are likely to come in contact with soil, the perimeter of the home (i.e. gardens, etc.) and other non-play areas of the yard where contact is less likely.

Current limits for lead soil samples taken during combination surveys are as follows in parts per million (ppm):

	Play Areas	House Perimeter or Other Areas of Yard
HUD	400	1200
EPA	400	1200

Actual soil results for the 841 E. 9th Street residence can be found in the chart below. Any sample above the allowable regulatory limit is in bold.

	Location	Results (parts per million)
SS-1	Perimeter of House	1067

Any high soil levels noted here represent lead hazards and are included in the hazard charts in the Executive Summary. This chart details the lead soil problems identified (or lack thereof) within this residence. Please keep in mind that lead soil samples are composite samples where a small portion is taken from four or five different locations to make up the one sample. Therefore the results of this one sample represent all of the different areas where the separate pieces were acquired. Play areas and non-play areas should never be mixed in the same sample

V.) HAZARD CONTROL OPTION RECOMMENDATIONS

Types of hazards that may have been identified during the lead combination include both identified hazards and potential hazards. Identified hazards include paint, dust and soil hazards that fit the six (6) hazard definitions of HUD and the EPA detailed above. For each identified hazard, hazard control options (recommendations) are given to explain how to address any problems identified in the sampling. In the case of the 841 E. 9th Street property, hazard control options can be found in the Executive Summary Chart.

Potential hazards are areas of the residence where the occupant or owner may be completing renovation activities in the future. If future renovation activities were identified, these areas were sampled using the XRF instrument to determine lead content. If the paint in these areas was found to be above 1.0 mg/cm^2 , they were listed as potential hazards. This is required as the up-coming renovation activities will likely disturb the paint and possibly create lead based dust hazards that do not currently exist. It is critical that the homeowner (or selected renovation contractor) follow "lead safe work practices" when working on the potential hazards to avoid creating lead dust hazards. A list of potential hazards identified during the combination can be found in Appendix C.

VI.) RE-EVALUATION RECOMMENDATIONS

Anytime lead paint or hazards remain in the building and are not completely removed, the risk assessor is required to make recommendations for re-evaluating the building. This is the recommended time when the homeowner should hire a certified risk assessor to determine whether (1) conditions at the home have changed possibly causing additional hazards, (2) the initial hazard control options implemented have been effective or (3) if further work is warranted. The frequency of re-evaluations recommended is dependent on both the risk assessment results and the hazard control options that are chosen and implemented.

At the time of producing this risk assessment, the risk assessor can only be sure of the current conditions, but can not know for sure which hazard control options will be selected. For this reason, ETC has chosen to include a re-evaluation chart in Appendix F. To determine the re-evaluation frequency recommended for this residence, please refer to this chart and reference Schedule 4 as given in the chart. This schedule was chosen based upon the results of the initial risk assessment. After finding the appropriate schedule, the homeowner / building manager / owner will need to know which hazard control options were conducted. By knowing the appropriate schedule (Schedule 4) and the hazard control selected (chosen by the owner) you can determine the recommended re-evaluation frequency.

If you do not wish to follow the chart, you can opt to follow the most stringent re-evaluation frequency that would be to re-evaluate at: 6 months, then 1 year then 2 years.

VII.) COST ESTIMATE

HUD and EPA regulations require the risk assessor to provide cost estimates for possible work to be completed. Below find a rough estimate of costs associated with lead remediation activities.

Encapsulation	\$3.50 sq. ft.	Enclosure wood	\$4.00 sq. ft.
Wet plane friction & impact points	\$2.50 sq. ft.	Enclosure metal	\$5.00 sq. ft.
Wet scrape and repaint	\$2.00 sq. ft.	Enclosure drywall	\$2.50 sq. ft.
Window replacement	\$500 each	Door replacement	\$750.00 each.
Dust removal-clean up	\$1.25 sq. ft.	Soil abatement	\$10.00 sq. ft
Siding Installation	\$2.75 sq. ft	Component replacement	5 times material cost

VIII.) RECOMMENDATIONS FOR FUTURE OPERATIONS AND MAINTENANCE


It is very important to note that future disturbance of lead painted surfaces may cause new and additional lead hazards. Homeowners, building managers and landlords are expected to follow "lead safe work practices" any time that a lead painted surface is disturbed. This means making sure very little dust is generated (i.e. wet sanding not dry sanding), not burning lead painted items, cleaning up thoroughly after work, etc.

In order to provide guidance for the owners, managers and landlords when conducting renovation, maintenance or potential future disturbance of painted surfaces, they should refer to an excellent manual developed by HUD titled "Lead Paint Safety: A Field Guide for Painting, Home Maintenance, and Renovation Work". This manual can be found for free on the Internet at <http://www.hud.gov/offices/lead/training/LBPguide.pdf>. Please download a copy of this manual before disturbing any painted surfaces within the residence. If access to the Internet is not available, you may order a copy at 1-800-424-5323.

If you have any questions not answered by this manual, please contact our office at (734) 955-6600. Thank you.

This report reviewed and submitted by

ETC – Environmental Services



Michael Gravlin (Cert. # P-00313)
EPA / Michigan Certified Risk Assessor

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
1										Positive	8.06 +/- 0
2			CALIBRATE						1.04	Negative	0.9 +/- 0.1
3			CALIBRATE						1.09	Positive	1 +/- 0.1
4			CALIBRATE						1.03	Negative	0.9 +/- 0.1
5	First	A	Dining Room 1	Wall	Plaster	POOR	Green		3.21	Negative	0.4 +/- 0.6
6	First	B	Dining Room 1	Wall	Plaster	POOR	Green		5.09	Negative	0.21 +/- 0.75
7	First	C	Dining Room 1	Wall	Plaster	POOR	Green		6.22	Negative	0.4 +/- 0.5
8	First	D	Dining Room 1	Wall	Plaster	POOR	Green		2.87	Negative	0.4 +/- 0.6
9	First	Ceiling	Dining Room 1	Ceiling	Plaster	POOR	White		1.41	Negative	0.02 +/- 0.04
10	First	A	Dining Room 1	Door Casing	Wood	POOR	White		7.88	Negative	0.06 +/- 0.11
11	First	A	Dining Room 1	Baseboard	Wood	POOR	Clear / Stain		1	Negative	0.05 +/- 0.1
12	First	A	Dining Room 1	Win. Sill/Stool	Wood	POOR	Clear / Stain		1	Negative	0.04 +/- 0.09
13	First	A	Dining Room 1	Win. Casing	Wood	POOR	Clear / Stain		1.13	Negative	0.08 +/- 0.14
14	First	A	Dining Room 1	Win. Stop	Wood	POOR	Clear / Stain		1.49	Negative	0.05 +/- 0.14
15	First	A	Dining Room 1	Win. Sash	Wood	POOR	Clear / Stain		1.15	Negative	0.08 +/- 0.14
16	First	A	Dining Room 1	Win. Sash, ext.	Wood	POOR	White		1.4	Positive	1.2 +/- 0.2
17	First	A	Dining Room 1	Win. Well/Trough	Wood	POOR	White		3.9	Positive	27 +/- 16.7
18	First	A	Dining Room 1	Win. Jamb	Wood	POOR	White		3.84	Positive	18.1 +/- 12.9
19	First	A	Dining Room 1	Ext. Win. Storm/Screen	Wood	POOR	White		4.26	Positive	9.9 +/- 8.5
20	First	B	Dining Room 1	Door Casing	Wood	FAIR	Clear / Stain		1.61	Negative	0.1 +/- 0.19
21	First	B	Dining Room 1	Door Jamb	Wood	FAIR	Clear / Stain		2.25	Negative	0.09 +/- 0.22
22	First	B	Dining Room 1	Door Stop	Wood	FAIR	Clear / Stain		1.22	Negative	0.02 +/- 0.08
23	First	B	Dining Room 1	Door	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.06
24	First	C	Dining Room 1	Cabinet Out	Wood	FAIR	Clear / Stain		1.63	Negative	0.04 +/- 0.13
25	First	C	Dining Room 1	Cabinet Door	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
26	First	C	Dining Room 1	Cabinet In	Wood	FAIR	Clear / Stain		1.37	Negative	0.01 +/- 0.07
27	First	C	Dining Room 1	Cabinet Shelf	Wood	FAIR	Clear / Stain		1.52	Negative	0.02 +/- 0.08
28	First	C	Dining Room 1	Drawer	Wood	POOR	Clear / Stain		1.02	Negative	0.03 +/- 0.08
29	First	C	Dining Room 1	Door Jamb	Wood	POOR	Green		7.33	Positive	7 +/- 3.6
30	First	Floor	Dining Room 1	Floor	Wood	POOR	Clear / Stain		1.09	Negative	0.04 +/- 0.1
31	First	A	Enclosed Porch 2	Knee Wall	Wood	POOR	Clear / Stain		1.85	Positive	3.2 +/- 1.6
32	First	B	Enclosed Porch 2	Knee Wall	Wood	POOR	Clear / Stain		6.2	Positive	8.5 +/- 4
33	First	C	Enclosed Porch 2	Wall	Metal	POOR	White		2.21	Negative	0.01 +/- 0.02
34	First	D	Enclosed Porch 2	Knee Wall	Wood	POOR	White		2.42	Positive	4.4 +/- 3.4
35	First	Ceiling	Enclosed Porch 2	Ceiling	Wood	POOR	White		5.82	Positive	7.9 +/- 3.8
36	First	Ceiling	Enclosed Porch 2	Joist	Wood	POOR	White		2.84	Positive	21 +/- 14.2
37	First	A	Enclosed Porch 2	Porch Column	Wood	POOR	White		5.47	Positive	22.1 +/- 13.8
38	First	A	Enclosed Porch 2	Trim	Wood	POOR	White		5.03	Positive	7.7 +/- 3.8

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
39	First	A	Enclosed Porch 2	Door Storm	Wood	POOR	White		5.95	Positive	8.8 +/- 4
40	First	A	Enclosed Porch 2	Door Storm	Wood	POOR	Grey		10	Positive	10.4 +/- 9
41	First	A	Enclosed Porch 2	Door Stop	Wood	POOR	Grey		6.46	Negative	0.21 +/- 0.63
42	First	C	Enclosed Porch 2	Door Casing	Wood	POOR	White		10	Positive	17.7 +/- 12.6
43	First	A	Foyer 3	Wall	Plaster	POOR	White		9.07	Negative	0.4 +/- 0.6
44	First	C	Foyer 3	Wall	Plaster	POOR	White		3.14	Negative	0.14 +/- 0.09
45	First	D	Foyer 3	Wall	Plaster	POOR	White		4.64	Negative	0.22 +/- 0.3
46	First	Ceiling	Foyer 3	Ceiling	Plaster	POOR	White		7.24	Negative	0.06 +/- 0.18
47	First	D	Foyer 3	Crown Molding	Wood	POOR	White		3.55	Negative	0.03 +/- 0.11
48	First	D	Foyer 3	Stair Wall	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.09
49	First	A	Foyer 3	Baseboard	Wood	FAIR	Clear / Stain		1.05	Negative	0.03 +/- 0.08
50	First	A	Foyer 3	Door Casing	Wood	POOR	Clear / Stain		2.04	Negative	0.03 +/- 0.13
51	First	A	Foyer 3	Entry door	Wood	POOR	Clear / Stain		1.19	Negative	0.06 +/- 0.13
52	First	A	Foyer 3	Door Jamb	Wood	POOR	Clear / Stain		1	Negative	0 +/- 0.03
53	First	A	Foyer 3	Door Jamb	Wood	POOR	White		3.17	Positive	17 +/- 12.3
54	First	A	Foyer 3	Door Threshold	Wood	POOR	Grey		2.2	Positive	18.1 +/- 13.2
55	First	B	Foyer 3	Archway cas.	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.07
56	First	Floor	Foyer 3	Floor	Wood	POOR	Clear / Stain		1.01	Negative	0.01 +/- 0.04
57	First	Floor	Living Room 4	Floor	Wood	POOR	Clear / Stain		1.1	Negative	0.01 +/- 0.04
58	First	A	Living Room 4	Wall	Plaster	POOR	White		7.55	Negative	0.27 +/- 0.4
59	First	B	Living Room 4	Wall	Plaster	FAIR	White		5.89	Negative	0.4 +/- 0.6
60	First	C	Living Room 4	Wall	Plaster	FAIR	White		7.26	Negative	0.11 +/- 0.81
61	First	D	Living Room 4	Wall	Plaster	POOR	White		4.57	Negative	0.3 +/- 0.59
62	First	Ceiling	Living Room 4	Ceiling	Plaster	POOR	White		6.11	Negative	0.26 +/- 0.73
63	First	A	Living Room 4	Crown Molding	Wood	POOR	White		1.12	Negative	0.03 +/- 0.09
64	First	A	Living Room 4	Baseboard	Wood	POOR	White		1.28	Negative	0.04 +/- 0.11
65	First	A	Living Room 4	Win. Apron	Wood	POOR	White		1.14	Negative	0.07 +/- 0.13
66	First	A	Living Room 4	Win. Sill/Stool	Wood	POOR	White		1.19	Negative	0.05 +/- 0.12
67	First	A	Living Room 4	Win. Casing	Wood	POOR	White		1.76	Negative	0.1 +/- 0.21
68	First	A	Living Room 4	Win. Stop	Wood	POOR	White		1.8	Negative	0.11 +/- 0.21
69	First	A	Living Room 4	Win. Sash	Wood	POOR	White		1.1	Negative	0.06 +/- 0.12
70	First	B	Living Room 4	Win. Sash, ext.	Wood	POOR	White		2.94	Positive	15.6 +/- 11.7
71	First	B	Living Room 4	Win. Well/Trough	Wood	POOR	White		5.68	Positive	18.9 +/- 13
72	First	B	Living Room 4	Win. Jamb	Wood	POOR	White		3.32	Positive	22.9 +/- 14.3
73	First	B	Living Room 4	Ext. Win. Storm/Screen	Wood	POOR	White		3.77	Positive	4.6 +/- 3
74	First	B	Living Room 4	Cabinet Out	Wood	FAIR	Clear / Stain		1	Negative	0.01 +/- 0.05
75	First	B	Living Room 4	Cabinet Door	Wood	FAIR	Clear / Stain		1.06	Negative	0.05 +/- 0.11
76	First	B	Living Room 4	Drawer	Wood	FAIR	Clear / Stain		1.95	Negative	0.02 +/- 0.09

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
77	First	B	Living Room 4	Cabinet Shelf	Wood	FAIR	Clear / Stain		1	Negative	0 +/- 0.03
78	First	B	Living Room 4	Cabinet In	Wood	FAIR	Clear / Stain		1	Negative	0 +/- 0.03
79	First	B	Living Room 4	Fire Mantle	Wood	FAIR	Clear / Stain		1	Negative	0.01 +/- 0.05
80	First	D	Living Room 4	Archway cas.	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.07
81	First	A	Office 5	Wall	Plaster	FAIR	White		4.48	Negative	0.2 +/- 0.79
82	First	B	Office 5	Wall	Plaster	FAIR	White		4.25	Negative	0.15 +/- 0.24
83	First	C	Office 5	Wall	Plaster	FAIR	White		2.93	Negative	0.2 +/- 0.79
84	First	D	Office 5	Wall	Plaster	POOR	White		5.53	Negative	0.19 +/- 0.25
85	First	Ceiling	Office 5	Ceiling	Plaster	POOR	White		4.54	Negative	0.16 +/- 0.77
86	First	C	Office 5	Crown Molding	Wood	FAIR	White		1	Negative	0.03 +/- 0.07
87	First	C	Office 5	Baseboard	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.1
88	First	C	Office 5	Win. Apron	Wood	FAIR	Clear / Stain		1.13	Negative	0.04 +/- 0.1
89	First	C	Office 5	Win. Sill/Stool	Wood	FAIR	Clear / Stain		1.07	Negative	0.06 +/- 0.12
90	First	C	Office 5	Win. Casing	Wood	FAIR	Clear / Stain		1	Negative	0.09 +/- 0.14
91	First	C	Office 5	Win. Sash	Wood	FAIR	Clear / Stain		1	Negative	0.05 +/- 0.1
92	First	C	Office 5	Win. Sash, ext.	Wood	POOR	White		1.35	Positive	1.1 +/- 0.1
93	First	C	Office 5	Win. Well/Trough	Wood	POOR	White		3.78	Positive	25.6 +/- 16.2
94	First	C	Office 5	Win. Jamb	Wood	POOR	White		4.02	Positive	19.7 +/- 13.7
95	First	C	Office 5	Ext. Win. Storm/Screen	Wood	POOR	White		6.62	Positive	10.9 +/- 8.8
96	First	D	Office 5	Clos. Casing	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.06
97	First	D	Office 5	Clos. Jamb	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.07
98	First	D	Office 5	Clos. Stop	Wood	FAIR	Clear / Stain		1	Negative	0.02 +/- 0.06
99	First	D	Office 5	Clos. Door	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.09
100	First	D	Office 5	Clos. Shelf	Wood	FAIR	Clear / Stain		1.54	Negative	0.07 +/- 0.16
101	First	D	Office 5	Shelf Brackets	Wood	FAIR	Clear / Stain		1.89	Negative	0.06 +/- 0.17
102	First	D	Office 5	Clothes Rod	Wood	POOR	Clear / Stain		1	Negative	0.03 +/- 0.08
103	First	D	Office 5	Clos. Wall	Plaster	FAIR	White		7.68	Negative	0.17 +/- 0.33
104	First	D	Office 5	Clos. Ceiling	Plaster	FAIR	White		2.31	Negative	0.05 +/- 0.12
105	First	A	Office 5	Door Casing	Wood	FAIR	Clear / Stain		1.33	Negative	0.06 +/- 0.13
106	First	A	Office 5	Door Jamb	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
107	First	A	Office 5	Door Stop	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
108	First	A	Office 5	Door	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.09
109	First	Floor	Office 5	Floor	Wood	FAIR	Clear / Stain		1	Negative	0 +/- 0.04
110	First	A	Bathroom 6	Wall	Plaster	FAIR	Green		10	Positive	1.8 +/- 0.8
111	First	B	Bathroom 6	Wall	Plaster	POOR	Green		10	Positive	1.9 +/- 0.8
112	First	C	Bathroom 6	Wall	Plaster	FAIR	Green		10	Positive	2.4 +/- 1
113	First	D	Bathroom 6	Wall	Plaster	FAIR	Green		10	Positive	4 +/- 2.4
114	First	Ceiling	Bathroom 6	Ceiling	Plaster	FAIR	Green		10	Positive	3.2 +/- 2.1

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client			Genesee County Land Bank								
Survey Location:			841 E. 9th Street, Flint, MI 48503								
Survey Date:			06/14/11								
Inspectors:			Michael Gravin		License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
115	First	B	Bathroom 6	Baseboard	Wood	FAIR	Green		5.07	Positive	5.6 +/- 3.2
116	First	B	Bathroom 6	Door Casing	Wood	FAIR	Green		10	Positive	4.8 +/- 3.4
117	First	B	Bathroom 6	Door Jamb	Wood	FAIR	Green		10	Positive	7.2 +/- 3.6
118	First	B	Bathroom 6	Door Stop	Wood	FAIR	Green		4.34	Positive	2.7 +/- 1.7
119	First	B	Bathroom 6	Door	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.09
120	First	C	Bathroom 6	Win. Apron	Wood	FAIR	Green		5.93	Positive	7.6 +/- 3.7
121	First	C	Bathroom 6	Win. Sill/Stool	Wood	FAIR	Green		6.79	Positive	6.6 +/- 3.6
122	First	C	Bathroom 6	Win. Casing	Wood	POOR	Green		10	Positive	7.3 +/- 3.8
123	First	C	Bathroom 6	Win. Sash	Wood	POOR	Green		10	Positive	6.5 +/- 3.5
124	First	C	Bathroom 6	Win. Sash, ext.	Wood	POOR	White		3.12	Positive	19.4 +/- 13.2
125	First	C	Bathroom 6	Win. Well/Trough	Wood	POOR	White		6.16	Positive	21.4 +/- 13.7
126	First	C	Bathroom 6	Win. Jamb	Wood	POOR	White		4.09	Positive	25.1 +/- 15.5
127	First	D	Bathroom 6	Door	Wood	POOR	Green		1.69	Negative	0.05 +/- 0.14
128	First	A	Bathroom 6	Sink In	Metal	POOR	White		2.46	Positive	29.3 +/- 18
129	First	A	Hallway 7	Wall	Plaster	POOR	Green		10	Positive	3.8 +/- 2.6
130	First	B	Hallway 7	Wall	Plaster	FAIR	Green		10	Positive	3.9 +/- 2.7
131	First	C	Hallway 7	Wall	Plaster	FAIR	Green		5.92	Positive	5.4 +/- 3.6
132	First	D	Hallway 7	Wall	Plaster	FAIR	Green		8.38	Positive	4.3 +/- 2.7
133	First	Ceiling	Hallway 7	Ceiling	Plaster	POOR	Green		9.43	Positive	5 +/- 3.4
134	First	B	Hallway 7	Baseboard	Wood	POOR	Green		5.34	Positive	3.9 +/- 2.3
135	First	C	Hallway 7	Baseboard	Wood	POOR	Green		5.48	Positive	3.8 +/- 2.3
136	First	C	Hallway 7	Door Stop	Wood	POOR	Blue		3.49	Positive	2.3 +/- 1.3
137	First	C	Hallway 7	Door Casing	Wood	POOR	Blue		9.77	Positive	15.6 +/- 11.6
138	First	C	Hallway 7	Door	Metal	POOR	Blue		1	Negative	0 +/- 0.03
139	First	Floor	Hallway 7	Floor	Wood	POOR	Clear / Stain		1.03	Negative	0.03 +/- 0.08
140	First	Floor	Rear Entry 8	Floor	Wood	POOR	Blue		3.17	Positive	7.7 +/- 4
141	First	D	Rear Entry 8	Wall	Metal	POOR	White		1.79	Negative	0.01 +/- 0.02
142	First	Ceiling	Rear Entry 8	Ceiling	Wood	FAIR	White		2	Positive	13.5 +/- 10.5
143	First	A	Rear Entry 8	Door Casing	Wood	POOR	Blue		10	Positive	17.6 +/- 12.3
144	First	A	Rear Entry 8	Door Threshold	Wood	POOR	Red		4.09	Positive	18.9 +/- 13
145	First	B	Rear Entry 8	Door Jamb	Wood	POOR	Grey		10	Positive	21.7 +/- 14
146	First	B	Rear Entry 8	Door Stop	Wood	POOR	Grey		7.76	Positive	22.5 +/- 14.4
147	First	B	Rear Entry 8	Door Threshold	Wood	POOR	Grey		1	Negative	0.02 +/- 0.06
148	First	B	Rear Entry 8	Door Storm	Wood	POOR	Grey		10	Positive	17.5 +/- 12.3
149	First	B	Rear Entry 8	Door Storm	Wood	POOR	White		10	Positive	19.5 +/- 13.6
150	First	C	Rear Entry 8	Win. Sill/Stool	Wood	POOR	White		9.48	Positive	19.4 +/- 13.1
151	First	C	Rear Entry 8	Win. Casing	Wood	POOR	White		6.8	Positive	16.6 +/- 12.6

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
152	First	C	Rear Entry 8	Win. Sash	Wood	POOR	White		6.64	Positive	11.7 +/- 10.1
153	First	C	Rear Entry 8	Win. Sash, ext.	Wood	POOR	White		2.84	Positive	17.3 +/- 12.6
154	First	D	Rear Entry 8	Clos. Casing	Wood	POOR	White		10	Positive	5.3 +/- 3.2
155	First	D	Rear Entry 8	Clos. Threshold	Wood	POOR	White		1.43	Negative	0.27 +/- 0.31
156	First	D	Rear Entry 8	Clos. Jamb	Wood	POOR	White		3.41	Positive	1.8 +/- 0.7
157	First	D	Rear Entry 8	Clos. Stop	Wood	POOR	White		3.54	Positive	3.7 +/- 2.1
158	First	D	Rear Entry 8	Clos. Door	Wood	POOR	White		6.15	Positive	2.7 +/- 1.4
159	First	D	Rear Entry 8	Clos. Shelf	Wood	POOR	White		1.98	Positive	11 +/- 9.4
160	First	D	Rear Entry 8	Shelf Brackets	Wood	POOR	White		2.35	Positive	11.9 +/- 9.4
161	First	D	Rear Entry 8	Shelf Brackets	Wood	POOR	Green		1.95	Positive	7.6 +/- 5.4
162	First	D	Rear Entry 8	Cabinet Shelf	Wood	POOR	Green		2.37	Positive	9.8 +/- 8.8
163	First	D	Rear Entry 8	Cabinet out	Wood	POOR	Green		2.45	Positive	8.1 +/- 6.4
164	First	D	Rear Entry 8	Cabinet in	Wood	POOR	Green		2.67	Positive	12.2 +/- 10
165	First	D	Rear Entry 8	Win. Apron	Wood	POOR	Green		3.22	Positive	7 +/- 3.5
166	First	D	Rear Entry 8	Win. Sill/Stool	Wood	POOR	Green		3.51	Positive	6 +/- 3.3
167	First	D	Rear Entry 8	Win. Casing	Wood	POOR	Green		2.42	Positive	2.5 +/- 1.4
168	First	D	Rear Entry 8	Win. Jamb	Wood	POOR	Green		2.74	Positive	21.7 +/- 14
169	First	D	Rear Entry 8	Win. Well/Trough	Wood	POOR	Green		3.32	Positive	21.9 +/- 14.2
170	First	D	Rear Entry 8	Ext. Win. Storm/Screen	Wood	POOR	Green		2.78	Positive	4.7 +/- 3.6
171	First	D	Rear Entry 8	Clos. Casing in.	Wood	POOR	Green		4.72	Positive	3.9 +/- 1.9
172	First	D	Rear Entry 8	Clos. Wall	Plaster	POOR	Green		1.73	Negative	0.25 +/- 0.08
173	First	D	Rear Entry 8	Clos. Ceiling	Plaster	POOR	Green		1.66	Negative	0.29 +/- 0.14
174	First	A	Kitchen 9	Wall	Plaster	POOR	Green		1	Negative	0 +/- 0.02
175	First	B	Kitchen 9	Wall	Plaster	POOR	Green		9.18	Positive	2.3 +/- 1
176	First	C	Kitchen 9	Wall	Plaster	POOR	Green		8.22	Positive	2.8 +/- 1.1
177	First	D	Kitchen 9	Wall	Plaster	POOR	Green		8.48	Positive	2.5 +/- 1.1
178	First	Ceiling	Kitchen 9	Ceiling	Plaster	POOR	Green		10	Positive	2.1 +/- 1
179	First	A	Kitchen 9	Baseboard	Wood	POOR	Green		4.02	Positive	4.2 +/- 3.1
180	First	A	Kitchen 9	Wall Register	Metal	POOR	Green		10	Negative	-0.33 +/- 0.85
181	First	A	Kitchen 9	Door Casing	Metal	POOR	Green		7.76	Positive	5.8 +/- 3.4
182	First	A	Kitchen 9	Laundry Chute Casing	Wood	POOR	Green		5.11	Positive	4.4 +/- 3
183	First	A	Kitchen 9	Laundry Chute Door	Wood	POOR	Green		10	Positive	4.6 +/- 3.1
184	First	A	Kitchen 9	Door Casing	Wood	POOR	Green		7.58	Positive	4.7 +/- 3.1
185	First	A	Kitchen 9	Door Jamb	Wood	POOR	Green		4.54	Positive	4.1 +/- 3
186	First	A	Kitchen 9	Door Stop	Wood	POOR	Green		4.72	Positive	1.5 +/- 0.5
187	First	C	Kitchen 9	Wall Casing	Wood	POOR	Green		4.43	Positive	5.2 +/- 3.2
188	First	C	Kitchen 9	Win. Apron	Wood	POOR	Green		10	Positive	4 +/- 2.4

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
189	First	C	Kitchen 9	Win. Sill/Stool	Wood	POOR	Green		10	Positive	4.5 +/- 3
190	First	C	Kitchen 9	Win. Casing	Wood	POOR	Green		10	Positive	2.7 +/- 1.6
191	First	C	Kitchen 9	Win. Sash	Wood	POOR	Green		2.5	Positive	7.8 +/- 4
192	First	D	Kitchen 9	Cabinet Out	Wood	POOR	Green		4.79	Positive	3.5 +/- 2.2
193	First	D	Kitchen 9	Drawer	Wood	POOR	Green		4.73	Positive	3.1 +/- 2
194	First	D	Kitchen 9	Cabinet Door	Wood	POOR	Green		7.61	Positive	3.9 +/- 2.2
195	First	D	Kitchen 9	Cabinet Shelf	Wood	POOR	White		4.15	Positive	3.2 +/- 2.2
196	First	D	Kitchen 9	Shelf Bracket	Wood	POOR	White		1.22	Positive	2.2 +/- 0.8
197	First	D	Kitchen 9	Cabinet In	Wood	POOR	White		5.47	Positive	4 +/- 2.8
198	First	B	Stair Up 10	Wall	Plaster	POOR	White		4.34	Negative	0.03 +/- 0.77
199	First	D	Stair Up 10	Wall	Plaster	POOR	White		8.6	Negative	-0.04 +/- 0.81
200	First	Ceiling	Stair Up 10	Ceiling	Plaster	POOR	White		4.09	Positive	2.7 +/- 1.2
201	First	D	Stair Up 10	Railing	Wood	FAIR	Clear / Stain		1.17	Negative	0.01 +/- 0.05
202	First	D	Stair Up 10	Stair Stringer	Wood	FAIR	Clear / Stain		1	Negative	0.01 +/- 0.05
203	First	D	Stair Up 10	Newel Post	Wood	FAIR	Clear / Stain		1.11	Negative	0.01 +/- 0.05
204	First	D	Stair Up 10	Railing Cap	Wood	FAIR	Clear / Stain		1	Negative	0.01 +/- 0.04
205	First	D	Stair Up 10	Baluster	Wood	FAIR	Clear / Stain		1.03	Negative	0.06 +/- 0.12
206	First	Floor	Stair Up 10	Stair Tread	Wood	FAIR	Clear / Stain		2.56	Negative	0.02 +/- 0.13
207	First	Floor	Stair Up 10	Stair Riser	Wood	FAIR	Clear / Stain		4.01	Negative	0.06 +/- 0.28
208	First	D	Stair Up 10	Wall Casing	Wood	FAIR	Clear / Stain		1.33	Negative	0.08 +/- 0.15
209	Second	D	Stair Up 10	Wall, Upper	Wood	FAIR	Clear / Stain		1.71	Negative	0.09 +/- 0.19
210	Second	C	Stair Up 10	Wall, Upper	Wood	FAIR	Clear / Stain		1.28	Negative	0.05 +/- 0.12
211	Second	C	Stair Up 10	Door Jamb	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.09
212	Second	C	Stair Up 10	Door	Wood	FAIR	Clear / Stain		1	Negative	0.05 +/- 0.1
213	Second	Floor	Hallway 11	Floor	Wood	FAIR	Clear / Stain		1	Negative	0 +/- 0.02
214	Second	C	Hallway 11	Baseboard	Wood	FAIR	Clear / Stain		4.27	Negative	0.09 +/- 0.34
215	Second	C	Hallway 11	Win. Apron	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.09
216	Second	C	Hallway 11	Win. Sill/Stool	Wood	FAIR	Clear / Stain		1.76	Negative	0.07 +/- 0.17
217	Second	C	Hallway 11	Win. Casing	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
218	Second	C	Hallway 11	Win. Sash	Wood	POOR	Clear / Stain		1.01	Negative	0.06 +/- 0.11
219	Second	C	Hallway 11	Win. Sash, ext.	Wood	POOR	White		3.27	Positive	11 +/- 9.5
220	Second	C	Hallway 11	Win. Well/Trough	Wood	POOR	White		7.74	Positive	26 +/- 16.1
221	Second	C	Hallway 11	Win. Jamb	Wood	POOR	White		2.76	Positive	13.9 +/- 10.6
222	Second	D	Hallway 11	Door Casing	Wood	FAIR	Clear / Stain		1.36	Negative	0.06 +/- 0.13
223	Second	A	Hallway 11	Wall	Wood	FAIR	Clear / Stain		1.18	Negative	0.05 +/- 0.11
224	Second	D	Hallway 11	Wall	Wood	FAIR	Clear / Stain		1.55	Negative	0.1 +/- 0.18
225	Second	D	Hallway 11	Railing Cap	Wood	FAIR	Clear / Stain		1	Negative	0.05 +/- 0.1
226	Second	D	Hallway 11	Newel Post	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin				License #	P-00313			Job#	137259
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
227	Second	D	Hallway 11	Baluster	Wood	FAIR	Clear / Stain		1.33	Negative	0.03 +/- 0.1
228	Second	B	Hallway 11	Cabinet casing	Wood	FAIR	Clear / Stain		1	Negative	0.04 +/- 0.09
229	Second	B	Hallway 11	Cabinet Door	Wood	FAIR	Clear / Stain		2.08	Negative	0.02 +/- 0.11
230	Second	B	Hallway 11	Drawer	Wood	FAIR	Clear / Stain		1.02	Negative	0.06 +/- 0.11
231	Second	B	Hallway 11	Cabinet Shelf	Wood	FAIR	Green		2.26	Negative	0.4 +/- 0.2
232	Second	B	Hallway 11	Shelf Bracket	Wood	FAIR	Green		2.26	Positive	2.3 +/- 0.8
233	Second	B	Hallway 11	Cabinet In	Plaster	POOR	Green		1	Negative	0 +/- 0.02
234	Second	A	Hallway 11	Wall	Plaster	POOR	White		6.24	Positive	1.7 +/- 0.5
235	Second	B	Hallway 11	Wall	Plaster	POOR	White		6.52	Positive	3.5 +/- 1.9
236	Second	C	Hallway 11	Wall	Plaster	POOR	White		7.65	Positive	3.6 +/- 2.2
237	Second	D	Hallway 11	Wall	Plaster	POOR	White		5.21	Positive	3.4 +/- 2.3
238	Second	Ceiling	Hallway 11	Ceiling	Plaster	POOR	White		7.44	Positive	3.4 +/- 2.1
239	Second	A	Bathroom 12	Wall	Plaster	POOR	Blue		10	Positive	6.5 +/- 3.9
240	Second	B	Bathroom 12	Wall	Plaster	POOR	Blue		7.62	Positive	3.9 +/- 2.3
241	Second	C	Bathroom 12	Wall	Plaster	POOR	Blue		4.4	Positive	4.4 +/- 3.4
242	Second	D	Bathroom 12	Wall	Plaster	POOR	Blue		1.64	Positive	3.8 +/- 2.6
243	Second	Ceiling	Bathroom 12	Ceiling	Plaster	POOR	Blue		1	Positive	5.6 +/- 3.8
244	Second	A	Bathroom 12	Clos. Casing	Wood	FAIR	Blue		9.41	Positive	7 +/- 3.5
245	Second	A	Bathroom 12	Clos. Jamb	Wood	FAIR	Blue		3.34	Negative	0.8 +/- 0.2
246	Second	A	Bathroom 12	Clos. Jamb	Wood	FAIR	Blue		10	Positive	3.8 +/- 2.3
247	Second	A	Bathroom 12	Clos. Door	Wood	FAIR	Blue		4.35	Negative	0.07 +/- 0.3
248	Second	A	Bathroom 12	Clos. Door	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
249	Second	A	Bathroom 12	Chair Rail	Wood	FAIR	Blue		5.61	Positive	5.2 +/- 3.3
250	Second	A	Bathroom 12	Med. Cabinet out	Wood	FAIR	Blue		10	Positive	6 +/- 3.4
251	Second	A	Bathroom 12	Cabinet Door	Wood	FAIR	Blue		10	Positive	5.9 +/- 3.2
252	Second	A	Bathroom 12	Cabinet In	Wood	POOR	White		10	Positive	7 +/- 3.6
253	Second	A	Bathroom 12	Cabinet Shelf	Wood	POOR	White		10	Positive	6.9 +/- 3.5
254	Second	B	Bathroom 12	Laundry Chute Casing	Wood	POOR	Blue		6.46	Positive	6.1 +/- 3.3
255	Second	B	Bathroom 12	Laundry Chute Door	Wood	POOR	Blue		10	Positive	4.6 +/- 3.1
256	Second	B	Bathroom 12	Door Casing	Wood	POOR	Blue		7.38	Positive	7.3 +/- 3.8
257	Second	B	Bathroom 12	Door Jamb	Wood	POOR	Clear / Stain		1.52	Negative	0.07 +/- 0.16
258	Second	B	Bathroom 12	Door Jamb	Wood	POOR	Clear / Stain		1.1	Negative	0.06 +/- 0.12
259	Second	B	Bathroom 12	Door	Wood	POOR	Clear / Stain		1	Negative	0.04 +/- 0.1
260	Second	C	Bathroom 12	Baseboard	Wood	POOR	Blue		10	Positive	6.5 +/- 3.5
261	Second	C	Bathroom 12	Win. Apron	Wood	POOR	Blue		10	Positive	8.3 +/- 4
262	Second	C	Bathroom 12	Win. Sill/Stool	Wood	POOR	Blue		4.55	Positive	6.8 +/- 3.6
263	Second	C	Bathroom 12	Win. Casing	Wood	POOR	Blue		8.26	Positive	8.4 +/- 4

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
264	Second	C	Bathroom 12	Win. Sash	Wood	POOR	Blue		10	Positive	8.3 +/- 3.8
265	Second	C	Bathroom 12	Partition	Drywall	POOR	Blue		1	Negative	0 +/- 0.02
266	Second	C	Bathroom 12	Bathtub	Metal	POOR	White		1.74	Positive	3.5 +/- 2.2
267	Second	D	Bathroom 12	Win. Sash, ext.	Wood	POOR	White		5.13	Positive	24.5 +/- 15.2
268	Second	D	Bathroom 12	Win. Well/Trough	Wood	POOR	White		3.14	Positive	20.8 +/- 13.6
269	Second	D	Bathroom 12	Win. Jamb	Wood	POOR	White		4.47	Positive	22.3 +/- 14.3
270	Second	Ceiling	Bedroom 13	Ceiling	Plaster	POOR	Blue		9.67	Negative	0.04 +/- 0.82
271	Second	A	Bedroom 13	Wall	Plaster	POOR	Blue		5.88	Negative	0.4 +/- 0.6
272	Second	B	Bedroom 13	Wall	Plaster	POOR	Blue		3.54	Negative	0.09 +/- 0.17
273	Second	C	Bedroom 13	Wall	Plaster	POOR	Blue		2.51	Negative	0.01 +/- 0.05
274	Second	D	Bedroom 13	Wall	Plaster	POOR	Blue		7.97	Negative	0.15 +/- 0.15
275	Second	D	Bedroom 13	Baseboard	Wood	POOR	Blue		10	Positive	8 +/- 3.8
276	Second	A	Bedroom 13	Win. Apron	Wood	POOR	Blue		10	Positive	5.5 +/- 3.3
277	Second	A	Bedroom 13	Win. Sill/Stool	Wood	POOR	Blue		10	Positive	5.3 +/- 3.2
278	Second	A	Bedroom 13	Win. Casing	Wood	POOR	Blue		10	Positive	8.2 +/- 3.8
279	Second	A	Bedroom 13	Win. Sash	Wood	POOR	Blue		10	Positive	9.1 +/- 4.1
280	Second	A	Bedroom 13	Win. Sash, ext.	Wood	POOR	Blue		10	Positive	6.1 +/- 3.5
281	Second	A	Bedroom 13	Win. Well/Trough	Wood	POOR	Blue		3.16	Positive	25.1 +/- 15.3
282	Second	A	Bedroom 13	Win. Jamb	Wood	POOR	Blue		3.33	Positive	27 +/- 16.6
283	Second	B	Bedroom 13	Door Casing	Wood	POOR	Blue		10	Positive	3 +/- 1.9
284	Second	B	Bedroom 13	Door	Wood	POOR	Blue		2.06	Negative	0.02 +/- 0.09
285	Second	B	Bedroom 13	Door	Wood	POOR	Clear / Stain		1	Negative	0.03 +/- 0.09
286	Second	B	Bedroom 13	Door Stop	Wood	POOR	Clear / Stain		1	Negative	0.04 +/- 0.1
287	Second	B	Bedroom 13	Door Jamb	Wood	POOR	Clear / Stain		1	Negative	0.03 +/- 0.08
288	Second	C	Bedroom 13	Clos. Casing	Wood	POOR	Blue		10	Positive	5.2 +/- 3.3
289	Second	C	Bedroom 13	Clos. Jamb	Wood	POOR	Blue		9.56	Positive	6.6 +/- 3.3
290	Second	C	Bedroom 13	Clos. Stop	Wood	POOR	Blue		3.68	Positive	1.9 +/- 0.8
291	Second	C	Bedroom 13	Clos. Casing in.	Wood	POOR	Blue		7.05	Positive	4.2 +/- 2.7
292	Second	C	Bedroom 13	Clos. Door	Wood	FAIR	Blue		7.49	Negative	0.18 +/- 0.66
293	Second	C	Bedroom 13	Clos. Baseboard	Wood	FAIR	Blue		10	Positive	4.6 +/- 3
294	Second	C	Bedroom 13	Clos. Shelf	Wood	FAIR	Blue		5.53	Positive	2.4 +/- 1.4
295	Second	C	Bedroom 13	Shelf Brackets	Wood	FAIR	Blue		7.76	Positive	6.3 +/- 3.3
296	Second	C	Bedroom 13	Clothes Rod	Wood	FAIR	Blue		2.25	Negative	0.03 +/- 0.13
297	Second	C	Bedroom 13	Clos. Wall	Plaster	FAIR	Blue		3.32	Positive	3.2 +/- 2
298	Second	C	Bedroom 13	Clos. Ceiling	Plaster	FAIR	Blue		3.44	Positive	2.3 +/- 1
299	Second	Floor	Bedroom 13	Floor	Wood	POOR	Clear / Stain		1	Negative	0 +/- 0.02
300	Second	Floor	Upper Entry 14	Floor	Wood	POOR	Clear / Stain		1	Negative	0 +/- 0.04

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
301	Second	A	Upper Entry 14	Wall	Plaster	POOR	White		4.18	Negative	0.7 +/- 0.1
302	Second	B	Upper Entry 14	Wall	Plaster	POOR	White		3.39	Negative	0.7 +/- 0.1
303	Second	C	Upper Entry 14	Wall	Plaster	POOR	White		4.25	Negative	0.7 +/- 0.1
304	Second	D	Upper Entry 14	Wall	Plaster	POOR	White		3.2	Negative	0.5 +/- 0.5
305	Second	Ceiling	Upper Entry 14	Ceiling	Plaster	POOR	White		4.22	Negative	0.5 +/- 0.1
306	Second	C	Upper Entry 14	Baseboard	Wood	FAIR	Clear / Stain		1.37	Negative	0.06 +/- 0.14
307	Second	C	Upper Entry 14	Door Casing	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
308	Second	C	Upper Entry 14	Door Jamb	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
309	Second	C	Upper Entry 14	Door Stop	Wood	FAIR	Clear / Stain		1.08	Negative	0.03 +/- 0.09
310	Second	C	Upper Entry 14	Door	Wood	FAIR	Clear / Stain		1	Negative	0.01 +/- 0.05
311	Second	B	Upper Entry 14	Wall Register	Metal	POOR	White		2.72	Negative	0.04 +/- 0.18
312	Second	A	Upper Entry 14	Entry door	Wood	POOR	White		3.05	Positive	17.4 +/- 12
313	Second	A	Upper Entry 14	Door Jamb	Wood	POOR	White		3.58	Positive	25.6 +/- 15.9
314	Second	A	Upper Entry 14	Door Threshold	Wood	POOR	White		3.52	Positive	23.3 +/- 14.6
315	Exterior	A	Ext. House 22	Ext. Soffit	Metal	FAIR	Grey		1.96	Negative	0.01 +/- 0.02
316	Exterior	A	Ext. House 22	Wall	Metal	FAIR	Grey		1.38	Negative	0.01 +/- 0.02
317	Exterior	A	Ext. House 22	Ext. Fascia	Metal	FAIR	Grey		10	Positive	11.7 +/- 10.6
318	Exterior	A	Ext. House 22	Ext. Gutter	Metal	POOR	Grey		4.85	Negative	0.07 +/- 0.05
319	Exterior	A	Ext. House 22	Door Casing	Wood	POOR	Blue		2.83	Positive	16.5 +/- 12.2
320	Exterior	A	Ext. House 22	Win. Sill/Stool	Wood	POOR	Blue		2.37	Positive	19.9 +/- 13.4
321	Exterior	A	Ext. House 22	Win. Casing	Wood	POOR	Blue		3.59	Positive	18.1 +/- 13.2
322	Exterior	A	Ext. House 22	Porch Rail Cap	Wood	POOR	Grey		1	Negative	0 +/- 0.04
323	Exterior	A	Ext. House 22	Baluster	Wood	POOR	Grey		1	Negative	0 +/- 0.03
324	Exterior	A	Ext. House 22	Joist ends	Wood	POOR	Grey		6.42	Positive	13.2 +/- 10.5
325	Exterior	A	Ext. House 22	Porch Beam	Wood	POOR	Grey		3.16	Positive	17.3 +/- 12.2
326	Second	A	Bedroom 15	Wall	Plaster	POOR	Beige		6.98	Negative	0.09 +/- 0.31
327	Second	B	Bedroom 15	Wall	Plaster	POOR	Beige		7.91	Negative	0.3 +/- 0.24
328	Second	C	Bedroom 15	Wall	Plaster	POOR	Beige		2.13	Negative	0.03 +/- 0.06
329	Second	D	Bedroom 15	Wall	Plaster	POOR	Beige		4.69	Negative	0.07 +/- 0.14
330	Second	Ceiling	Bedroom 15	Ceiling	Plaster	POOR	White		6.28	Negative	0.14 +/- 0.14
331	Second	D	Bedroom 15	Wall Register	Metal	POOR	Red		10	Negative	0.03 +/- 0.9
332	Second	D	Bedroom 15	Baseboard	Wood	POOR	Red		10	Positive	4.7 +/- 3
333	Second	D	Bedroom 15	Door Casing	Wood	POOR	Red		10	Positive	7.2 +/- 3.5
334	Second	D	Bedroom 15	Door Jamb	Wood	POOR	Clear / Stain		1	Negative	0.02 +/- 0.06
335	Second	D	Bedroom 15	Door Stop	Wood	POOR	Clear / Stain		1	Negative	0.02 +/- 0.07
336	Second	D	Bedroom 15	Door	Wood	POOR	Clear / Stain		1	Negative	0.04 +/- 0.1
337	Second	C	Bedroom 15	Clos. Door	Wood	POOR	Clear / Stain		1	Negative	0.03 +/- 0.08
338	Second	C	Bedroom 15	Clos. Casing	Wood	POOR	Red		10	Positive	6.1 +/- 3.3

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
339	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White		7.05	Positive	5.3 +/- 3.9
340	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White		3.1	Positive	2 +/- 0.8
341	Second	C	Bedroom 15	Clos. Casing in.	Wood	FAIR	White		5.27	Positive	6.4 +/- 3.3
342	Second	C	Bedroom 15	Clos. Baseboard	Wood	FAIR	White		8.69	Positive	7.6 +/- 3.7
343	Second	C	Bedroom 15	Shelf Bracket	Wood	FAIR	White		10	Positive	7.5 +/- 3.6
344	Second	C	Bedroom 15	Clos. Wall	Wood	POOR	White		3.42	Negative	0.07 +/- 0.14
345	Second	C	Bedroom 15	Clos. Ceiling	Wood	FAIR	Green		2.73	Positive	1.8 +/- 0.6
346	Second	A	Bedroom 15	Win. Apron	Wood	POOR	Red		10	Positive	5.9 +/- 3.4
347	Second	A	Bedroom 15	Win. Sill/Stool	Wood	POOR	Red		10	Positive	6 +/- 3.3
348	Second	A	Bedroom 15	Win. Casing	Wood	POOR	Red		10	Positive	5.8 +/- 3.3
349	Second	A	Bedroom 15	Win. Sash	Wood	POOR	Red		10	Positive	8.9 +/- 4
350	Second	A	Bedroom 15	Win. Sash, ext.	Wood	POOR	White		3.04	Positive	15.1 +/- 10.9
351	Second	A	Bedroom 15	Win. Jamb	Wood	POOR	White		5.54	Positive	17.4 +/- 12.4
352	Second	A	Bedroom 15	Win. Well/Trough	Wood	POOR	White		5.01	Positive	22.1 +/- 14.4
353	Second	Floor	Bedroom 15	Floor	Wood	POOR	Clear / Stain		2.4	Negative	0.02 +/- 0.13
354	Second	Floor	Bedroom 16	Floor	Wood	POOR	Clear / Stain		1	Negative	0.01 +/- 0.04
355	Second	A	Bedroom 16	Wall	Plaster	POOR	White		1.11	Negative	0.01 +/- 0.04
356	Second	A	Bedroom 16	Wall	Plaster	POOR	White		3.03	Negative	0.07 +/- 0.1
357	Second	B	Bedroom 16	Wall	Plaster	POOR	White		6.35	Negative	0.04 +/- 0.13
358	Second	C	Bedroom 16	Wall	Plaster	POOR	White		1.43	Negative	0.01 +/- 0.03
359	Second	D	Bedroom 16	Wall	Plaster	POOR	White		2.54	Negative	0.02 +/- 0.06
360	Second	Ceiling	Bedroom 16	Ceiling	Plaster	POOR	White		5.18	Negative	0.05 +/- 0.14
361	Second	D	Bedroom 16	Wall Register	Metal	POOR	White		6.26	Negative	0.09 +/- 0.2
362	Second	D	Bedroom 16	Baseboard	Wood	POOR	White		10	Positive	3.9 +/- 2.8
363	Second	D	Bedroom 16	Door Casing	Wood	POOR	White		9.65	Positive	3.7 +/- 2.7
364	Second	D	Bedroom 16	Door Jamb	Wood	POOR	Clear / Stain		1	Negative	0.02 +/- 0.06
365	Second	D	Bedroom 16	Door Stop	Wood	POOR	Clear / Stain		1	Negative	0.04 +/- 0.1
366	Second	D	Bedroom 16	Door	Wood	POOR	Clear / Stain		1.42	Negative	0.06 +/- 0.14
367	Second	C	Bedroom 16	Win. Apron	Wood	POOR	White		9.72	Positive	4.6 +/- 3.2
368	Second	C	Bedroom 16	Win. Sill/Stool	Wood	POOR	White		10	Positive	6.4 +/- 3.5
369	Second	C	Bedroom 16	Win. Casing	Wood	POOR	White		9.76	Positive	4.7 +/- 3.2
370	Second	C	Bedroom 16	Win. Sash	Wood	POOR	White		10	Positive	6.6 +/- 3.4
371	Second	C	Bedroom 16	Win. Sash, ext.	Wood	POOR	White		2.41	Positive	13.3 +/- 10.7
372	Second	C	Bedroom 16	Win. Well/Trough	Wood	POOR	White		6.24	Positive	24.8 +/- 15.4
373	Second	C	Bedroom 16	Win. Jamb	Wood	POOR	White		5.05	Positive	24.5 +/- 15.4
374	Second	A	Bedroom 16	Clos. Casing	Wood	POOR	White		10	Positive	4.8 +/- 3.1
375	Second	A	Bedroom 16	Clos. Jamb	Wood	POOR	White		10	Positive	5.4 +/- 3.3

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
376	Second	A	Bedroom 16	Clos. Stop	Wood	POOR	White		3.55	Positive	2 +/- 0.7
377	Second	A	Bedroom 16	Clos. Door	Wood	FAIR	White		2.07	Negative	0.04 +/- 0.15
378	Second	A	Bedroom 16	Clos. Door	Wood	FAIR	Clear / Stain		1.72	Negative	0.04 +/- 0.13
379	Second	A	Bedroom 16	Clos. Baseboard	Wood	FAIR	White		6.34	Positive	4.8 +/- 3.1
380	Second	A	Bedroom 16	Shelf Bracket	Wood	FAIR	White		10	Positive	11.1 +/- 4.5
381	Second	A	Bedroom 16	Clos. Wall	Plaster	POOR	White		3.9	Positive	2.7 +/- 1.2
382	Second	A	Bedroom 16	Clos. Ceiling	Plaster	FAIR	White		3.96	Positive	3 +/- 1.3
383	Second	A	Attic Stair 17	Wall	Plaster	FAIR	Green		1.03	Negative	0.04 +/- 0.06
384	Second	B	Attic Stair 17	Wall	Plaster	FAIR	Green		1.18	Negative	0.06 +/- 0.07
385	Second	C	Attic Stair 17	Wall	Plaster	FAIR	Green		1	Negative	0.03 +/- 0.04
386	Second	Ceiling	Attic Stair 17	Ceiling	Plaster	FAIR	Green		1.61	Negative	0.06 +/- 0.11
387	Second	A	Attic Stair 17	Door Casing	Wood	FAIR	Green		5.04	Positive	7.9 +/- 3.6
388	Second	A	Attic Stair 17	Door Jamb	Wood	FAIR	Green		4.58	Positive	5 +/- 3.3
389	Second	A	Attic Stair 17	Door Stop	Wood	POOR	Green		4.54	Positive	6.8 +/- 3.6
390	Second	A	Attic Stair 17	Door Jamb	Wood	FAIR	Clear / Stain		1	Negative	0.03 +/- 0.08
391	Second	A	Attic Stair 17	Door	Wood	FAIR	Clear / Stain		1.45	Negative	0.07 +/- 0.15
392	Second	B	Attic Stair 17	Railing	Wood	FAIR	Clear / Stain		1	Negative	0 +/- 0.03
393	Second	Floor	Attic Stair 17	Stair Tread	Wood	POOR	Clear / Stain		1.1	Negative	0.26 +/- 0.25
394	Second	Floor	Attic Stair 17	Stair Riser	Wood	POOR	Clear / Stain		1.27	Negative	0.7 +/- 0.3
395	Second	Floor	Attic Stair 17	Stair Riser	Wood	POOR	Green		1.59	Positive	2.1 +/- 1
396	Second	Floor	Attic Stair 17	Stair Tread	Wood	POOR	Green		1.55	Positive	4.4 +/- 2.7
397	Second	B	Attic Stair 17	Wall Casing	Wood	POOR	Green		1	Negative	0.09 +/- 0.14
398	Third	B	Attic 18	Wall	Wood	POOR	Green		1	Negative	0 +/- 0.03
399	Third	C	Attic 18	Wall	Wood	POOR	Green		1	Negative	0 +/- 0.02
400	Third	D	Attic 18	Wall	Wood	POOR	Green		1	Negative	0 +/- 0.02
401	Third	D	Attic 18	Ceiling	Wood	POOR	Green		1	Negative	0 +/- 0.02
402	Third	C	Attic 18	Win. Sash	Wood	POOR	White		1.26	Positive	2.6 +/- 1.6
403	Third	C	Attic 18	Win. Sash, ext.	Wood	POOR	White		3.46	Positive	18 +/- 13.2
404	Third	C	Attic 18	Win. Well/Trough	Wood	POOR	White		4.06	Positive	23.6 +/- 15.2
405	Third	C	Attic 18	Win. Jamb	Wood	POOR	White		4.98	Positive	25.3 +/- 15.3
406	Second	C	Basment Stair 19	Door Jamb	Wood	POOR	Green		10	Positive	6.6 +/- 3.6
407	Second	C	Basment Stair 19	Door Stop	Wood	POOR	Green		6.52	Positive	3.1 +/- 1.9
408	Second	C	Basment Stair 19	Door	Wood	POOR	Green		1	Negative	0.01 +/- 0.06
409	Second	C	Basment Stair 19	Door	Wood	POOR	Clear / Stain		1.29	Negative	0.05 +/- 0.12
410	Second	B	Basment Stair 19	Wall	Plaster	POOR	Green		2.28	Negative	0.06 +/- 0.11
411	Second	D	Basment Stair 19	Wall	Plaster	POOR	Green		3.41	Negative	0.12 +/- 0.19
412	Second	D	Basment Stair 19	Ceiling	Plaster	POOR	Green		2.29	Negative	0.05 +/- 0.12
413	Second	D	Basment Stair 19	Coat Rack	Plaster	POOR	Green		2.83	Negative	0.09 +/- 0.26

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
414	Second	D	Basment Stair 19	Railing	Wood	POOR	Clear / Stain		1	Negative	0.01 +/- 0.06
415	Second	C	Basment Stair 19	Door Casing	Wood	FAIR	Green		8.45	Positive	4.7 +/- 2.8
416	Second	A	Basment Stair 19	Shelf	Wood	POOR	Green		3.6	Positive	23.1 +/- 14.6
417	Second	D	Basment Stair 19	Stair Stringer	Wood	POOR	Grey		2.39	Positive	9.4 +/- 7.7
418	Second	D	Basment Stair 19	Stair Tread	Wood	POOR	Grey		1.01	Negative	0.03 +/- 0.08
419	Second	D	Basment Stair 19	Stair Tread	Wood	POOR	Grey		3.78	Negative	0.24 +/- 0.3
420	Second	D	Basment Stair 19	Stair Tread	Wood	POOR	Green		1	Negative	0.03 +/- 0.08
421	Second	A	Basement 20	Wall	Cinder Block	POOR	White		1	Negative	0 +/- 0.02
422	Second	B	Basement 20	Wall	Cinder Block	POOR	White		2.79	Negative	0.05 +/- 0.04
423	Second	B	Basement 20	Wall	Wood	POOR	White		2.16	Negative	0.25 +/- 0.36
424	Second	C	Basement 20	Wall	Cinder Block	POOR	White		1	Negative	0.01 +/- 0.02
425	Second	D	Basement 20	Wall	Cinder Block	POOR	White		1.31	Negative	0 +/- 0.02
426	Second	D	Basement 20	Win. Sash	Wood	POOR	Grey		1.98	Positive	13.6 +/- 10.8
427	Second	Center	Basement 20	Support Pole	Brick	POOR	Green		1.24	Negative	0.24 +/- 0.06
428	Second	Center	Basement 20	Support Pole	Metal	POOR	Green		1.08	Negative	0.16 +/- 0.13
429	Second	Center	Basement 20	Support Pole	Metal	POOR	Silver		1.76	Negative	0.08 +/- 0.18
430	Second	Center	Basement 20	Floor	Metal	POOR	Grey		1.61	Negative	0.07 +/- 0.07
431	Second	A	Basement 21	Wall	Wood	POOR	Yellow		1.2	Negative	0.01 +/- 0.07
432	Second	B	Basement 21	Wall	Cinder Block	POOR	White		2.38	Negative	0.05 +/- 0.05
433	Second	C	Basement 21	Wall	Cinder Block	POOR	Yellow		1.07	Negative	0.01 +/- 0.02
434	Second	D	Basement 21	Wall	Wood	POOR	White		1.03	Negative	0.02 +/- 0.07
435	Second	D	Basement 21	Door	Wood	POOR	White		1.17	Negative	0.11 +/- 0.16
436	Second	D	Basement 21	Door	Wood	POOR	White		2.01	Negative	0.18 +/- 0.3
437	Second	D	Basement 21	Door	Wood	POOR	White		1	Negative	0.07 +/- 0.12
438	Second	A	Basement 21	Bookcase Shelf	Wood	POOR	Yellow		1	Negative	0 +/- 0.03
439	Second	A	Basement 21	Bookcase Shelf	Wood	POOR	Yellow		2.04	Negative	0.03 +/- 0.13
440	Second	A	Basement 21	Clos. Door	Wood	POOR	Yellow		1.76	Negative	0.02 +/- 0.09
441	Second	A	Basement 21	Clos. Door	Wood	POOR	Yellow		2.57	Negative	0.02 +/- 0.12
442	Second	A	Basement 21	Clos. Door	Wood	POOR	Yellow		1	Negative	0 +/- 0.03
443	Second	A	Basement 21	Clos. Door	Wood	POOR	Yellow		1	Negative	0 +/- 0.03
444	Second	B	Basement 21	Win. Sash	Wood	POOR	Grey		1.92	Positive	6.8 +/- 4.4
445	Exterior	A	Ext. House 22	Wall	Wood	POOR	Grey		10	Positive	7.2 +/- 3.7
446	Exterior	A	Ext. House 22	Porch Column	Wood	POOR	Grey		3.72	Positive	18 +/- 12.4
447	Exterior	A	Ext. House 22	Crown Molding	Wood	POOR	Grey		2.9	Positive	12.3 +/- 10.4
448	Exterior	A	Ext. House 22	Trim	Wood	POOR	Grey		8.81	Positive	10.1 +/- 4.4
449	Exterior	A	Ext. House 22	Wall	Metal	POOR	Grey		1	Negative	0.01 +/- 0.02
450	Exterior	A	Ext. House 22	Win. Sill/Stool	Wood	POOR	Blue		4.56	Positive	19.7 +/- 13.5
451	Exterior	A	Ext. House 22	Win. Casing	Wood	POOR	Blue		10	Positive	10 +/- 8.6

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
452	Exterior	A	Ext. House 22	Win. Sash, ext.	Wood	POOR	White		5.44	Positive	5.4 +/- 3.2
453	Exterior	D	Ext. House 22	Wall	Metal	POOR	White		1.15	Negative	0.01 +/- 0.02
454	Exterior	D	Ext. House 22	Win. Casing	Wood	POOR	White		3.33	Positive	21.8 +/- 14.2
455	Exterior	D	Ext. House 22	Win. Sill/Stool	Wood	POOR	White		3.6	Positive	18.4 +/- 13
456	Exterior	B	Ext. House 22	Wall	Metal	POOR	Grey		2.11	Negative	0.01 +/- 0.02
457	Exterior	B	Ext. House 22	Coal Door	Metal	POOR	Blue		1.46	Positive	1.4 +/- 0.4
458	Exterior	C	Ext. House 22	Wall	Metal	POOR	Grey		2.06	Negative	0.01 +/- 0.02
459	Exterior	C	Ext. House 22	Stair Tread	Concrete	POOR	White		1	Negative	0.02 +/- 0.02
460	Exterior	A	Ext. Garage 23	Wall	Stucco	POOR	Grey		5.77	Negative	0.08 +/- 0.08
461	Exterior	A	Ext. Garage 23	Wall	Wood	POOR	Grey		10	Positive	5.6 +/- 3.4
462	Exterior	C	Ext. Garage 23	Wall	Stucco	POOR	White		1	Negative	0 +/- 0.02
463	Exterior	D	Ext. Garage 23	Wall	Stucco	POOR	White		1	Negative	0 +/- 0.02
464	Exterior	D	Ext. Garage 23	Ext. Downspout	Metal	POOR	White		2.09	Negative	0.3 +/- 0.43
465	Exterior	C	Ext. Garage 23	Wall	Wood	POOR	Grey		1	Negative	0 +/- 0.03
466	Exterior	D	Ext. Garage 23	Wall	Wood	POOR	Grey		4.62	Negative	0.03 +/- 0.19
467	Exterior	A	Ext. Garage 23	Wall	Wood	POOR	Grey		1	Negative	0 +/- 0.02
468	Exterior	D	Ext. Garage 23	Wall	Stucco	POOR	Grey		2.5	Negative	0.06 +/- 0.04
469	Exterior	D	Ext. Garage 23	Win. Casing	Wood	POOR	Blue		1.45	Positive	1.5 +/- 0.4
470	Exterior	D	Ext. Garage 23	Win. Sill/Stool	Wood	POOR	Blue		3.22	Positive	21.7 +/- 14.5
471	Exterior	D	Ext. Garage 23	Win. Sash, ext.	Wood	POOR	White		1.58	Positive	1.9 +/- 0.7
472	Exterior	D	Ext. Garage 23	Win. Well/Trough	Wood	POOR	White		1.35	Positive	2.2 +/- 1
473	Exterior	D	Ext. Garage 23	Win. Jamb	Wood	POOR	White		2.18	Positive	10.2 +/- 9.1
474	Exterior	A	Ext. Garage 23	Ext. Soffit	Stucco	POOR	Grey		2.43	Negative	0.4 +/- 0.6
475	Exterior	A	Ext. Garage 23	Ext. Fascia	Wood	POOR	Blue		3.01	Positive	11.2 +/- 9.6
476	Exterior	A	Ext. Garage 23	Crown Molding	Wood	POOR	Blue		2.23	Positive	10.5 +/- 9.3
477	Exterior	A	Ext. Garage 23	Door Casing	Wood	POOR	Blue		4	Negative	0.5 +/- 0.4
478	Exterior	A	Ext. Garage 23	Door Jamb	Wood	POOR	Blue		6.83	Negative	0.11 +/- 0.46
479	Exterior	A	Ext. Garage 23	Door	Fiberglass	POOR	Blue		1.22	Negative	0.01 +/- 0.03
480	Exterior	B	Int. Garage 23	Wall	Drywall	POOR	White		1.05	Negative	0.01 +/- 0.02
481	Exterior	C	Int. Garage 23	Wall	Drywall	POOR	White		1	Negative	0 +/- 0.02
482	Exterior	D	Int. Garage 23	Wall	Wood	POOR	White		1	Negative	0 +/- 0.03
483	Exterior	D	Int. Garage 23	Cabinet Out	Wood	POOR	White		1.29	Negative	0.01 +/- 0.05
484	Exterior	D	Int. Garage 23	Cabinet Door	Wood	POOR	White		1	Negative	0 +/- 0.02
485	Exterior	D	Int. Garage 23	Win. Casing	Wood	POOR	White		1	Negative	0.01 +/- 0.04
486	Exterior	D	Int. Garage 23	Win. Sash	Wood	POOR	White		1.64	Positive	6.6 +/- 4.1
487	Exterior	C	Int. Garage 23	Support Pole	Metal	POOR	White		1	Negative	0 +/- 0.03
488	Exterior	C	Int. Shed 24	Wall	Stucco	POOR	White		1.62	Negative	0.03 +/- 0.02
489	Exterior	C	Int. Shed 24	Wall	Wood	POOR	White		1	Negative	0 +/- 0.02

ETC - Environmental Services WILCO Environmental

APPENDIX A

All Paint Samples Taken - In Order Sampled

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Graviin			License #	P-00313			Job#	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
490	Exterior	D	Int. Shed 24	Wall	Wood	POOR	White		1	Negative	0 +/- 0.02
491	Exterior	D	Grounds 25	Doghouse	Wood	POOR	Grey		1.33	Negative	0.04 +/- 0.11
492	Exterior	D	Grounds 25	Fence	Wood	POOR	Grey		1	Negative	0 +/- 0.02
493	Exterior	D	Grounds 25	Planter	Transite	POOR	Grey		1	Negative	0 +/- 0.02
494	Exterior	D	Grounds 25	Light Fixture	Metal	POOR	Black		1	Negative	0 +/- 0.03
495	Exterior	D	Grounds 25	Railing	Metal	POOR	Black		1	Negative	0 +/- 0.02
496	Exterior	D	Grounds 25	Railing	Metal	POOR	Black		1	Negative	0.03 +/- 0.07
497			CALIBRATE						1.07	Positive	1 +/- 0.1
498			CALIBRATE						2.76	Positive	1.1 +/- 0.1
499			CALIBRATE						2.75	Positive	1.1 +/- 0.1
500	First	All	Kitchen 9	Win. Sash, ext.	Wood	POOR	Blue			Positive	Presumed +/-
501	First	All	Kitchen 9	Win. Well/Trough	Wood	POOR	Blue			Positive	Presumed +/-
502	First	All	Kitchen 9	Win. Jamb	Wood	POOR	Blue			Positive	Presumed +/-

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravlin			License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
16	First	A	Dining Room 1	Win. Sash, ext.	Wood	POOR	White	0	1.4	Positive	1.2 +/- 0.2
17	First	A	Dining Room 1	Win. Well/Trough	Wood	POOR	White	0	3.9	Positive	27 +/- 16.7
18	First	A	Dining Room 1	Win. Jamb	Wood	POOR	White	0	3.84	Positive	18.1 +/- 12.9
19	First	A	Dining Room 1	Ext. Win. Storm/Screen	Wood	POOR	White	0	4.26	Positive	9.9 +/- 8.5
29	First	C	Dining Room 1	Door Jamb	Wood	POOR	Green	0	7.33	Positive	7 +/- 3.6
31	First	A	Enclosed Porch 2	Knee Wall	Wood	POOR	Clear / Stain	0	1.85	Positive	3.2 +/- 1.6
32	First	B	Enclosed Porch 2	Knee Wall	Wood	POOR	Clear / Stain	0	6.2	Positive	8.5 +/- 4
34	First	D	Enclosed Porch 2	Knee Wall	Wood	POOR	White	0	2.42	Positive	4.4 +/- 3.4
35	First	Ceiling	Enclosed Porch 2	Ceiling	Wood	POOR	White	0	5.82	Positive	7.9 +/- 3.8
36	First	Ceiling	Enclosed Porch 2	Joist	Wood	POOR	White	0	2.84	Positive	21 +/- 14.2
37	First	A	Enclosed Porch 2	Porch Column	Wood	POOR	White	0	5.47	Positive	22.1 +/- 13.8
38	First	A	Enclosed Porch 2	Trim	Wood	POOR	White	0	5.03	Positive	7.7 +/- 3.8
39	First	A	Enclosed Porch 2	Door Storm	Wood	POOR	White	0	5.95	Positive	8.8 +/- 4
40	First	A	Enclosed Porch 2	Door Storm	Wood	POOR	Grey	0	10	Positive	10.4 +/- 9
42	First	C	Enclosed Porch 2	Door Casing	Wood	POOR	White	0	10	Positive	17.7 +/- 12.6
53	First	A	Foyer 3	Door Jamb	Wood	POOR	White	0	3.17	Positive	17 +/- 12.3
54	First	A	Foyer 3	Door Threshold	Wood	POOR	Grey	0	2.2	Positive	18.1 +/- 13.2
70	First	B	Living Room 4	Win. Sash, ext.	Wood	POOR	White	0	2.94	Positive	15.6 +/- 11.7
71	First	B	Living Room 4	Win. Well/Trough	Wood	POOR	White	0	5.68	Positive	18.9 +/- 13
72	First	B	Living Room 4	Win. Jamb	Wood	POOR	White	0	3.32	Positive	22.9 +/- 14.3
73	First	B	Living Room 4	Ext. Win. Storm/Screen	Wood	POOR	White	0	3.77	Positive	4.6 +/- 3
92	First	C	Office 5	Win. Sash, ext.	Wood	POOR	White	0	1.35	Positive	1.1 +/- 0.1
93	First	C	Office 5	Win. Well/Trough	Wood	POOR	White	0	3.78	Positive	25.6 +/- 16.2
94	First	C	Office 5	Win. Jamb	Wood	POOR	White	0	4.02	Positive	19.7 +/- 13.7
95	First	C	Office 5	Ext. Win. Storm/Screen	Wood	POOR	White	0	6.62	Positive	10.9 +/- 8.8
110	First	A	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	1.8 +/- 0.8
111	First	B	Bathroom 6	Wall	Plaster	POOR	Green	0	10	Positive	1.9 +/- 0.8
112	First	C	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	2.4 +/- 1
113	First	D	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	4 +/- 2.4
114	First	Ceiling	Bathroom 6	Ceiling	Plaster	FAIR	Green	0	10	Positive	3.2 +/- 2.1
115	First	B	Bathroom 6	Baseboard	Wood	FAIR	Green	0	5.07	Positive	5.6 +/- 3.2
116	First	B	Bathroom 6	Door Casing	Wood	FAIR	Green	0	10	Positive	4.8 +/- 3.4
117	First	B	Bathroom 6	Door Jamb	Wood	FAIR	Green	0	10	Positive	7.2 +/- 3.6
118	First	B	Bathroom 6	Door Stop	Wood	FAIR	Green	0	4.34	Positive	2.7 +/- 1.7
120	First	C	Bathroom 6	Win. Apron	Wood	FAIR	Green	0	5.93	Positive	7.6 +/- 3.7
121	First	C	Bathroom 6	Win. Sill/Stool	Wood	FAIR	Green	0	6.79	Positive	6.6 +/- 3.6
122	First	C	Bathroom 6	Win. Casing	Wood	POOR	Green	0	10	Positive	7.3 +/- 3.8
123	First	C	Bathroom 6	Win. Sash	Wood	POOR	Green	0	10	Positive	6.5 +/- 3.5

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client			Genesee County Land Bank								
Survey Location:			841 E. 9th Street, Flint, MI 48503								
Survey Date:			06/14/11								
Inspectors:			Michael Gravlin		License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
124	First	C	Bathroom 6	Win. Sash, ext.	Wood	POOR	White	0	3.12	Positive	19.4 +/- 13.2
125	First	C	Bathroom 6	Win. Well/Trough	Wood	POOR	White	0	6.16	Positive	21.4 +/- 13.7
126	First	C	Bathroom 6	Win. Jamb	Wood	POOR	White	0	4.09	Positive	25.1 +/- 15.5
128	First	A	Bathroom 6	Sink In	Metal	POOR	White	0	2.46	Positive	29.3 +/- 18
129	First	A	Hallway 7	Wall	Plaster	POOR	Green	0	10	Positive	3.8 +/- 2.6
130	First	B	Hallway 7	Wall	Plaster	FAIR	Green	0	10	Positive	3.9 +/- 2.7
131	First	C	Hallway 7	Wall	Plaster	FAIR	Green	0	5.92	Positive	5.4 +/- 3.6
132	First	D	Hallway 7	Wall	Plaster	FAIR	Green	0	8.38	Positive	4.3 +/- 2.7
133	First	Ceiling	Hallway 7	Ceiling	Plaster	POOR	Green	0	9.43	Positive	5 +/- 3.4
134	First	B	Hallway 7	Baseboard	Wood	POOR	Green	0	5.34	Positive	3.9 +/- 2.3
135	First	C	Hallway 7	Baseboard	Wood	POOR	Green	0	5.48	Positive	3.8 +/- 2.3
136	First	C	Hallway 7	Door Stop	Wood	POOR	Blue	0	3.49	Positive	2.3 +/- 1.3
137	First	C	Hallway 7	Door Casing	Wood	POOR	Blue	0	9.77	Positive	15.6 +/- 11.6
140	First	Floor	Rear Entry 8	Floor	Wood	POOR	Blue	0	3.17	Positive	7.7 +/- 4
142	First	Ceiling	Rear Entry 8	Ceiling	Wood	FAIR	White	0	2	Positive	13.5 +/- 10.5
143	First	A	Rear Entry 8	Door Casing	Wood	POOR	Blue	0	10	Positive	17.6 +/- 12.3
144	First	A	Rear Entry 8	Door Threshold	Wood	POOR	Red	0	4.09	Positive	18.9 +/- 13
145	First	B	Rear Entry 8	Door Jamb	Wood	POOR	Grey	0	10	Positive	21.7 +/- 14
146	First	B	Rear Entry 8	Door Stop	Wood	POOR	Grey	0	7.76	Positive	22.5 +/- 14.4
148	First	B	Rear Entry 8	Door Storm	Wood	POOR	Grey	0	10	Positive	17.5 +/- 12.3
149	First	B	Rear Entry 8	Door Storm	Wood	POOR	White	0	10	Positive	19.5 +/- 13.6
150	First	C	Rear Entry 8	Win. Sill/Stool	Wood	POOR	White	0	9.48	Positive	19.4 +/- 13.1
151	First	C	Rear Entry 8	Win. Casing	Wood	POOR	White	0	6.8	Positive	16.6 +/- 12.6
152	First	C	Rear Entry 8	Win. Sash	Wood	POOR	White	0	6.64	Positive	11.7 +/- 10.1
153	First	C	Rear Entry 8	Win. Sash, ext.	Wood	POOR	White	0	2.84	Positive	17.3 +/- 12.6
154	First	D	Rear Entry 8	Clos. Casing	Wood	POOR	White	0	10	Positive	5.3 +/- 3.2
156	First	D	Rear Entry 8	Clos. Jamb	Wood	POOR	White	0	3.41	Positive	1.8 +/- 0.7
157	First	D	Rear Entry 8	Clos. Stop	Wood	POOR	White	0	3.54	Positive	3.7 +/- 2.1
158	First	D	Rear Entry 8	Clos. Door	Wood	POOR	White	0	6.15	Positive	2.7 +/- 1.4
159	First	D	Rear Entry 8	Clos. Shelf	Wood	POOR	White	0	1.98	Positive	11 +/- 9.4
160	First	D	Rear Entry 8	Shelf Brackets	Wood	POOR	White	0	2.35	Positive	11.9 +/- 9.4
161	First	D	Rear Entry 8	Shelf Brackets	Wood	POOR	Green	0	1.95	Positive	7.6 +/- 5.4
162	First	D	Rear Entry 8	Cabinet Shelf	Wood	POOR	Green	0	2.37	Positive	9.8 +/- 8.8
163	First	D	Rear Entry 8	Cabinet out	Wood	POOR	Green	0	2.45	Positive	8.1 +/- 6.4
164	First	D	Rear Entry 8	Cabinet in	Wood	POOR	Green	0	2.67	Positive	12.2 +/- 10
165	First	D	Rear Entry 8	Win. Apron	Wood	POOR	Green	0	3.22	Positive	7 +/- 3.5
166	First	D	Rear Entry 8	Win. Sill/Stool	Wood	POOR	Green	0	3.51	Positive	6 +/- 3.3
167	First	D	Rear Entry 8	Win. Casing	Wood	POOR	Green	0	2.42	Positive	2.5 +/- 1.4
168	First	D	Rear Entry 8	Win. Jamb	Wood	POOR	Green	0	2.74	Positive	21.7 +/- 14

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravlin			License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
169	First	D	Rear Entry 8	Win. Well/Trough	Wood	POOR	Green	0	3.32	Positive	21.9 +/- 14.2
170	First	D	Rear Entry 8	Ext. Win. Storm/Screen	Wood	POOR	Green	0	2.78	Positive	4.7 +/- 3.6
171	First	D	Rear Entry 8	Clos. Casing in.	Wood	POOR	Green	0	4.72	Positive	3.9 +/- 1.9
175	First	B	Kitchen 9	Wall	Plaster	POOR	Green	0	9.18	Positive	2.3 +/- 1
176	First	C	Kitchen 9	Wall	Plaster	POOR	Green	0	8.22	Positive	2.8 +/- 1.1
177	First	D	Kitchen 9	Wall	Plaster	POOR	Green	0	8.48	Positive	2.5 +/- 1.1
178	First	Ceiling	Kitchen 9	Ceiling	Plaster	POOR	Green	0	10	Positive	2.1 +/- 1
179	First	A	Kitchen 9	Baseboard	Wood	POOR	Green	0	4.02	Positive	4.2 +/- 3.1
181	First	A	Kitchen 9	Door Casing	Metal	POOR	Green	0	7.76	Positive	5.8 +/- 3.4
182	First	A	Kitchen 9	Laundry Chute Casing	Wood	POOR	Green	0	5.11	Positive	4.4 +/- 3
183	First	A	Kitchen 9	Laundry Chute Door	Wood	POOR	Green	0	10	Positive	4.6 +/- 3.1
184	First	A	Kitchen 9	Door Casing	Wood	POOR	Green	0	7.58	Positive	4.7 +/- 3.1
185	First	A	Kitchen 9	Door Jamb	Wood	POOR	Green	0	4.54	Positive	4.1 +/- 3
186	First	A	Kitchen 9	Door Stop	Wood	POOR	Green	0	4.72	Positive	1.5 +/- 0.5
187	First	C	Kitchen 9	Wall Casing	Wood	POOR	Green	0	4.43	Positive	5.2 +/- 3.2
188	First	C	Kitchen 9	Win. Apron	Wood	POOR	Green	0	10	Positive	4 +/- 2.4
189	First	C	Kitchen 9	Win. Sill/Stool	Wood	POOR	Green	0	10	Positive	4.5 +/- 3
190	First	C	Kitchen 9	Win. Casing	Wood	POOR	Green	0	10	Positive	2.7 +/- 1.6
191	First	C	Kitchen 9	Win. Sash	Wood	POOR	Green	0	2.5	Positive	7.8 +/- 4
192	First	D	Kitchen 9	Cabinet Out	Wood	POOR	Green	0	4.79	Positive	3.5 +/- 2.2
193	First	D	Kitchen 9	Drawer	Wood	POOR	Green	0	4.73	Positive	3.1 +/- 2
194	First	D	Kitchen 9	Cabinet Door	Wood	POOR	Green	0	7.61	Positive	3.9 +/- 2.2
195	First	D	Kitchen 9	Cabinet Shelf	Wood	POOR	White	0	4.15	Positive	3.2 +/- 2.2
196	First	D	Kitchen 9	Shelf Bracket	Wood	POOR	White	0	1.22	Positive	2.2 +/- 0.8
197	First	D	Kitchen 9	Cabinet In	Wood	POOR	White	0	5.47	Positive	4 +/- 2.8
200	First	Ceiling	Stair Up 10	Ceiling	Plaster	POOR	White	0	4.09	Positive	2.7 +/- 1.2
219	Second	C	Hallway 11	Win. Sash, ext.	Wood	POOR	White	0	3.27	Positive	11 +/- 9.5
220	Second	C	Hallway 11	Win. Well/Trough	Wood	POOR	White	0	7.74	Positive	26 +/- 16.1
221	Second	C	Hallway 11	Win. Jamb	Wood	POOR	White	0	2.76	Positive	13.9 +/- 10.6
232	Second	B	Hallway 11	Shelf Bracket	Wood	FAIR	Green	0	2.26	Positive	2.3 +/- 0.8
234	Second	A	Hallway 11	Wall	Plaster	POOR	White	0	6.24	Positive	1.7 +/- 0.5
235	Second	B	Hallway 11	Wall	Plaster	POOR	White	0	6.52	Positive	3.5 +/- 1.9
236	Second	C	Hallway 11	Wall	Plaster	POOR	White	0	7.65	Positive	3.6 +/- 2.2
237	Second	D	Hallway 11	Wall	Plaster	POOR	White	0	5.21	Positive	3.4 +/- 2.3
238	Second	Ceiling	Hallway 11	Ceiling	Plaster	POOR	White	0	7.44	Positive	3.4 +/- 2.1
239	Second	A	Bathroom 12	Wall	Plaster	POOR	Blue	0	10	Positive	6.5 +/- 3.9
240	Second	B	Bathroom 12	Wall	Plaster	POOR	Blue	0	7.62	Positive	3.9 +/- 2.3
241	Second	C	Bathroom 12	Wall	Plaster	POOR	Blue	0	4.4	Positive	4.4 +/- 3.4
242	Second	D	Bathroom 12	Wall	Plaster	POOR	Blue	0	1.64	Positive	3.8 +/- 2.6

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client			Genesee County Land Bank								
Survey Location:			841 E. 9th Street, Flint, MI 48503								
Survey Date:			06/14/11								
Inspectors:			Michael Gravlin		License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
243	Second	Ceiling	Bathroom 12	Ceiling	Plaster	POOR	Blue	0	1	Positive	5.6 +/- 3.8
244	Second	A	Bathroom 12	Clos. Casing	Wood	FAIR	Blue	0	9.41	Positive	7 +/- 3.5
246	Second	A	Bathroom 12	Clos. Jamb	Wood	FAIR	Blue	0	10	Positive	3.8 +/- 2.3
249	Second	A	Bathroom 12	Chair Rail	Wood	FAIR	Blue	0	5.61	Positive	5.2 +/- 3.3
250	Second	A	Bathroom 12	Med. Cabinet out	Wood	FAIR	Blue	0	10	Positive	6 +/- 3.4
251	Second	A	Bathroom 12	Cabinet Door	Wood	FAIR	Blue	0	10	Positive	5.9 +/- 3.2
252	Second	A	Bathroom 12	Cabinet In	Wood	POOR	White	0	10	Positive	7 +/- 3.6
253	Second	A	Bathroom 12	Cabinet Shelf	Wood	POOR	White	0	10	Positive	6.9 +/- 3.5
254	Second	B	Bathroom 12	Laundry Chute Casing	Wood	POOR	Blue	0	6.46	Positive	6.1 +/- 3.3
255	Second	B	Bathroom 12	Laundry Chute Door	Wood	POOR	Blue	0	10	Positive	4.6 +/- 3.1
256	Second	B	Bathroom 12	Door Casing	Wood	POOR	Blue	0	7.38	Positive	7.3 +/- 3.8
260	Second	C	Bathroom 12	Baseboard	Wood	POOR	Blue	0	10	Positive	6.5 +/- 3.5
261	Second	C	Bathroom 12	Win. Apron	Wood	POOR	Blue	0	10	Positive	8.3 +/- 4
262	Second	C	Bathroom 12	Win. Sill/Stool	Wood	POOR	Blue	0	4.55	Positive	6.8 +/- 3.6
263	Second	C	Bathroom 12	Win. Casing	Wood	POOR	Blue	0	8.26	Positive	8.4 +/- 4
264	Second	C	Bathroom 12	Win. Sash	Wood	POOR	Blue	0	10	Positive	8.3 +/- 3.8
266	Second	C	Bathroom 12	Bathtub	Metal	POOR	White	0	1.74	Positive	3.5 +/- 2.2
267	Second	D	Bathroom 12	Win. Sash, ext.	Wood	POOR	White	0	5.13	Positive	24.5 +/- 15.2
268	Second	D	Bathroom 12	Win. Well/Trough	Wood	POOR	White	0	3.14	Positive	20.8 +/- 13.6
269	Second	D	Bathroom 12	Win. Jamb	Wood	POOR	White	0	4.47	Positive	22.3 +/- 14.3
275	Second	D	Bedroom 13	Baseboard	Wood	POOR	Blue	0	10	Positive	8 +/- 3.8
276	Second	A	Bedroom 13	Win. Apron	Wood	POOR	Blue	0	10	Positive	5.5 +/- 3.3
277	Second	A	Bedroom 13	Win. Sill/Stool	Wood	POOR	Blue	0	10	Positive	5.3 +/- 3.2
278	Second	A	Bedroom 13	Win. Casing	Wood	POOR	Blue	0	10	Positive	8.2 +/- 3.8
279	Second	A	Bedroom 13	Win. Sash	Wood	POOR	Blue	0	10	Positive	9.1 +/- 4.1
280	Second	A	Bedroom 13	Win. Sash, ext.	Wood	POOR	Blue	0	10	Positive	6.1 +/- 3.5
281	Second	A	Bedroom 13	Win. Well/Trough	Wood	POOR	Blue	0	3.16	Positive	25.1 +/- 15.3
282	Second	A	Bedroom 13	Win. Jamb	Wood	POOR	Blue	0	3.33	Positive	27 +/- 16.6
283	Second	B	Bedroom 13	Door Casing	Wood	POOR	Blue	0	10	Positive	3 +/- 1.9
288	Second	C	Bedroom 13	Clos. Casing	Wood	POOR	Blue	0	10	Positive	5.2 +/- 3.3
289	Second	C	Bedroom 13	Clos. Jamb	Wood	POOR	Blue	0	9.56	Positive	6.6 +/- 3.3
290	Second	C	Bedroom 13	Clos. Stop	Wood	POOR	Blue	0	3.68	Positive	1.9 +/- 0.8
291	Second	C	Bedroom 13	Clos. Casing in.	Wood	POOR	Blue	0	7.05	Positive	4.2 +/- 2.7
293	Second	C	Bedroom 13	Clos. Baseboard	Wood	FAIR	Blue	0	10	Positive	4.6 +/- 3
294	Second	C	Bedroom 13	Clos. Shelf	Wood	FAIR	Blue	0	5.53	Positive	2.4 +/- 1.4
295	Second	C	Bedroom 13	Shelf Brackets	Wood	FAIR	Blue	0	7.76	Positive	6.3 +/- 3.3
297	Second	C	Bedroom 13	Clos. Wall	Plaster	FAIR	Blue	0	3.32	Positive	3.2 +/- 2
298	Second	C	Bedroom 13	Clos. Ceiling	Plaster	FAIR	Blue	0	3.44	Positive	2.3 +/- 1
312	Second	A	Upper Entry 14	Entry door	Wood	POOR	White	0	3.05	Positive	17.4 +/- 12

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client			Genesee County Land Bank								
Survey Location:			841 E. 9th Street, Flint, MI 48503								
Survey Date:			06/14/11								
Inspectors:			Michael Gravlin		License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
313	Second	A	Upper Entry 14	Door Jamb	Wood	POOR	White	0	3.58	Positive	25.6 +/- 15.9
314	Second	A	Upper Entry 14	Door Threshold	Wood	POOR	White	0	3.52	Positive	23.3 +/- 14.6
317	Exterior	A	Ext. House 22	Ext. Fascia	Metal	FAIR	Grey	0	10	Positive	11.7 +/- 10.6
319	Exterior	A	Ext. House 22	Door Casing	Wood	POOR	Blue	0	2.83	Positive	16.5 +/- 12.2
320	Exterior	A	Ext. House 22	Win. Sill/Stool	Wood	POOR	Blue	0	2.37	Positive	19.9 +/- 13.4
321	Exterior	A	Ext. House 22	Win. Casing	Wood	POOR	Blue	0	3.59	Positive	18.1 +/- 13.2
324	Exterior	A	Ext. House 22	Joist ends	Wood	POOR	Grey	0	6.42	Positive	13.2 +/- 10.5
325	Exterior	A	Ext. House 22	Porch Beam	Wood	POOR	Grey	0	3.16	Positive	17.3 +/- 12.2
332	Second	D	Bedroom 15	Baseboard	Wood	POOR	Red	0	10	Positive	4.7 +/- 3
333	Second	D	Bedroom 15	Door Casing	Wood	POOR	Red	0	10	Positive	7.2 +/- 3.5
338	Second	C	Bedroom 15	Clos. Casing	Wood	POOR	Red	0	10	Positive	6.1 +/- 3.3
339	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White	0	7.05	Positive	5.3 +/- 3.9
340	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White	0	3.1	Positive	2 +/- 0.8
341	Second	C	Bedroom 15	Clos. Casing in.	Wood	FAIR	White	0	5.27	Positive	6.4 +/- 3.3
342	Second	C	Bedroom 15	Clos. Baseboard	Wood	FAIR	White	0	8.69	Positive	7.6 +/- 3.7
343	Second	C	Bedroom 15	Shelf Bracket	Wood	FAIR	White	0	10	Positive	7.5 +/- 3.6
345	Second	C	Bedroom 15	Clos. Ceiling	Wood	FAIR	Green	0	2.73	Positive	1.8 +/- 0.6
346	Second	A	Bedroom 15	Win. Apron	Wood	POOR	Red	0	10	Positive	5.9 +/- 3.4
347	Second	A	Bedroom 15	Win. Sill/Stool	Wood	POOR	Red	0	10	Positive	6 +/- 3.3
348	Second	A	Bedroom 15	Win. Casing	Wood	POOR	Red	0	10	Positive	5.8 +/- 3.3
349	Second	A	Bedroom 15	Win. Sash	Wood	POOR	Red	0	10	Positive	8.9 +/- 4
350	Second	A	Bedroom 15	Win. Sash, ext.	Wood	POOR	White	0	3.04	Positive	15.1 +/- 10.9
351	Second	A	Bedroom 15	Win. Jamb	Wood	POOR	White	0	5.54	Positive	17.4 +/- 12.4
352	Second	A	Bedroom 15	Win. Well/Trough	Wood	POOR	White	0	5.01	Positive	22.1 +/- 14.4
362	Second	D	Bedroom 16	Baseboard	Wood	POOR	White	0	10	Positive	3.9 +/- 2.8
363	Second	D	Bedroom 16	Door Casing	Wood	POOR	White	0	9.65	Positive	3.7 +/- 2.7
367	Second	C	Bedroom 16	Win. Apron	Wood	POOR	White	0	9.72	Positive	4.6 +/- 3.2
368	Second	C	Bedroom 16	Win. Sill/Stool	Wood	POOR	White	0	10	Positive	6.4 +/- 3.5
369	Second	C	Bedroom 16	Win. Casing	Wood	POOR	White	0	9.76	Positive	4.7 +/- 3.2
370	Second	C	Bedroom 16	Win. Sash	Wood	POOR	White	0	10	Positive	6.6 +/- 3.4
371	Second	C	Bedroom 16	Win. Sash, ext.	Wood	POOR	White	0	2.41	Positive	13.3 +/- 10.7
372	Second	C	Bedroom 16	Win. Well/Trough	Wood	POOR	White	0	6.24	Positive	24.8 +/- 15.4
373	Second	C	Bedroom 16	Win. Jamb	Wood	POOR	White	0	5.05	Positive	24.5 +/- 15.4
374	Second	A	Bedroom 16	Clos. Casing	Wood	POOR	White	0	10	Positive	4.8 +/- 3.1
375	Second	A	Bedroom 16	Clos. Jamb	Wood	POOR	White	0	10	Positive	5.4 +/- 3.3
376	Second	A	Bedroom 16	Clos. Stop	Wood	POOR	White	0	3.55	Positive	2 +/- 0.7
379	Second	A	Bedroom 16	Clos. Baseboard	Wood	FAIR	White	0	6.34	Positive	4.8 +/- 3.1
380	Second	A	Bedroom 16	Shelf Bracket	Wood	FAIR	White	0	10	Positive	11.1 +/- 4.5
381	Second	A	Bedroom 16	Clos. Wall	Plaster	POOR	White	0	3.9	Positive	2.7 +/- 1.2

ETC - Environmental Services WILCO Environmental

APPENDIX B

Lead Paint ONLY Samples - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravlin			License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/cm ² +/- Precision
382	Second	A	Bedroom 16	Clos. Ceiling	Plaster	FAIR	White	0	3.96	Positive	3 +/- 1.3
387	Second	A	Attic Stair 17	Door Casing	Wood	FAIR	Green	0	5.04	Positive	7.9 +/- 3.6
388	Second	A	Attic Stair 17	Door Jamb	Wood	FAIR	Green	0	4.58	Positive	5 +/- 3.3
389	Second	A	Attic Stair 17	Door Stop	Wood	POOR	Green	0	4.54	Positive	6.8 +/- 3.6
395	Second	Floor	Attic Stair 17	Stair Riser	Wood	POOR	Green	0	1.59	Positive	2.1 +/- 1
396	Second	Floor	Attic Stair 17	Stair Tread	Wood	POOR	Green	0	1.55	Positive	4.4 +/- 2.7
402	Third	C	Attic 18	Win. Sash	Wood	POOR	White	0	1.26	Positive	2.6 +/- 1.6
403	Third	C	Attic 18	Win. Sash, ext.	Wood	POOR	White	0	3.46	Positive	18 +/- 13.2
404	Third	C	Attic 18	Win. Well/Trough	Wood	POOR	White	0	4.06	Positive	23.6 +/- 15.2
405	Third	C	Attic 18	Win. Jamb	Wood	POOR	White	0	4.98	Positive	25.3 +/- 15.3
406	Second	C	Basment Stair 19	Door Jamb	Wood	POOR	Green	0	10	Positive	6.6 +/- 3.6
407	Second	C	Basment Stair 19	Door Stop	Wood	POOR	Green	0	6.52	Positive	3.1 +/- 1.9
415	Second	C	Basment Stair 19	Door Casing	Wood	FAIR	Green	0	8.45	Positive	4.7 +/- 2.8
416	Second	A	Basment Stair 19	Shelf	Wood	POOR	Green	0	3.6	Positive	23.1 +/- 14.6
417	Second	D	Basment Stair 19	Stair Stringer	Wood	POOR	Grey	0	2.39	Positive	9.4 +/- 7.7
426	Second	D	Basement 20	Win. Sash	Wood	POOR	Grey	0	1.98	Positive	13.6 +/- 10.8
444	Second	B	Basement 21	Win. Sash	Wood	POOR	Grey	0	1.92	Positive	6.8 +/- 4.4
445	Exterior	A	Ext. House 22	Wall	Wood	POOR	Grey	0	10	Positive	7.2 +/- 3.7
446	Exterior	A	Ext. House 22	Porch Column	Wood	POOR	Grey	0	3.72	Positive	18 +/- 12.4
447	Exterior	A	Ext. House 22	Crown Molding	Wood	POOR	Grey	0	2.9	Positive	12.3 +/- 10.4
448	Exterior	A	Ext. House 22	Trim	Wood	POOR	Grey	0	8.81	Positive	10.1 +/- 4.4
450	Exterior	A	Ext. House 22	Win. Sill/Stool	Wood	POOR	Blue	0	4.56	Positive	19.7 +/- 13.5
451	Exterior	A	Ext. House 22	Win. Casing	Wood	POOR	Blue	0	10	Positive	10 +/- 8.6
452	Exterior	A	Ext. House 22	Win. Sash, ext.	Wood	POOR	White	0	5.44	Positive	5.4 +/- 3.2
454	Exterior	D	Ext. House 22	Win. Casing	Wood	POOR	White	0	3.33	Positive	21.8 +/- 14.2
455	Exterior	D	Ext. House 22	Win. Sill/Stool	Wood	POOR	White	0	3.6	Positive	18.4 +/- 13
457	Exterior	B	Ext. House 22	Coal Door	Metal	POOR	Blue	0	1.46	Positive	1.4 +/- 0.4
461	Exterior	A	Ext. Garage 23	Wall	Wood	POOR	Grey	0	10	Positive	5.6 +/- 3.4
469	Exterior	D	Ext. Garage 23	Win. Casing	Wood	POOR	Blue	0	1.45	Positive	1.5 +/- 0.4
470	Exterior	D	Ext. Garage 23	Win. Sill/Stool	Wood	POOR	Blue	0	3.22	Positive	21.7 +/- 14.5
471	Exterior	D	Ext. Garage 23	Win. Sash, ext.	Wood	POOR	White	0	1.58	Positive	1.9 +/- 0.7
472	Exterior	D	Ext. Garage 23	Win. Well/Trough	Wood	POOR	White	0	1.35	Positive	2.2 +/- 1
473	Exterior	D	Ext. Garage 23	Win. Jamb	Wood	POOR	White	0	2.18	Positive	10.2 +/- 9.1
475	Exterior	A	Ext. Garage 23	Ext. Fascia	Wood	POOR	Blue	0	3.01	Positive	11.2 +/- 9.6
476	Exterior	A	Ext. Garage 23	Crown Molding	Wood	POOR	Blue	0	2.23	Positive	10.5 +/- 9.3
486	Exterior	D	Int. Garage 23	Win. Sash	Wood	POOR	White	0	1.64	Positive	6.6 +/- 4.1
500	First	All	Kitchen 9	Win. Sash, ext.	Wood	POOR	Blue	0		Positive	Presumed +/-
501	First	All	Kitchen 9	Win. Well/Trough	Wood	POOR	Blue	0		Positive	Presumed +/-
502	First	All	Kitchen 9	Win. Jamb	Wood	POOR	Blue	0		Positive	Presumed +/-

ETC - Environmental Services WILCO Environmental

APPENDIX C

Potential Future Lead Paint Hazards - Ordered by Room

Please note: Post 1978 Construction, factory finished and unpainted items were not sampled

Client		Genesee County Land Bank									
Survey Location:		841 E. 9th Street, Flint, MI 48503									
Survey Date:		06/14/11									
Inspectors:		Michael Gravlín			License #:	P-00313			Job #:	137259	
Sample #	Floor	Wall / Side	Room and #	Component	Substrate	Visual Condition	Color	Note	Depth Index	Result	mg/ cm ² +/- Precision
110	First	A	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	1.8 +/- 0.8
112	First	C	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	2.4 +/- 1
113	First	D	Bathroom 6	Wall	Plaster	FAIR	Green	0	10	Positive	4 +/- 2.4
114	First	Ceiling	Bathroom 6	Ceiling	Plaster	FAIR	Green	0	10	Positive	3.2 +/- 2.1
115	First	B	Bathroom 6	Baseboard	Wood	FAIR	Green	0	5.07	Positive	5.6 +/- 3.2
116	First	B	Bathroom 6	Door Casing	Wood	FAIR	Green	0	10	Positive	4.8 +/- 3.4
117	First	B	Bathroom 6	Door Jamb	Wood	FAIR	Green	0	10	Positive	7.2 +/- 3.6
118	First	B	Bathroom 6	Door Stop	Wood	FAIR	Green	0	4.34	Positive	2.7 +/- 1.7
120	First	C	Bathroom 6	Win. Apron	Wood	FAIR	Green	0	5.93	Positive	7.6 +/- 3.7
121	First	C	Bathroom 6	Win. Sill/Stool	Wood	FAIR	Green	0	6.79	Positive	6.6 +/- 3.6
130	First	B	Hallway 7	Wall	Plaster	FAIR	Green	0	10	Positive	3.9 +/- 2.7
131	First	C	Hallway 7	Wall	Plaster	FAIR	Green	0	5.92	Positive	5.4 +/- 3.6
132	First	D	Hallway 7	Wall	Plaster	FAIR	Green	0	8.38	Positive	4.3 +/- 2.7
142	First	Ceiling	Rear Entry 8	Ceiling	Wood	FAIR	White	0	2	Positive	13.5 +/- 10.5
232	Second	B	Hallway 11	Shelf Bracket	Wood	FAIR	Green	0	2.26	Positive	2.3 +/- 0.8
244	Second	A	Bathroom 12	Clos. Casing	Wood	FAIR	Blue	0	9.41	Positive	7 +/- 3.5
246	Second	A	Bathroom 12	Clos. Jamb	Wood	FAIR	Blue	0	10	Positive	3.8 +/- 2.3
249	Second	A	Bathroom 12	Chair Rail	Wood	FAIR	Blue	0	5.61	Positive	5.2 +/- 3.3
250	Second	A	Bathroom 12	Med. Cabinet out	Wood	FAIR	Blue	0	10	Positive	6 +/- 3.4
251	Second	A	Bathroom 12	Cabinet Door	Wood	FAIR	Blue	0	10	Positive	5.9 +/- 3.2
293	Second	C	Bedroom 13	Clos. Baseboard	Wood	FAIR	Blue	0	10	Positive	4.6 +/- 3
294	Second	C	Bedroom 13	Clos. Shelf	Wood	FAIR	Blue	0	5.53	Positive	2.4 +/- 1.4
295	Second	C	Bedroom 13	Shelf Brackets	Wood	FAIR	Blue	0	7.76	Positive	6.3 +/- 3.3
297	Second	C	Bedroom 13	Clos. Wall	Plaster	FAIR	Blue	0	3.32	Positive	3.2 +/- 2
298	Second	C	Bedroom 13	Clos. Ceiling	Plaster	FAIR	Blue	0	3.44	Positive	2.3 +/- 1
317	Exterior	A	Ext. House 22	Ext. Fascia	Metal	FAIR	Grey	0	10	Positive	11.7 +/- 10.6
339	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White	0	7.05	Positive	5.3 +/- 3.9
340	Second	C	Bedroom 15	Clos. Jamb	Wood	FAIR	White	0	3.1	Positive	2 +/- 0.8
341	Second	C	Bedroom 15	Clos. Casing in.	Wood	FAIR	White	0	5.27	Positive	6.4 +/- 3.3
342	Second	C	Bedroom 15	Clos. Baseboard	Wood	FAIR	White	0	8.69	Positive	7.6 +/- 3.7
343	Second	C	Bedroom 15	Shelf Bracket	Wood	FAIR	White	0	10	Positive	7.5 +/- 3.6
345	Second	C	Bedroom 15	Clos. Ceiling	Wood	FAIR	Green	0	2.73	Positive	1.8 +/- 0.6
379	Second	A	Bedroom 16	Clos. Baseboard	Wood	FAIR	White	0	6.34	Positive	4.8 +/- 3.1
380	Second	A	Bedroom 16	Shelf Bracket	Wood	FAIR	White	0	10	Positive	11.1 +/- 4.5
382	Second	A	Bedroom 16	Clos. Ceiling	Plaster	FAIR	White	0	3.96	Positive	3 +/- 1.3
387	Second	A	Attic Stair 17	Door Casing	Wood	FAIR	Green	0	5.04	Positive	7.9 +/- 3.6
388	Second	A	Attic Stair 17	Door Jamb	Wood	FAIR	Green	0	4.58	Positive	5 +/- 3.3
415	Second	C	Basment Stair 19	Door Casing	Wood	FAIR	Green	0	8.45	Positive	4.7 +/- 2.8

APPENDIX D

Maps of Residence


The inspection process uses a standard method of describing where lead paint is located. This is so that all parties involved will have a clear understanding as to what surfaces contain lead.

The outsides of the house will be lettered, starting with the letter A for the side of the house where the house gets its street address from. Starting at the A side, the rest of the house is lettered consecutively, clockwise around the house. Regardless of where the front door is located, the side of the house facing the street where the address is derived from will always be side A.

Inside the house, the process is much the same. The wall of each room that is nearest the A side of the house will be identified as wall A in the report. The wall nearest the B side will be labeled wall B, and so on.



For identifying the rooms and other areas of the interior of the house, a numbering system is used. Most rooms, with the exception of the kitchen and bath could be used for different purposes. When numbers are used, deciphering which room is called what will not be required. See dwelling map and labeling to determine the locations of the tests and hazards.

EXAMPLE

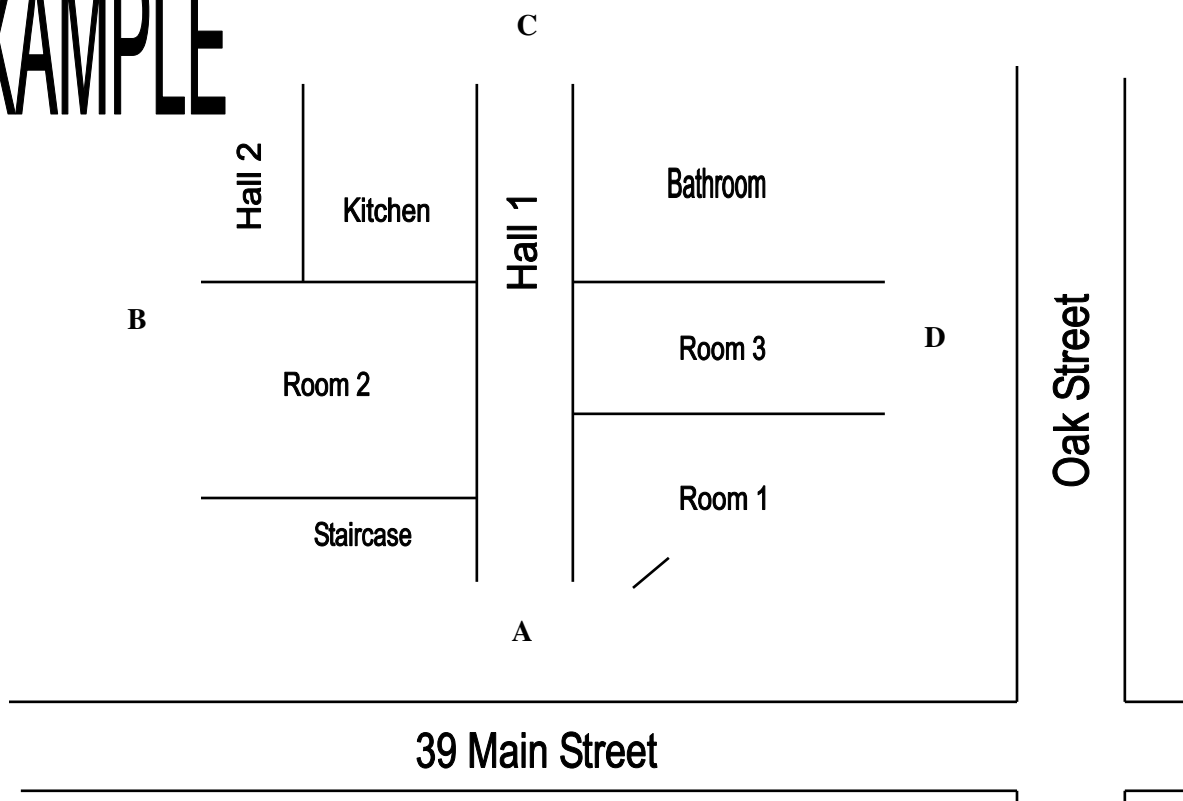


Side C

841 E. 9th Street
Flint, MI 48503
Year Built: 1920's

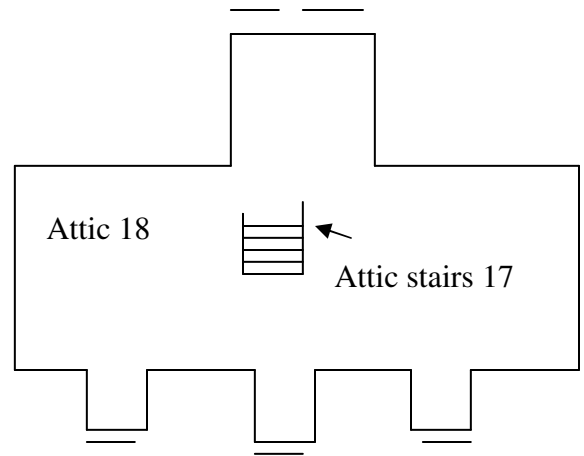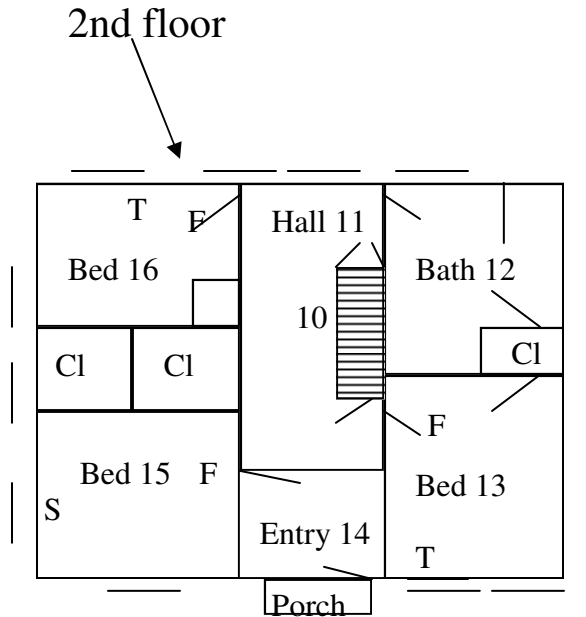

Side B

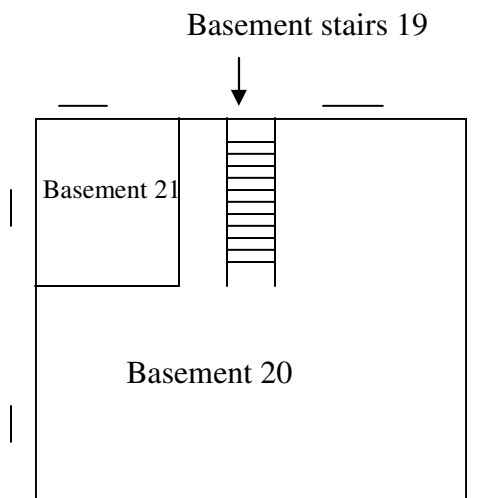

Side D

F = Floor Dust Wipe Sample
S = Windowsill Dust Wipe Sample
T = Window Trough Dust Wipe Sample
W = Wood windows
V = Vinyl windows
A = Aluminum windows
M = Metal windows
GB = Glass block windows


Side A

Please Note: This is a rough floor plan only. All items, (doorways, Windows, etc.) may not be included in this illustration. Also, room and component sizes are not drawn to scale.

Genesee County Land Bank
137259

Side C

841 E. 9th Street
Flint, MI 48503
Year Built: 1920's

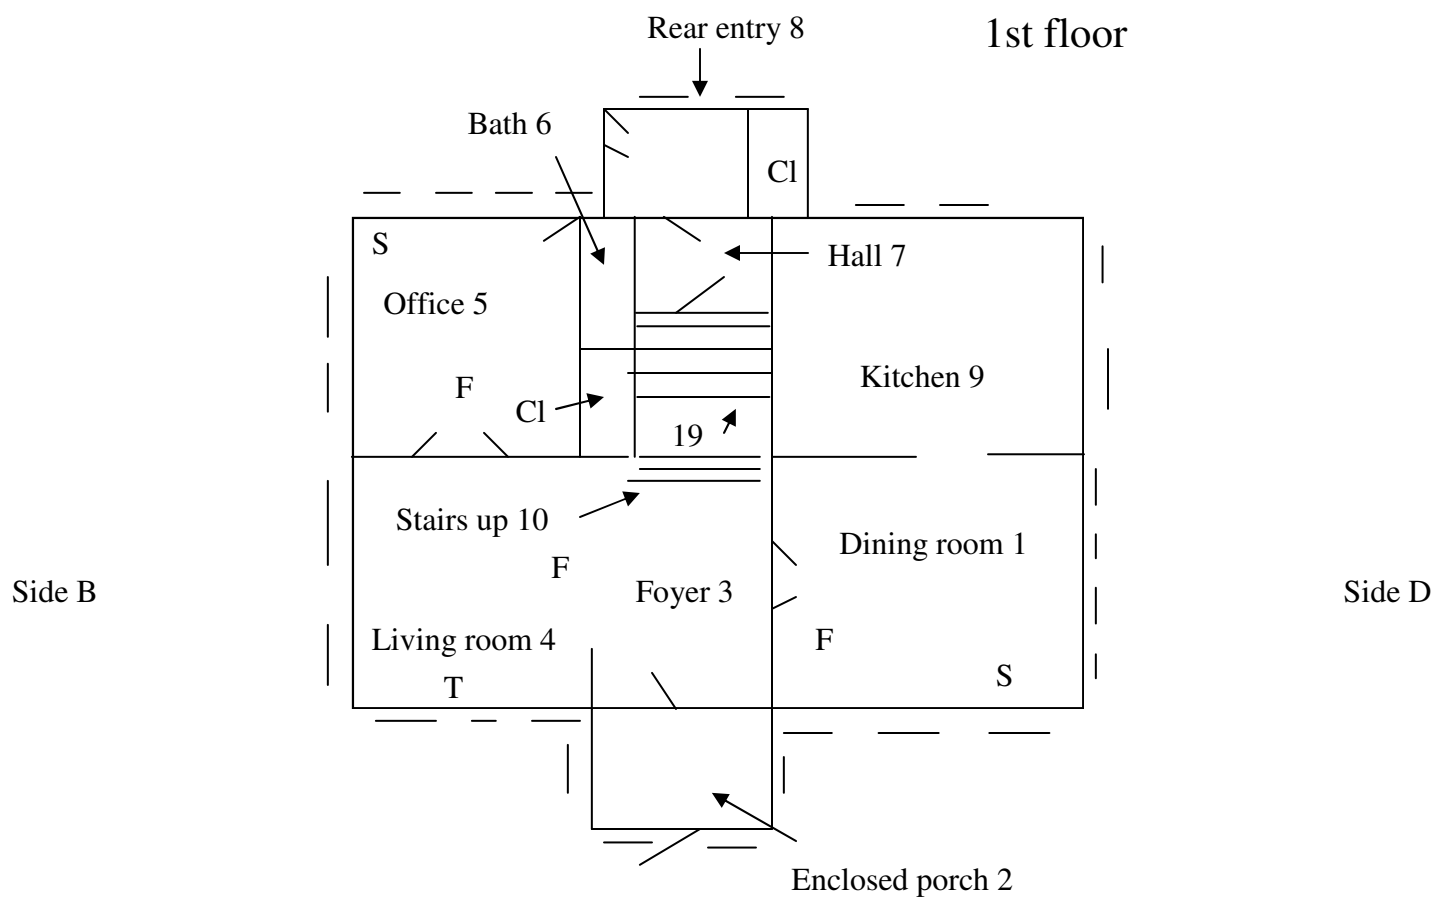


F = Floor Dust Wipe Sample
S = Windowsill Dust Wipe Sample
T = Window Trough Dust Wipe Sample
W = Wood windows
V = Vinyl windows
A = Aluminum windows
M = Metal windows
GB = Glass block windows

Please Note: This is a rough floor plan only. All items, (doorways, Windows, etc.) may not be included in this illustration. Also, room and component sizes are not drawn to scale.

Side A

Genesee County Land Bank
137259

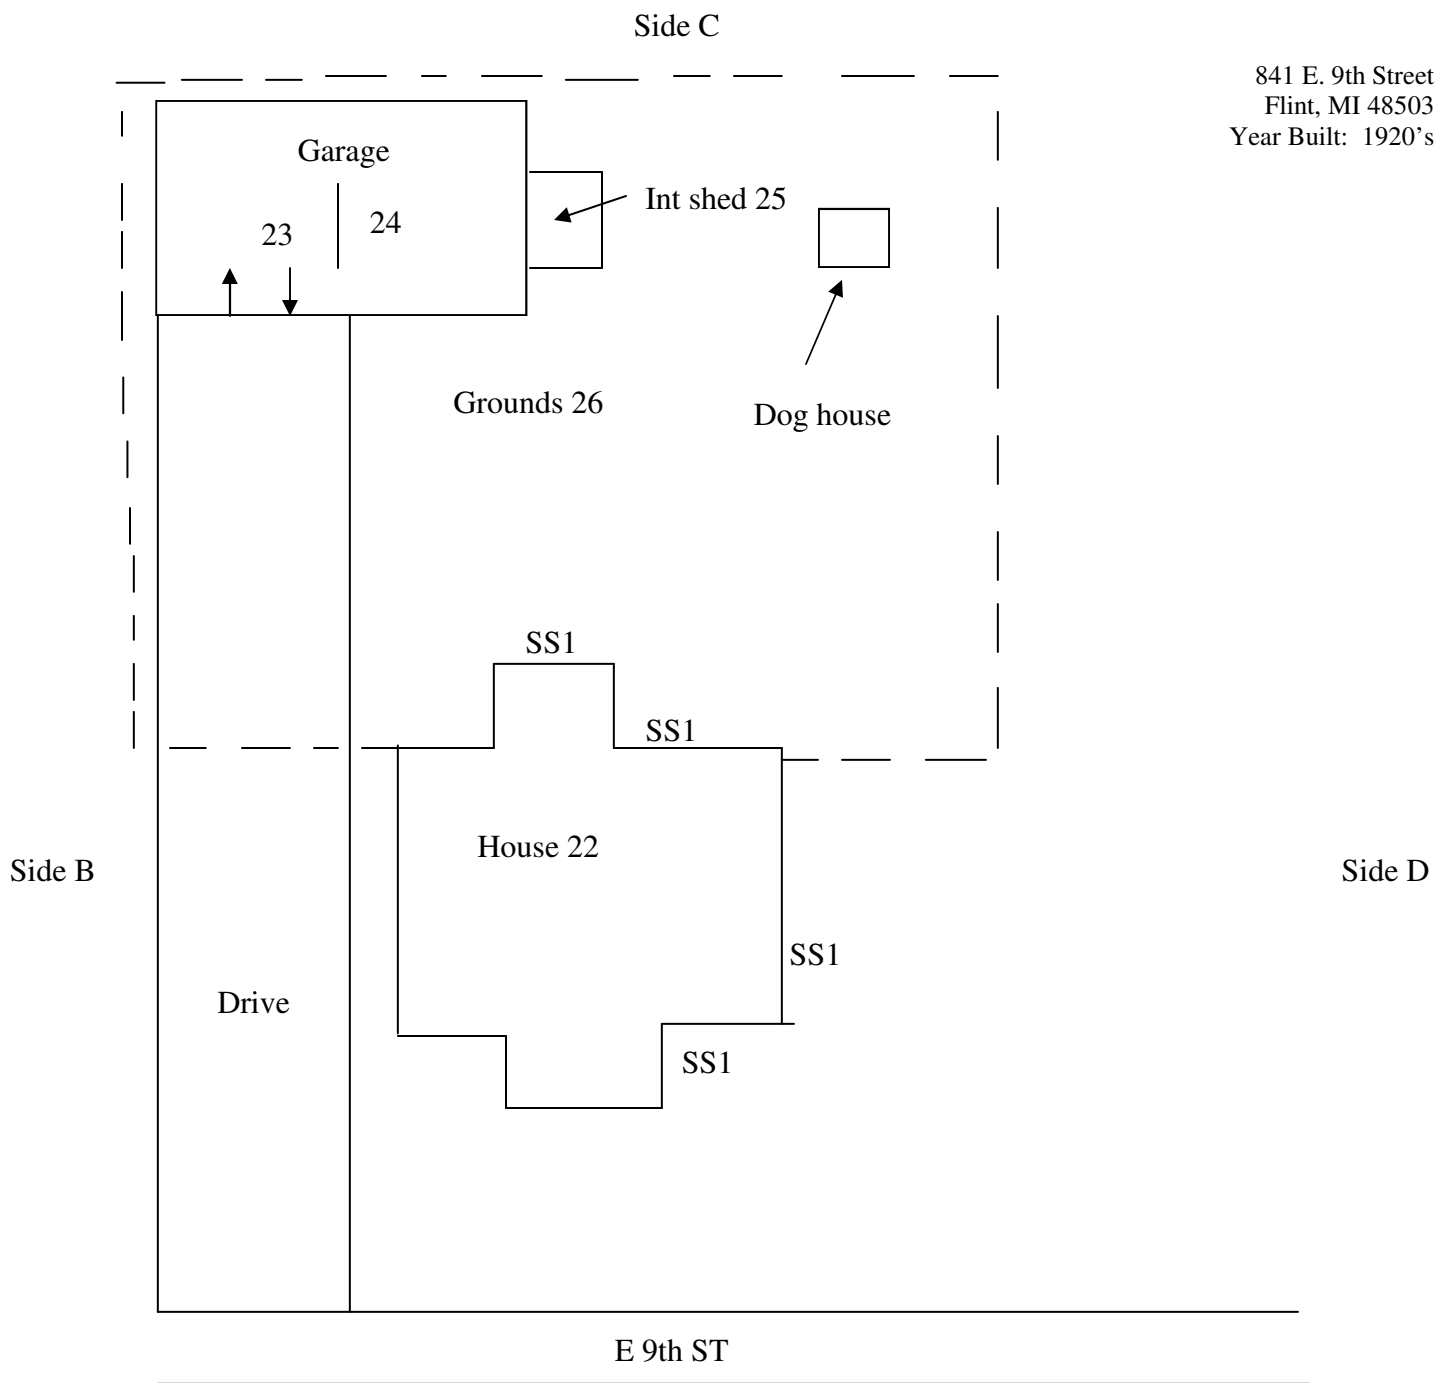

F = Floor Dust Wipe Sample
 S = Windowsill Dust Wipe Sample
 T = Window Trough Dust Wipe Sample
 W = Wood windows
 V = Vinyl windows
 A = Aluminum windows
 M = Metal windows
 GB = Glass block windows

Please Note: This is a rough floor plan only. All items, (doorways, Windows, etc.) may not be included in this illustration. Also, room and component sizes are not drawn to scale.

Side A

Genesee County Land Bank
137259

APPENDIX E

Resident Questionnaire and Building Condition Form

RESIDENT QUESTIONNAIRE

This residence was VACANT at the time of the inspection

Do any children under the age of 18 live in the home?	N/A—Vacant
What are the ages of the children?	N/A—Vacant
Do any children under the age of 18 visit regularly in the home?	N/A—Vacant
What are the ages of the children?	N/A—Vacant
Any known elevated blood lead levels?	N/A—Vacant
Location of children (under 7) bedrooms.	N/A—Vacant
Where do children eat? Rm. #'s:	N/A—Vacant
What room are toys stored (children play)?	N/A—Vacant
Where do children play outdoors?	N/A—Vacant
Which windows are opened most often?	N/A—Vacant
Rooms with window air conditioners.	N/A—Vacant
Have any renovation work items been completed in the last several years?	Unknown
Are you planning any renovations of the home?	Yes—gut/rehab summer of 2011
Are you planning any landscaping activities?	Unknown
Is there evidence of chewed, chipped, or peeling paints?	Yes—see XRF results
Have any previous lead inspections/assessments been completed at this property?	Unknown
Have any lead hazard control activities been conducted at this address?	Unknown
Are you aware of any current lead paint hazards in this home?	N/A
Has a housing code violation ever been issued for this building?	Unknown
Which entrances are used most often?	N/A—Vacant
Do you have a vegetable garden?	N/A—Vacant
Is there a dog or cat in the home?	N/A—Vacant
How often is the house regularly cleaned?	N/A—Vacant
How often is the house thoroughly cleaned?	N/A—Vacant
What cleaning methods are used?	N/A—Vacant
Do any household members work in a field that might expose them to lead?	N/A—Vacant
If yes to 21, where are work clothes stored for cleaning?	N/A—Vacant
Who was interviewed for this section?	Visual observation by the Technician

Building Condition Form

If two or more components have been found to be in poor condition, this house needs more than a Risk Assessment. A complete paint inspection will give information as to potential hazards not identified in a standard Risk Assessment.

Condition	Yes	No
Roof missing parts of surface covering?	X	
Roof has holes or large cracks?	X	
Gutters or downspouts broken?		X
Chimney or masonry cracked, with loose or missing components, out of plumb or otherwise deteriorated?		X
Exterior or interior walls have large cracks, or damage requiring more than routine painting?	X	
Exterior siding missing components?		X
Water stains on interior walls or ceilings?	X	
Plaster walls deteriorated?	X	
Two or more windows or doors missing, broken or boarded up?		X
Porch or steps have major cracks, missing materials, structural leans, or visibly unsound?	X	
Foundation has damage, structural problems, leans or is unsound?		X
Are there any debris piles or other “extreme” storage issues around the yard/grounds?	X	
Other conditions not listed—MOLD GROWTH	X	
Total		

APPENDIX F

Re-Evaluation Schedule Chart

Standard Reevaluation Schedule
(See Notes to Table)

Schedule	Evaluation Results	Action Taken	Reevaluation Frequency	Visual Survey (by owner or owner's representative)
1	Combination risk assessment/inspection finds no leaded dust or soil and no lead-based paint	None	None	None
2	No lead-based paint hazards found during risk assessment conducted before hazard control or at clearance (hazards include dust and soil).	None	3 years	Annually and whenever information indicates a possible problem
3	The average of leaded dust levels on all floors, interior window sills, or window troughs sampled exceeds the applicable standard, but by less than a factor of 10.	A. Interim controls and/or hazard abatement (or mixture of the two), including, but not necessarily limited to, dust removal. This schedule does not include window replacement. B. Treatments specified in section A plus replacement of all windows with lead hazards C. Abatement of all lead-based paint using encapsulation or enclosure D. Removal of all lead-based paint	1 year, 2 years 1 year None None	Same as Schedule 2, except for encapsulants. The first visual survey of encapsulants should be done one month after clearance; the second should be done six months later and annually thereafter. Same as Schedule 3 above None
4	The average of leaded dust levels on all floors, interiors window sills, or window troughs sampled exceeds the applicable standard by a factor of 10 or more	A. Interim controls and/or hazard abatement (or mixture of the two), including, but not necessarily limited to, dust removal. This schedule does not include window replacement. B. Treatments specified in section A plus replacement of all windows with lead hazards C. Abatement of all lead-based paint using encapsulation or enclosure D. Removal of all lead-based paint	6 months, 1 year, 2 years 6 months 2 years None None	Same as Schedule 3 Same as Schedule 3 Same as Schedule 3 None
5	No leaded dust or leaded soil hazards identified, but lead-based paint or lead-based paint hazards are found.	A. Interim controls or mixture of interim controls and abatement (not including window replacement) B. Mixture of interim controls and abatement, including window replacement C. Abatement of all lead-based paint hazards, but not all lead-based paint D. Abatement of all lead-based paint using encapsulation or enclosure E. Removal of all lead-based paint	2 years 3 years 4 years None None	Same as Schedule 3 Same as Schedule 3 Same as Schedule 3 Same as Schedule 3
6	Bare leaded soil exceeds standard, but less than 5.000 μ g/g.	Interim controls	None	3 months to check new ground cover, then annually to identify new bare spots
7	Bare leaded soil greater than or equal to 5.000 μ g/g.	Abatement (paving or removal)	None	None for removal, annually to identify new bare spots or deterioration of paving

Standard Reevaluation Schedule (continued)

Notes to Table:

When more than one schedule applies to a dwelling, use the one with the most stringent reevaluation schedule. Do not use the results of a reevaluation for Schedule 2.

A lead-based paint hazard includes deteriorated lead-based paint and leaded dust and soil above applicable standards.

The frequency of reevaluations and the interval between reevaluations depends on the findings at each reevaluation and the action taken. For example, a dwelling unit or common area falling under Schedule 3.A would be reevaluated one year after clearance. If no lead-based paint hazards are detected at that time, the unit or area would be reevaluated again two years after the first reevaluation. If no hazards are found in the second reevaluation, no further reevaluation is necessary, but annual visual monitoring should continue.

If, on the other hand, the unit or common area fails a reevaluation, a new reevaluation schedule should be determined based on the results of the reevaluation and the action taken. For instance, if the reevaluation finds deteriorated lead-based paint but no lead-contaminated dust, and the action taken is paint stabilization, Schedule 5.A would apply, which indicates that the next reevaluation should be in two years. If, however, the owner of this same property decides to abate all lead-based paint hazards instead of doing only paint stabilization, the property would move to Schedule 5.C, which calls for reevaluation four years from the date of clearance after the hazard abatement.

Following another scenario, suppose a reevaluation of this same dwelling unit or common area finds that the average dust lead levels on sampled window troughs exceeds the applicable standard by a factor of 10 or more, but no other lead-based paint hazards. The owner conducts dust removal. In this case the next reevaluation would be six months after clearance.

The initial evaluation results determine which reevaluation schedule should be applied. An initial evaluation can be a risk assessment, a risk assessment/ inspection combination, or, if the owner has opted to bypass the initial evaluation and proceed directly to controlling suspected hazards, a combination risk assessment/clearance examination. This type of clearance must be conducted by a certified risk assessor, who should determine if all hazards were in fact controlled. The results of the initial clearance dust tests, soil sampling and visual examination should be used to determine the appropriate schedule. If repeated cleaning was necessary to achieve clearance, use the results of the dust tests before repeated cleaning was performed for schedule determination.

If a unit fails two consecutive reevaluations, the reevaluation interval should be reduced by half and the number of reevaluations should be doubled. If deteriorated lead-based paint hazards continue to occur, then the offending components/surfaces should be abated. If dwellings with dust hazards but no paint-related hazards repeatedly fail reevaluations, the exterior source should be identified (if identification efforts fail, regular dust removal efforts are needed).

APPENDIX G

Site Photos



Front of Home (Side A)



Side B



Rear of Home (Side C)



Side D



Enclosed Porch Exterior



Enclosed Porch Interior



Garage



Interior



Interior



Interior



Interior



Interior



Interior



Shed



Yard

Applicability

The Project or Program to which the construction work covered by this contract pertains is being assisted by the United States of America and the following Federal Labor Standards Provisions are included in this Contract pursuant to the provisions applicable to such Federal assistance.

A. 1. (i) Minimum Wages. All laborers and mechanics employed or working upon the site of the work will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR Part 3), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics. Contributions made or costs reasonably anticipated for bona fide fringe benefits under Section I(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of 29 CFR 5.5(a)(1)(iv); also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs, which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period.

Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under 29 CFR 5.5(a)(1)(ii) and the Davis-Bacon poster (WH-1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible, place where it can be easily seen by the workers.

(ii) (a) Any class of laborers or mechanics which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. HUD shall approve an additional classification and wage rate and fringe benefits therefor only when the following criteria have been met:

- (1)** The work to be performed by the classification requested is not performed by a classification in the wage determination; and
- (2)** The classification is utilized in the area by the construction industry; and
- (3)** The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.

(b) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and HUD or its designee agree on the classification and wage rate (including the amount designated for fringe benefits where

appropriate), a report of the action taken shall be sent by HUD or its designee to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, D.C. 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise HUD or its designee or will notify HUD or its designee within the 30-day period that additional time is necessary. (Approved by the Office of Management and Budget under OMB control number 1215-0140.)

(c) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and HUD or its designee do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), HUD or its designee shall refer the questions, including the views of all interested parties and the recommendation of HUD or its designee, to the Administrator for determination. The Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise HUD or its designee or will notify HUD or its designee within the 30-day period that additional time is necessary. (Approved by the Office of Management and Budget under OMB Control Number 1215-0140.)

(d) The wage rate (including fringe benefits where appropriate) determined pursuant to subparagraphs (1)(ii)(b) or (c) of this paragraph, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.

(iii) Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.

(iv) If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program. (Approved by the Office of Management and Budget under OMB Control Number 1215-0140.)

2. Withholding. HUD or its designee shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld from the contractor under this contract or any other Federal contract with the same prime contractor, or any other Federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee or helper, employed or working on the site of the work, all or part

of the wages required by the contract, HUD or its designee may, after written notice to the contractor, sponsor, applicant, or owner, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased. HUD or its designee may, after written notice to the contractor, disburse such amounts withheld for and on account of the contractor or subcontractor to the respective employees to whom they are due. The Comptroller General shall make such disbursements in the case of direct Davis-Bacon Act contracts.

3. (i) Payrolls and basic records. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in Section I(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5 (a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in Section I(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs. (Approved by the Office of Management and Budget under OMB Control Numbers 1215-0140 and 1215-0017.)

(ii) (a) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to HUD or its designee if the agency is a party to the contract, but if the agency is not such a party, the contractor will submit the payrolls to the applicant sponsor, or owner, as the case may be, for transmission to HUD or its designee. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i). This information may be submitted in any form desired. Optional Form WH-347 is available for this purpose and may be purchased from the Superintendent of Documents (Federal Stock Number 029-005-00014-1), U.S. Government Printing Office, Washington, DC 20402. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. (Approved by the Office of Management and Budget under OMB Control Number 1215-0149.)

(b) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:

(1) That the payroll for the payroll period contains the information required to be maintained under 29 CFR 5.5 (a)(3)(i) and that such information is correct and complete;

(2) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll

period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in 29 CFR Part 3;

(3) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.

(c) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH-347 shall satisfy the requirement for submission of the "Statement of Compliance" required by subparagraph A.3.(ii)(b).

(d) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under Section 1001 of Title 18 and Section 231 of Title 31 of the United States Code.

(iii) The contractor or subcontractor shall make the records required under subparagraph A.3.(i) available for inspection, copying, or transcription by authorized representatives of HUD or its designee or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, HUD or its designee may, after written notice to the contractor, sponsor, applicant or owner, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

4. Apprentices and Trainees.

(i) Apprentices. Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice. The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed. Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the

journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination. In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

(ii) Trainees. Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration. The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration. Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

(iii) Equal employment opportunity. The utilization of apprentices, trainees and journeymen under 29 CFR Part 5 shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR Part 30.

5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR Part 3 which are incorporated by reference in this contract

6. Subcontracts. The contractor or subcontractor will insert in any subcontracts the clauses contained in subparagraphs 1 through 11 of this paragraph A and such other clauses as HUD or its designee may by appropriate instructions require, and a copy of the applicable prevailing wage decision, and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in this paragraph.

7. Contract termination; debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.

8. Compliance with Davis-Bacon and Related Act Requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR Parts 1, 3, and 5 are herein incorporated by reference in this contract

9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR Parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and HUD or its designee, the U.S. Department of Labor, or the employees or their representatives.

10. (i) Certification of Eligibility. By entering into this contract the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of Section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1) or to be awarded HUD contracts or participate in HUD programs pursuant to 24 CFR Part 24.

(ii) No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of Section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1) or to be awarded HUD contracts or participate in HUD programs pursuant to 24 CFR Part 24.

(iii) The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001. Additionally, U.S. Criminal Code, Section 1010, Title 18, U.S.C., "Federal Housing Administration transactions", provides in part: "Whoever, for the purpose of . . . influencing in any way the action of such Administration..... makes, utters or publishes any statement knowing the same to be false..... shall be fined not more than \$5,000 or imprisoned not more than two years, or both."

11. Complaints, Proceedings, or Testimony by Employees. No laborer or mechanic to whom the wage, salary, or other labor standards provisions of this Contract are applicable shall be discharged or in any other manner discriminated against by the Contractor or any subcontractor because such employee has filed any complaint or instituted or caused to be instituted any proceeding or has testified or is about to testify in any proceeding under or relating to the labor standards applicable under this Contract to his employer.

B. Contract Work Hours and Safety Standards Act. The provisions of this paragraph B are applicable only where the amount of the prime contract exceeds \$100,000. As used in this paragraph, the terms "laborers" and "mechanics" include watchmen and guards.

(1) Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of 40 hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of 40 hours in such workweek.

(2) Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in subparagraph

graph (1) of this paragraph, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in subparagraph (1) of this paragraph, in the sum of \$10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of 40 hours without payment of the overtime wages required by the clause set forth in sub paragraph (1) of this paragraph.

(3) Withholding for unpaid wages and liquidated damages. HUD or its designee shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contract, or any other Federally-assisted contract subject to the Contract Work Hours and Safety Standards Act which is held by the same prime contractor such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in subparagraph (2) of this paragraph.

(4) Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in subparagraph (1) through (4) of this paragraph and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in subparagraphs (1) through (4) of this paragraph.

C. Health and Safety. The provisions of this paragraph C are applicable only where the amount of the prime contract exceeds \$100,000.

(1) No laborer or mechanic shall be required to work in surroundings or under working conditions which are unsanitary, hazardous, or dangerous to his health and safety as determined under construction safety and health standards promulgated by the Secretary of Labor by regulation.

(2) The Contractor shall comply with all regulations issued by the Secretary of Labor pursuant to Title 29 Part 1926 and failure to comply may result in imposition of sanctions pursuant to the Contract Work Hours and Safety Standards Act, 40 USC 3701 et seq.

(3) The Contractor shall include the provisions of this paragraph in every subcontract so that such provisions will be binding on each subcontractor. The Contractor shall take such action with respect to any subcontract as the Secretary of Housing and Urban Development or the Secretary of Labor shall direct as a means of enforcing such provisions.

**EQUAL OPPORTUNITY CLAUSE
(EXECUTIVE ORDER 11246)**

"During the performance of this contract, the contractor agrees as follows:

"(1) The contractor will not discriminate against any employee or applicant for Employment because of race, creed, color, or national origin. The contractor will take affirmative action to ensure that applicants are employed, and that employees are treated during employment, without regard to their race, creed, color, or national origin. Such action shall include, but not be limited to the following: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided by the contracting officer setting forth the provisions of this nondiscrimination clause.

"(2) The contractor will, in all solicitations or advertisements for employees placed by or on behalf of the contractor, state that all qualified applicants will receive consideration for employment without regard to race, creed, color, or national origin.

"(3) The contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice, to be provided by the agency contracting officer, advising the labor union or workers' representative of the contractor's commitments under Section 202 of Executive Order No. 11246 of September 24, 1965, and shall post copies of the notice in conspicuous places available to employees and applicants for employment.

"(4) The contractor will comply with all provisions of Executive Order No. 11246 of Sept. 24, 1965, and of the rules, regulations, and relevant orders of the Secretary of Labor.

"(5) The contractor will furnish all information and reports required by Executive Order No. 11246 of September 24, 1965, and by the rules, regulations, and orders of the Secretary of Labor, or pursuant thereto, and will permit access to his books, records, and accounts by the contracting agency and the Secretary of Labor for purposes of investigation to ascertain compliance with such rules, regulations, and orders.

"(6) In the event of the contractor's noncompliance with the nondiscrimination clauses of this contract or with any of such rules, regulations, or orders, this contract may be cancelled, terminated or suspended in whole or in part and the contractor may be declared ineligible for further Government contracts in accordance with procedures authorized in Executive Order No. 11246 of Sept 24, 1965, and such other sanctions may be imposed and remedies invoked as provided in Executive Order No. 11246 of September 24, 1965, or by rule, regulation, or order of the Secretary of Labor, or as otherwise provided by law.

"(7) The contractor will include the provisions of Paragraphs (1) through (7) in every subcontract or purchase order unless exempted by rules, regulations, or orders of the Secretary of Labor issued pursuant to Section 204 of Executive Order No. 11246 of Sept. 24, 1965, so that such provisions will be binding upon each subcontractor or vendor. The contractor will take such action with respect to any subcontract or purchase order as the contracting agency may direct as a means of enforcing such provisions including sanctions for noncompliance: Provided, however, That in the event the contractor becomes involved in, or is threatened with, litigation with a subcontractor or vendor as a result of such direction by the contracting agency, the contractor may request the United States to enter into such litigation to protect the interests of the United States."

SECTION 3 CLAUSE

All Section 3 covered contracts shall include the following clause (referred to as the “Section 3 Clause”):

A. The work to be performed under this contract is subject to the requirements of Section 3 of the Housing and Urban Development Act of 1968, as amended, [12 U.S.C. 1701u](#) (section 3). The purpose of section 3 is to ensure that employment and other economic opportunities generated by HUD assistance or HUD-assisted projects covered by section 3, shall, to the greatest extent feasible, be directed to low- and very low-income persons, particularly persons who are recipients of HUD assistance for housing.

B. The parties to this contract agree to comply with HUD's regulations in 24 CFR Part 135, which implement section 3. As evidenced by their execution of this contract, the parties to this contract certify that they are under no contractual or other impediment that would prevent them from complying with the part 135 regulations.

C. The contractor agrees to send to each labor organization or representative of workers with which the contractor has a collective bargaining agreement or other understanding, if any, a notice advising the labor organization or workers' representative of the contractor's commitments under this section 3 clause, and will post copies of the notice in conspicuous places at the work site where both employees and applicants for training and employment positions can see the notice. The notice shall describe the section 3 preference, shall set forth minimum number and job titles subject to hire, availability of apprenticeship and training positions, the qualifications for each; and the name and location of the person(s) taking applications for each of the positions; and the anticipated date the work shall begin.

D. The contractor agrees to include this section 3 clause in every subcontract subject to compliance with regulations in 24 CFR Part 135, and agrees to take appropriate action, as provided in an applicable provision of the subcontract or in this section 3 clause, upon a finding that the subcontractor is in violation of the regulations in 24 CFR Part 135. The contractor will not subcontract with any subcontractor where the contractor has notice or knowledge that the subcontractor has been found in violation of the regulations in 24 CFR Part 135.

E. The contractor will certify that any vacant employment positions, including training positions, that are filled (1) after the contractor is selected by before the contract is executed, and (2) with persons other than those to whom the regulations of 24 CFR part 135 require employment opportunities to be directed, were not filled to circumvent the contractor's obligations under 24 CFR part 135.

F. Noncompliance with HUD's regulations in 24 CFR part 135 may result in sanctions, termination of this contract for default, and debarment or suspension from future HUD assisted contracts.

G. With respect to work performed in connection with section 3 covered Indian housing assistance, section 7(b) of the Indian Self-Determination and Education Assistance Act (25 U.S.C. 450e) also applies to the work to be performed under this contract. Section 7(b) requires that to the greatest extent feasible (i) preference in the award of contracts and subcontracts shall be given to Indian organizations and Indian-owned Economic Enterprises. Parties to this contract that are subject to the provisions of section 3 and section 7(b) agree to comply with section 3 to the maximum extent feasible, but not in derogation of compliance with section 7(b).

City of Flint – Section 3 Plan Addendum

This document provides specific direction for certification and reporting of the implementation of the City of Flint's Section 3 Standard Operating Procedures.

Title 24--Housing and Urban Development

CHAPTER I--OFFICE OF ASSISTANT SECRETARY FOR EQUAL OPPORTUNITY,
DEPARTMENT OF HOUSING AND URBAN DEVELOPMENT
PART 135--ECONOMIC OPPORTUNITIES FOR LOW- AND VERY LOW-INCOME
PERSONS

Resident Requirements

Each contractor conducting services on covered projects under the guideline Title 24 Code of Federal Regulation Part 135 is to provide the City of Flint a current list of employees that will be assigned to accomplish activities under the covered contract within 10 business days of the contract execution date.

Section 3 is triggered when the normal completion of construction and rehabilitation projects creates the need for new employment, contracting or training opportunities beyond the list of employees provided at the execution of the contract including, but not limited to, administrative, managerial, clerical, service, and building trades positions.

Employee registers should be submitted monthly on the Monthly Status Report Worksheet along with the monthly activity report/pay request. Section 3 compliance will be monitored monthly by verifying the names on the initial employee list with monthly activity reports and/or pay requests that list new employees in the payroll. Thirty percent of new hires, trainees or contractors are required to be Section 3 eligible. If accomplishing the contract does not require new employees, training or contractors, Section 3 is not triggered.

All potential Section 3 eligible new hires must register with the Mott Community College Workforce Development and Career Services Department before they begin working. MCC Workforce Development (MCC WFD) will certify that new hires are Section 3 eligible. MCC WFD will provide the new hire Section 3 certification documentation to the identified Contractor and the City of Flint.

If the contractor/sub recipient is unable to identify Section 3 eligible individuals with the skill sets needed to accomplish the work that is needed, MCC Workforce Development has a pool of Building Construction Trade graduates that are Section 3 certified. The contractor should contact MCC to secure certified employees.

MCC WFD will provide the City of Flint with monthly reports to identify the number and placement of Section 3 certified workers.

Business Concerns

Each contractor conducting services on covered projects under the guideline Title 24 Code of Federal Regulation Part 135 is to provide the City of Flint a current list of contractors that will be assigned to accomplish activities under the covered contract within 10 business days of the contract execution date.

Section 3 is triggered when the normal completion of construction and rehabilitation projects creates the need for new employment, contracting or training opportunities beyond the list of contractors provided at the execution of the contract.

Each contractor and subcontractor demonstrates compliance with the requirements of this part by awarding at least 10 percent of contracts to Section 3 Business Concerns.

If the Contract Holder identifies a Section 3 Business Concern for sub contracting purposes, submit Section 3 Business Concern documentation for certification to the City of Flint Section 3 Coordinator to certify each Business Concern. Each Section 3 eligible employee of that Contractor must be directed to Mott Community College Workforce Development and Career Services Department for certification.

Contractor registers should be submitted monthly on the Monthly Status Report Worksheet along with the monthly activity report/pay request. Section 3 compliance will be monitored monthly by verifying the companies on the initial employee list with monthly activity reports and/or pay requests that list new employees in the payroll. If accomplishing the contract does not require new contractors, Section 3 is not triggered.

A list is being compiled of Section 3 Business Concerns. For a list of eligible businesses, please contact the Department of Community and Economic Development.

Certification for Resident Seeking Section 3 Training and Employment

Preference

Eligibility Preference

A Section 3 resident seeking the preference in training and employment provided by this project shall certify or submit evidence to Mott Community College Workforce Development and recipient contractor/subcontractor that the person is a Section 3 resident.

I, _____, am a legal resident of the City of Flint

(print name)

and meet the income eligibility guidelines for a low- or very-low-income person for this area.

My permanent address is:

I have attached the following documentation as evidence of my status:

- ☐ Copy of lease
- ☐ Copy of receipt of public assistance
- ☐ Copy of Evidence of participation in a public assistance program
- ☐ Other evidence
 - ☐ Tax return
 - ☐ Pay stub
 - ☐ Social Security Annual Income Report
 - ☐ Unemployment rejection letter
 - ☐ DHS denial letter
 - ☐ Notarized letter of support from other individual

Signature _____

Print Name _____

Date _____

Open Enrollment

Monday - Thursday ONLY

Arrive 15 minutes early

Intake is at 9AM-or-1PM

MUST be on time!!!

Intake is 3-3 ½ hours

NO children PLEASE!



Mott Community College (MCC) – Workforce & Career Development Department is pleased to share services offered through the Workforce Investment Act (WIA) Program, which are designed to assist with **employment and career goals.**

MCC provides services through the WIA Title I **Adult, Dislocated and Older Youth Worker Programs.** **All participants must be 18 years of age or older; a citizen of the United States or an eligible non-citizen and registered with selective service (if applicable).** Dislocated Worker Program participants must also be terminated or laid off or have received a notice of termination or layoff from employment; and eligible for/or exhausted his/her entitlement to unemployment compensation. **If the previous requirements are not met, participants must have worked 90 days consecutively and unlikely to return.**

Both programs offer three levels of service: staff-assisted core, intensive and training services. Participants are involved in activities such as Individual Job Development, Advanced Job Club, Advanced Screened Referrals and Follow-Up Services, which are tailored to meet individual needs. Supportive Services may be available on a limited basis, to those who qualify for the purpose of enabling the successful participation and completion of program services.

To take advantage of these program opportunities, individuals must register with and receive core services from the Employment Services Office; complete the WIA Registration process and meet the program eligibility and documentation requirements.

Please call (810) 232-2555 if you have any questions.

The following documentation will be needed at the time of your appointment as it applies to your situation.

- **Career Alliance Referral Forms from Employment Services**
- **Valid Driver's License or State ID**
- **Social Security Card**
- **Birth Certificate (If no valid ID)**
- **Adult Workers (*Proof of Family Size & Proof of Income – Most Recent Check Stub*)**
- **Spouse most recent check stub (*If married*)**
- **Most Recent Tax Return (To verify Family size)**
- **Dislocated Workers (*Most Current UA Check Stub, UA Determination Notice*)**
- **Letter of dismissal from last employer-if available**
- **Medical Cards / Bridge Card**
- **DHS Statement of Income**
- **SSI / SSD Statement of Income**
- **Copy of WorkKeys assessment results**
- **DD-214, Military Transfer/Discharge Paper**

We look forward to working with you soon!

**Charles Stewart Mott Community College
Workforce & Career Development – WIA Program**

709 North Saginaw Street - Flint, Michigan 48503 • (810) 232-2555 (Voice & TTY) – (810) 232-4981 (Fax)

AN EQUAL OPPORTUNITY PROGRAM/AFFIRMATIVE ACTION EMPLOYER
AUXILIARY AIDS AND SERVICES ARE AVAILABLE TO PERSONS WITH DISABILITIES UPON REQUEST.

**Certification for Business Concern Seeking Section 3 Preference in
Contracting and Demonstration of Capacity**

Name of Business _____ Phone/Fax _____

Address of Business _____

Type of Business: Corporation Partnership Sole Proprietorship

Type of Business Activity: _____

Attached is the following documentation as evidence of status:

For all business entities (as applicable):

- | | |
|---|---|
| <input type="checkbox"/> Copy of Articles of Incorporation | <input type="checkbox"/> Certificate of Good Standing |
| <input type="checkbox"/> Assumed Business Name Certificate | <input type="checkbox"/> Partnership Agreement |
| <input type="checkbox"/> List of owners/stockholders and
51% ownership of each | <input type="checkbox"/> Corporation Annual Report |
| <input type="checkbox"/> Organization chart with names and titles
and brief function statement | <input type="checkbox"/> Latest Board minutes appointing officers |
| | <input type="checkbox"/> Additional documentation |

For business claiming status as a Section 3 resident-owned enterprise:

Certification for Section 3 Residents (at least 51% of the business owners)

**For Business claiming Section 3 status by subcontracting 25% of the dollar
award to**

qualified Section 3 Business:

- ☐ List of subcontracted Section 3 business(es) and subcontract amount
- ☐ This certification & all supporting documentation for each subcontracted
Section 3 Business

**For business claiming Section 3 status, claiming at least 30 percent of their
workforce are currently Section 3 residents or were Section 3 eligible
residents within 3 years of date of first employment with the business:**

- ☐ List of all current full time employees
- ☐ List of employees claiming Section 3 status
- ☐ Certification for Section 3 Residents (at least 30% of all current full-time
employees) with supporting documentation showing Section 3 status
immediately prior to the date of first hire

**Evidence of ability to perform successfully under the terms and conditions
of the proposed contract:**

- ☐ Current financial statement or Income Tax Return
- ☐ Statement of ability to comply with public policy (federal, state or city work
experience)
- ☐ List of owned equipment
- ☐ List of all contracts for the past two years

Authorized Name, Title and Signature

Date _____

Please submit documentation of the following items to Tracy Atkinson at City of
Flint, Dept. of Community and Economic Development, 1101 S. Saginaw St.,
Flint, Michigan 48502, tatkinson@cityofflint.com, 810-766-7426 ext. 3059,
810-766-7351 (fax)

City of Flint Housing Administration Division
SECTION 3 DEVELOPER/SUBGRANTEE EMPLOYMENT ROSTER
Submitted on Execution of Contract

Contractor Name: _____ Contact Person: _____ Telephone: _____ Fax: _____

Project Name: _____ Contact Number: _____ Reporting Period: _____

Please list all current employees on your project – Identify Section 3 Certified employees

Name	Address	Telephone	Starting Date	Ending Date	Position
1.					
2.					
3.					
4.					
5.					
6.					
7.					
8.					
9.					
10.					

Signature _____ Date: _____

To be submitted with monthly activity/pay requests

City of Flint Housing Administration Division
SECTION 3 GENERAL CONTRACTOR'S MONTHLY STATUS REPORT
WORK-SHEET

Reporting Period: _____

Contact Person: _____

Date Submitted: _____

Telephone: _____

Project Name	Contract Dollar Amount	Sub-Contractor	Start Date	Scheduled Completion Date	Total Hours Worked	Total New Hires	Total Section 3 New Hires	% of Section 3 Hours Worked	Total Contract Dollars to Section 3 Labor

Signature _____ Date: _____

Return with monthly activity report/pay request

SECTION 3 SUB-CONTRACTOR MONTHLY REPORT

SUPPLEMENTAL INFORMATION

1. Reporting Period:

2. Project Name

3. Project Location

(4)	(5)	(6)	(7)	(8)	(9)
Job Category	Total New Hires	Total New Hires that are Section 3 Residents	Total Staff Hours	Total Staff hours for Section 3 Employees & Trainees	Total Section 3 Labor Dollars
Professionals					
Professionals					
Technical					
Office/Clerical					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
Trade:					
(9) TOTAL		0			

Signature _____ Date: _____

Include in monthly activity report/pay request (Sub-contractors submit to General)